#### **Features**

- 50mm thermal transfer method of paper recorder
- · Data logger function for recording without paper
- · Supports RS485 communication and dedicated communication port to set or monitor parameters in real-time by PC/PLC
- Multi-input with high accuracy 0.2% level (RTD, TC, Analog)
- · 2-channel simultaneous recording in graphic mode and digital mode
- · High visibility and easy setting by LCD dot matrix
- · Supports various option I/O function
- · Small size(W96×H96×L100mm), light weight



Please read "Caution for your safety" in operation manual before using this unit.



#### Manual

- · For more information and instructions, refer to the user manual and the user manual for communication. Visit our web site (www.autonics.com) to download the manuals.
- The user manual includes product specifications, functions, and operations.

#### Integrated device management program(DAQMaster)

DAQMaster is the integrated device management program to set parameters and manage monitoring data.

Visit our website (www.autonics.com) to download user manual and integrated device management program.


< Computer specification for using software >

Item	Minimum requirements			
System	IBM PC compatible computer with Intel Pentium			
System	III or above			
Operating system	Microsoft Windows 98/NT/XP/Vista/7			
Memory	256MB or more			
Hard disk	More than 1GB of free hard disk space			
VGA	1024×768 or higher resolution display			
Others	RS-232 serial port(9-pin), USB port			

< DAQMaster screen >




#### Ordering information

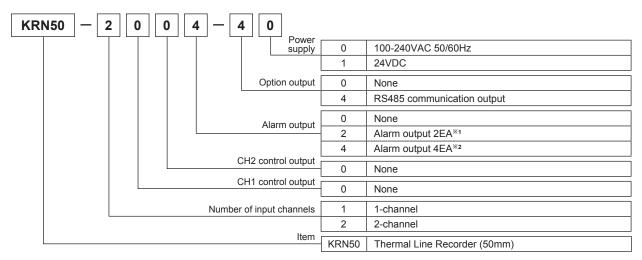

X 1. When selecting this for 2CH model, 2EA alarm outputs for CH1 are available. In other words, you cannot set 1EA for CH1 and 1EA for CH2. X 2. It is selectable only for 2CH model.


#### Connections

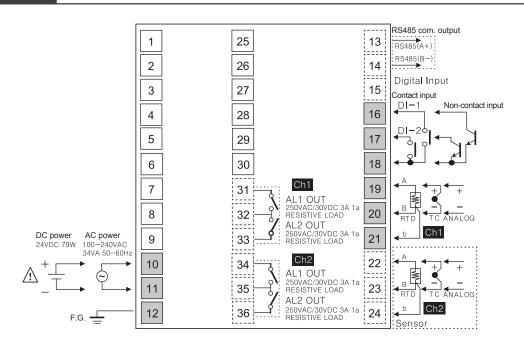

- X Shaded terminals are for the standard model. (power terminal, CH1 input terminal, DI input terminal)
- X Dot line terminals are for the option model. (CH2 input terminal, alarm output terminal, communication output terminal)
- X When using 2-wire RTD, short B and b terminals.

#### **Dimensions**

(unit:mm)

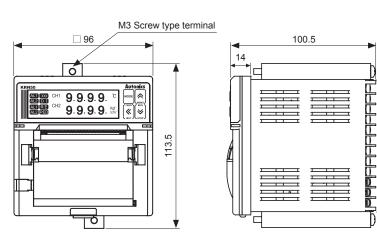

# (96×(N-1)+92)\*0 92\*0.5 Parallel mounting

• Panel cut-out

·N = Quantity ·Panel thickness: 1 to 4 mm A. Recorder

B. Indicator

C. Converter

D. Controller

E. Thyristor unit

F. Pressure transmitter

G. Temp. transmitter

H. Accessories

KRN100

#### **Specifications**

Series		KRN50				
Power	AC voltage	100-240VAC 50 to 60Hz				
supply	DC voltage	24VDC				
Allowable AC voltage		85 to 110% of rated voltage				
voltage range DC voltage		90 to 110% of rated voltage				
Power AC voltage		Max. 34VA				
consumption	DC voltage	Max. 79W				
Display method	d	LCD Dot matrix Display (resolution 128×32 Dot)				
	RTD	JPt100 $\Omega$ , DPt100 $\Omega$ , DPt50 $\Omega$ , Cu100 $\Omega$ , Cu50 $\Omega$ (5 types)				
	TC	K, J, E, T, B, R, S, N, C, G, L, U, PLII (13 types)				
Input type	Analog	· Voltage: -50.0-50.0mV, -199.0-200.0mV, -1.000-1.000V, -1.00-10.00V (4 types) · Current: 0.00-20.00mA, 4.00-20.00mA (2 types) ※ For current input, connect external 50Ω B class (0.1%) high-accuracy resistor				
	Contact	Input ON: Max. 1kΩ, OFF: Min. 100kΩ				
Event input	Non-contact	Input ON: Residual voltage max. 1V, OFF: Leakage current max. 0.05mA				
	Outflow current	Approx. 0.3mA				
	RTD	±0.2%F.S.±1digit(25±5°C), ±0.3%F.S.±1digit(0 to 20°C, 30 to 50°C)				
Display accuracy <sup>×1</sup>	TC	Below -100°C for TC is ±0.4%F.S.±1digit				
Analog		(TC-K2 has same accuracy with TC-K1 and -200 to 1350°C range.)				
Record accura	су	±0.5%F.S.				
Alarm output		CH1(AL1, AL2), CH2(AL1, AL2) Relay output(250VAC/30VDC 3A 1 a)				
Alarm output h	ysteresis	ON/OFF interval setting for alarm output: 1 to 999digit variable				
Communication output		RS485 communication output(Modbus RTU protocol)				
Set method		Setting by front keys				
Sampling cycle	9	500ms/channel×2 channels = 1000ms				
Dielectric stren	igth	2300VAC 50/60 Hz for 1 min.(charging terminal of the other polarity)				
Vibration		0.75mm amplitude at frequency of 10 to 55Hz (for 1 min.) in each of X, Y, Z directions for 1 hour				
Relay life cycle	;	Mechanical: Over 5,000,000 operations, Electrical: Over 100,000 operations				
Insulation resis	stance	Over 100MΩ (at 500VDC megger)				
Noise resistan	ce	Square shaped noise by noise simulator (pulse width 1µs)±2kV				
	Method	Direct thermal line print				
Deint	Resolution	8 dot/mm				
Print	Dots	384 dot/Line				
	Life cycle	50km				
	Graphic mode	Record speed(recording paper speed): 10, 30, 60, 120, 240, 480, 940mm/hour · Memo cycle: 30s, 1m, 5m, 10m, 15m, 30m, 1h, 2h, 3h, 4h, 8h, 16h, 24h				
Digital mode		TEXT mode record cycle: 00m 05s to 99m 59s				
Record	Paper	Thermal Direct Receipt Paper (57mm×16m)				
	Paper supply method	Clamshell type				
	Language	Korean, English				
Can de como d	Ambient temperature	0 to 50°C, storage: -20 to 60°C				
Environment	Ambient humidity	35 to 85%RH, storage: 35 to 85%RH				
Approval		C€				
Unit weight		Approx. 700g				

- $\ensuremath{\mathbb{X}}$  1. Exception range for measurement accuracy by each sensor
  - · J: -200 ≤ T ≤ -100 ±2.7°C
  - · R, S, C, G:  $0 \le T \le 100 \pm 5.2$ °C
  - · B: Below 400°C, there is no accuracy standards.
  - · U, T: -200  $\leq$  T  $\leq$  -100  $\pm$ 3.5°C, -100  $\leq$  T  $\leq$  400  $\pm$ 2.5°C
- X Environment resistance is rated at no freezing or condensation.

#### Input type and range

Ir	put type		Dot	Display	Input range(°C)	Input range(°F)				
	K(CA)		1	TC-K1	-200 to 1350	-328 to 2462				
	K(CA)		0.1	TC-K2	-199.9 to 999.9	-199.9 to 999.9				
	1/10)		1	TC-J1	-200 to 800	-328 to 1472				
	J(IC)		0.1	TC-J2	-199.9 to 800.0	-199.9 to 999.9				
	E(CR)		1	TC-E1	-200 to 800	-328 to 1472				
	E(CK)		0.1	TC-E2	-199.9 to 800.0	-199.9 to 999.9				
	T(CC)	T(00)		TC-T1	-200 to 400	-328 to 752				
1(00)			0.1	TC-T2	-199.9 to 400.0	-199.9 to 752.0				
	B(PR)		1	TC-B	100 to 1800	212 to 3272				
Thermocouple	R(PR)		1	TC-R	0 to 1750	32 to 3182				
	S(PR)		1	TC-S	0 to 1750	32 to 3182				
	N(NN)		1	TC-N	-200 to 1300	-328 to 2372				
	C(TT) *1		C(TT) *1		C(TT) *1		1	TC-C	0 to 2300	32 to 4172
L	G(TT) *2		1	TC-G	0 to 2300	32 to 4172				
	L(IC)		1	TC-L1	-200 to 900	-328 to 1652				
			0.1	TC-L2	-199.9 to 900.0	-199.9 to 999.9				
	LI/CC)	II(CC)		TC-U1	-200 to 400	-328 to 752				
	U(CC)		0.1	TC-U2	-199.9 to 400.0	-199.9 to 752.0				
	Platinel II		1	TC-P	0 to 1390	32 to 2534				
	Cu50Ω		0.1	CU50	-199.9 to 200.0	-199.9 to 392.0				
	Cu100Ω		0.1	CU100	-199.9 to 200.0	-199.9 to 392.0				
	ID+1000		1	JPT1	-200 to 600	-328 to 1112				
RTD	31-110022	JPt100Ω		JPT2	-199.9 to 600.0	-199.9 to 999.9				
	DPt50Ω		0.1	DPT50	-199.9 to 600.0	-199.9 to 999.9				
	DD#1000		1	DPT1	-200 to 600	-328 to 1112				
	DPt100Ω		0.1	DPT2	-199.9 to 600.0	-199.9 to 999.9				
		-50.0 -	50.0mV	50mV						
	Voltage	-199.9 -	200.0mV	200mV						
Angles	Voltage	-1.000 -	1.000V	1V	-1999 t	o 9999				
Analog		-1.00 -	10.00V	10V	(display range depends on	the decimal point position)				
	Current	0 -	20mA	0-20						
	Current	4 -	20mA	4-20						

※ 1. C(TT): Same as	existing	W5(TT)	type	sensor.
---------------------	----------	--------	------	---------

 $<sup>\</sup>times$  2. G(TT): Same as existing W(TT) type sensor.

A. Recorder

B. Indicator

C. Converter

D. Controller

E. Thyristor unit


F. Pressure transmitter

G. Temp. transmitter

H. Accessories

KRN100

#### Part descriptions



- ① CH 1 alarm(AL1) output indicator: Turns ON when AL1 of input channel 1 operates.
- ② CH 1 alarm(AL2) output indicator: Turns ON when AL2 of input channel 1 operates.
- ③ CH 2 alarm(AL1) output indicator: Turns ON when AL1 of input channel 2 operates.
- ④ CH 2 alarm(AL2) output indicator: Turns ON when AL2 of input channel 2 operates.
- Recording start(>>>)/Recording stop(III) indicator: >>>> turns ON when start recording (RUN). III turns ON when stopping recording (STOP).
- ® Digital input indicator: Turns ON when setting digital input.
- ② Recording reservation(RE) indicator: RE turns ON when recording reservation operates.
- ® Recording paper status(PED)indicator: PED turns ON if running out of recording paper during recording (RUN).
- (CH) display part: Displays input channel of currently displayed PV on the PV display part.
- ® PV display part: In RUN mode, displays PV of the current channel. In setting mode, displays parameters and mode setting values.
- 1 Unit display part: Unit of relevant channel is indicated.
- @ MODE key: Used to enter setting mode and changing SV mode.
- - key: Digital memo key, 

    key: Recording Run/Stop key
- - Paper feeding key (STOP), printing parameter setting information key (RUN)
- ® PC loader port: It is a PC loader port for serial communication to set or monitor parameters by PC. Used to connect SCM-US (USB to Serial converter, sold separately).

#### **Functions**

#### ■ Input unit and Scale of temperature sensor

#### © Temperature unit setting by input type [ CH ☐ Temp Unit ]

You can set the temperature unit as Celsius(°C), or Fahrenheit(°F) for each input temperature sensor.

When changing temperature unit for temperature sensor input (Celsius[  $^{\circ}$ C ]  $\leftrightarrow$  Fahrenheit[  $^{\circ}$ F ]) current PV is also changed by the conversion calculation.

For analog input type, this parameter [ CH Temp Unit ]is not displayed.

When changing temperature unit, the related bias value is initialized as 0. The other parameter values except bias maintains the existing values.

- Set range: °C / °F
- Factory default: °C (unit: -)

#### 

For temperature sensor input type (TC, RTD), this function is to set the scale value of the recorded graph on recording paper. You can set the recording range to record the specified section detailed with curve of graph.

When the input exceeds the graph high/low limit scale range, it is recorded on the empty space of recording paper of at the left/right side of graph (approx. 1mm).

At the starting point of digital memo recording, even though input exceeds graph high/low limit scale range, the input within high/low limit input range is recorded as its actual value.

#### 

This function is to set low limit scale value of graph within input range of each input type.

· Set range:

Min. range by each sensor input type to Graph high limit scale value[ CH $\!\square$  Hi Graph ]- F.S. 5%

• Factory default: -200 (unit: digit)

※ For analog input type, this parameter is not displayed.

#### © Graph high-limit scale value [ CH ☐ Hi Graph ]

This function is to set high limit scale value of graph within input range of each input type.

· Set range:

Graph low limit scale value[ CH□ Lo Graph ] + F.S. 5% to Max. range by each sensor input type

· Factory default: 1350 (unit: digit)

※ For analog input type, this parameter is not displayed.

#### User input range

For analog input type, this function is to set input range. Set low limit input value [CH Lo Range] and high limit input value [CH Hi Range] to limit the input range.

Set range

Low limit input value: Min. input range to High limit input value -5% F.S.

High limit input value: Low limit input +5% F.S. to Max. input range

· Factory default

Low limit input value: Min. input range High limit input value: Max. input range

#### **■ Input correction [** CH □ In Bias ]

This function is to correct the error occurring from a thermocouple, a RTD or analog input out of allowable error range of this unit.

This is also available to correct error when a sensor cannot contact the subject position by calculating the error temperature.

Variable temperature sensors have accuracy level. Because high accuracy type is expansive, standard thermocouples are generally used. By executing this function, you can get more accurate temperature from standard thermocouples.

When executing input correction function, you should measure the error from a sensor accurately. If the measured error is not correct, error may be greater.

Set input correction value to each channel. [ CH1 In Bias, CH2 In Bias ]

When changing temperature unit ( ${}^{\circ}C \leftrightarrow {}^{\circ}F$ ) for temperature sensor input type (TC or RTD), or input type, correction value is initialized as 0.

· Set range: -999 to 999

· Factory default: 0000 (unit: digit)

#### Display scale


For analog input, this function is to set (-1999 to 9999) for particular high/low limit value in order to display high/low limit value of measurement input. If measurement inputs are 'a' and 'b' and particular values are 'A' and 'B', it will display a=A, b=B as below graphs.

Set range:

Low limit scale, High limit scale: within F.S. range

Factory default :

Low limit scale: 0.0, High limit scale: 100.0

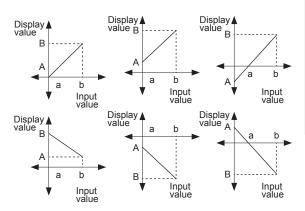


Display scale function is able to change display value for max./min. measured input by setting high limit scale [ Hi Scale ] and low limit scale [ Lo Scale ].


Ex) Set high/low scale value (input range is 0 to 10V)

• Lo Scale = 0.00


• Hi Scale = 5.00, 10.00, 15.00, -10.00



Lo Scale = 10.00, Hi Scale = -10.00



• Lo Scale = -5.00, Hi Scale = 5.00



When changing input type, high/low scale is changed as factory default. A. Recorder

B. Indicator

C. Converter

D. Controller

E. Thyristor unit

F. Pressure transmitter

G. Temp. transmitter

H. Accessories

KRN100

#### Scale decimal point [ CH ☐ Sc Point ]

It is able to change decimal point position for high/low limit scale value. It changes decimal point position of display value (PV and SV, etc).

• Set range: 0 / 0.0 / 0.00 / 0.000

• Factory default: 0.0 (unit: -)

#### Display unit [ CH □ Dp Unit ]

This function is to set unit for recording and displaying. This parameter is displayed only for analog input type at [  $CH \square$  In Type ] parameter.

Even though changing analog input unit, PV is not converted different with temperature unit changing.

· Set range:

 $^{\circ}$ C,  $^{\circ}$ F, %, ppm, V, mV, mA, Pa, kPa, pH, psi, kgf/cm², m³/h, mmHg, mmH $_2$ O, us0 to us9

Factory default: % (unit: - )

#### ■ Alarm output [ Alarm Setup ]

Alarm output operates too high or low temperature/scale value of the subject during displaying temperature/scale value. When occurring alarm output by each channel, the related alarm indicators (CH1 = AL1, AL2 CH2 = AL1, AL2) turn ON.

If alarm output occurs during recording, it records that time, PV, and alarm information(AL HI =↑, AL LO =↓, SBA = B, P.END = P) on recording paper.

To divide HI and LO marks of AL1 and AL2, AL1 marks (↑↓) and AL2 marks (↓↑).

#### 

Mode	Name	Record	Operation	Description
Off	No alarm	_	_	_
PV.Hi	High limit alarm	AL1= ↑ AL2= ↑	OFF ▼H ON OFF ▼H ON  PV 90 110  High limit AL temp. (AL1.H): 90  OFF ▼H ON  OFF ▼H ON	PV ≥ high limit alarm temperature(AL1.H) , alarm output is ON
PV.Lo	Low limit alarm	AL1= ↓ AL2= ↓	ON H OFF ON H OFF  PV 90 110  Low limit AL temp. (AL1.L): 90 (AL1.L): 110	PV ≤ low limit alarm temperature (AL1.L) , alarm is ON
SBA	Sensor break alarm	AL1=B AL2=B	_	When input is not connected or disconnected during recording, alarm output is ON. You can check the input break using external alarm output contact by buzzer or others.
P.End	No paper alarm	AL1=P AL2=P	_	If running out of recording paper during recording, alarm output is ON. (measured value is saved at system memory) When recording paper is replaced, alarm is cleared automatically (standard alarm) and P is printed on recording paper when printing back up data.

#### $\odot$ Alarm option [ CH $\square$ AL $\square$ Opt ]

Option	Name	Description	
None Standard alarm If it is an alarm condition, alarm output is ON. Unless an alarm condition, alarm output is OFF.			
Latch Alarm latch If it is an alarm condition, alarm output is ON. An ON condition is latched. (Holding the alarm output			
StBy  Standby sequence  First alarm condition is ignored. From the second alarm condition, standard alarm operates.  When power is ON and it is not an alarm condition, standard alarm operates.			
La+St  Alarm latch and standby sequence  High it is an alarm condition, it operates both alarm latch and standby sequence. When power is ON and it is an alarm condition, it is ignored. From the second alarm condition, alarm latch operates.		When power is ON and it is an alarm condition, it is ignored.	

0	Alarm ter	mperature setting	[	$CH \square AL \square$	Lo	],	[	CH □AI		Hi	]
---	-----------	-------------------	---	-------------------------	----	----	---	--------	--	----	---

0 1 1 1			
Set alarm value for each	ch alarm output operation	. If current value is the al	arm value. alarm output is ON.

According to the alarm output operation mode [  $CH \square AL \square Type$  ] setting, [  $CH \square AL \square Lo$  ], [  $CH \square AL \square Hi$  ] parameters of the channel is displayed.

- When selecting high limit alarm [ PV.Hi ], only [ CH □AL □ High ] is displayed.
- When selecting low limit alarm [PV.Lo], only [CH□AL□Low] is displayed.
- When changing Input Type Setup[ CH□In Type ], [ CH□AL□High ] or [ CH□AL□Low ] value is changed within the input range of [ CH□In Type ].
- ※For temperature input type (TC or RTD), if burn occurs by sensor open when alarm temperature is set as [ CH □AL □Low ],
  the alarm operates.
- · Set range: Within input type and range
- Factory default: [ CH AL Lo ]: Low limit scale value / [ CH AL Hi ]: High limit scale value (unit: °C/°F)


#### 

"H" of alarm output operation mode is hysteresis. Set ON and OFF interval of alarm output.


- Set range: 001 to 999 (decimal point position is same with that of input decimal point)
- · Factory default: 001(unit: digit)

#### © Example of alarm output

#### • High limit alarm [ PV.Hi ]

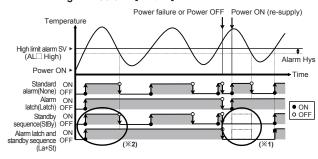

#### • Low limit alarm [ PV.Lo ]

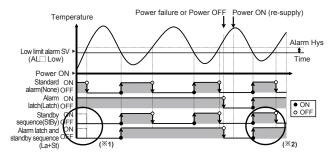

#### **X** Standby sequence

When power is ON and it is alarm condition, this condition is ignored. From the second alarm condition, standard alarm operates. (Refer to  $\times 1$ . of the above graph.)

When power is ON and it is not an alarm condition, standard alarm operates from the first condition. (Refer to  $\times 2$ . of the above graph.)

Conditions of re-applied standby sequence after occurring standby sequence:

Power ON, changing alarm value, or alarm clear forced

#### **XAlarm** latch

If it is an alarm condition, alarm output is ON even though it is out of alarm range. (Holding the alarm output)

· Conditions of clear alarm latch:

To clear alarm latch, press the  $\triangle + \bigvee$  keys for 3 sec. when PV is below alarm value. For alarm latch by sensor break alarm (SBA) and no paper alarm (P.End), press the  $\triangle + \bigvee$  keys for 3 sec. to clear the alarm.

When changing alarm output operation mode [ CH 

□AL □Type ], alarm values [ CH □AL □High, Low ] are initialized as max./min. value automatically.

When changing alarm output option, the alarm value maintains the existing value.

#### ■ Record mode[ Rec Mode ]

There are two modes; graph mode and digital mode to record current PV on recording paper.


- · Set range: Graph / Digital
- · Factory default: Graph (unit: -)

#### 

Graph mode records PV with graph of curve on recording paper.

It records current date (year-month-day), high/low limit scale value of each channel by every 1 hour.

Depending on the set digital memo period [ Memo Period ], it records current time (hh:mm:ss) and PV of each channel periodically.

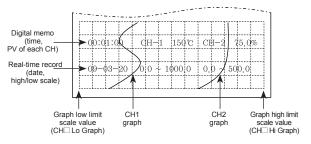

#### O Digital mode [ Digital Mode ]

Digital mode records PV with numerical value on recording paper. It records current time (hh:mm:ss) and PV of each channel periodically by the set print/record period[ Rec Period ].

For digital model, it records current date (year-monthday), high/low limit scale value of each channel by every 24 hours.

It records current PV by digital memo function through the front key( key for 3 sec.), DI input terminal (DI-2, 1sec.) or communication.

[				۱۰-۰-۱
00:02:00	CH-1	110℃	CH-2	75.0%
00:03:00	CH-1	110℃	CH-2	75.0%
00:01:00	CH-1	150℃	CH-2	75.0%
09-03-20	0 ~	1000	0 ~	500
23:59:00	CH-1	150℃	CH-2	72.0%
23:58:00	CH-1	$120^{\circ}\mathrm{C}$	CH-2	70.0%
23:57:00	CH-1	80 °C	CH-2	58.0%

A. Recorder

B. Indicator

C. Converter

D. Controller

E. Thyristor unit

F. Pressure transmitter

G. Temp. transmitter

H. Accessories

KRN100

#### ■ Reservation record [ Reservation ]

Set the reservation record time in advance and it starts to record at the set record start time (RUN) and stops to record at the set record stop time (STOP).

•Ex) Record Setup Record Mode: Digital

Record Speed: 5sec

Reservation Setup Start Time: 12:00

Stop Time: 12:02

(Record Start)12:00:00  $\rightarrow$  12:00:05 ...... 12:01:55  $\rightarrow$  12:02:00(Record Stop)

To using reservation record function, set [ Reservation ] as  $\lceil \text{On} \rfloor$  and record start time (Start Time) and record stop time (Stop time) parameters are displayed. It records during the set time.

When returning to RUN mode after setting reservation record, it stops recording and the Recording reservation (RE) indicator turns ON in display part.

When power is re-supplied by power failure during recording by reservation, if the time is within the reservation, it records continuously. Or not, it stops recording.

When setting [ Reservation ] as 「Off」 and record start time (Start Time) and record stop time (Stop Time) parameters are not displayed.

- Set range: Off(not using reservation record function)
   On(using reservation record function)
- · Factory default: Off

#### External digital input terminal

### O DI-1 function [ Digital Input 1 ] : Record start(RUN)

This function is to operate record start (RUN) by external digital input terminals (16, 18).

When setting [ Digital Input1 ] as 「Run」, it operates recording at the set time of print/record period [ Rec Period ] on recording paper while external digital input terminal is short.

When starting DI-1 function at first, it records the current date and time as below.

- 현재시간 2009년03월19일 12시30분00초(Korean)
- DATE 03-19-2009 12:30:00(English)

When setting [ Digital Input1 ] as  $\lceil \text{Off}_{J} \>$  , it does not operate any other function.

- Set range: Off / Run
- Factory default: Off (unit: -)

#### O DI-2 function [ Digital Input 2 ]: Digital memo

This function is to operate digital memo by external digital input terminals (17, 18).

When setting [ Digital Input2 ] as 「Memo」, it operates recording. It records current PV of each channel and current time (hh:mm:ss) when one signal is input to the external digital input terminal.

It is same memo function with by the front key ( key, 3sec.)

When setting [ Digital Input2 ] as  $\lceil \text{Off}_{J} \>$  , it does not operate any other function.

- · Set range: Off / Memo
- Factory default: Off (unit: -)

#### Data save and re-recording when running out of recording paper

This recorder saves the measured data in inner memory and records it at recording paper after supplying the power. When running out of recording paper (P.End), this recorder cannot record the data but saves it.

After replacing recording paper, the message for whether record the un-recorded data at the display part.

Select All or Part and the recorder records the un-recorded data which is from the time of running out of recording paper. After recording this, normal recording continues.

Record previous data in memory ? All Part Cancel

- All(all of unrecorded data): Records/Prints the whole range data from the time of paper end to current time
- Part(part of unrecorded data): Records/Prints the set part (start time/stop time) data of the after time of paper end
- Cancel(ignores not recording): Not record/print the saved data in memory and returns to RUN mode.
- · Set range: All / Part / Cancel (unit: -)
- · Factory default: Cancel

When running out of recording paper during recording (RUN) state, recording (RUN) state changes stop recording (STOP) state automatically.

#### ■ Parameter setting information print [ List Print ]

This function is to record the parameter setting information on recording paper.

Press the **key** key for over 3 sec. during recording, and it stops recording PV. After recording setting information of each menu, it records PV again.

Recorded parameter:

tag name, input type, display unit, input range, display range, alarm operation mode, alarm value, communication

When starting record, depending on the setting of [ RUN On State ] parameter, it records parameter setting information.



CH 1 CH	9
	. 4
	JMI
INPUT TC-K1 mA	ı.
UNIT °C %	
RANGE -200~1350 4~	20
SCALE 0~400 0~	1000
ALARM 1 HIGH HIG	ЗH
VALUE 300 900	)
ALARM 2 LOW LO	W
VALUE 150 700	)
INTERFACE RS485 Mo	dbus RTU

<Korean>

<English>

#### ■ Backup data recording [ Rec Backup ]

It is similar with data logger and it saves record data in inner memory.


Based on the saved back up data in inner memory, you can select whole range or part range of data to print.

When entering [ Rec BackUp ] parameter, it displays the fixed backup start time (Start) and current save time (Stop) to select the desired time within the saved time range as below.

> Start: 03/09 12:01 Stop: 03/09 12:10 Graph Digital Cancel

In the screen, the current save time (Stop) is displayed as fixed to select the desired time range within the saved time range but in the product, this time is updated continuously.

After entering the parameter, change (Stop) to current time or re-entering the parameter and (Stop) displays the current time to print backup data of current time.



Data storage space of this product is 18138EA (for 1CH) and the save time is different by record mode as the below

Backup data record supports graph mode and digital mode. To print the backup data which is the different mode from the saved record mode (ex: saved record mode: digital mode, to-be-printed record mode: graph mode), it prints the data by the record time (for digital mode) or cycle (for graph mode).

When the saved record mode of backup data is digital mode, the backup data save time is different by record time. (ex: record time of digital mode: 5 min., backup data save interval: 5 min., time changing of stop time: every 5min.)

If the total record backup time is not over as below table, start time is fixed and only stop time is updated.

If the total record backup time is over as below table, from that time, both start time and stop time are updated.

- Set range: Cancel / Yes (unit: -)
- · Factory default: Cancel

Graph Mode	Interval of	Total record backup time		
Rec Speed	saving time for 1 data	2CH mode	1CH mode	
960mm/h	0.5 sec.	11542x0.5 sec. = Approx. 1 hour 30 min.	18138x0.5 sec. = Approx. 2 hours 30 min.	
480mm/h	1 sec.	Approx. 3 hours	Approx. 5 hours	
240mm/h	2 sec.	Approx. 6 hours	Approx. 10 hours	
120mm/h	4 sec.	Approx. 12 hours	Approx. 20 hours	
60mm/h	8 sec.	Approx. 24 hours	Approx. 40 hours	
30mm/h	16 sec.	Approx. 48 hours	Approx. 80 hours	
10mm/h	48 sec.	Approx. 6 days (153 hours)	Approx. 10 days (241 hours)	

Digital Mode	Interval of	Total record backup time		
Rec Speed	saving time for 1 data	2CH mode	1CH mode	
5 sec.	5 sec.	11542x5 sec. = Approx. 16 hours	18138x5 sec. = Approx. 25 hours	
1 min.	60 sec.	Approx. 8 days	Approx. 12 days	
to	to	to	to	
60 min.	3600 sec.	Approx. 480 days	Approx. 755 days	
to	to	to	to	
99 min. 59 sec.	6000 sec.	Approx. 800 days	Approx. 1259 days	

#### ■ Lock [ Setting Lock ]

It limits to check parameter set value and to change it.

Parameter	OFF	Loc1	Loc2	Loc3
Alarm Setup Reservation Setup	•	•	•	0
Input Setup Record Setup Option Setup RS485 Setup	•	•	•	0
Date/Time Setup Record Backup_Data Environment Setup	•	•	0	0

Enable to check/set. ①: Enable to check, disable to set.

O: Disable to check

Even though setting as  $\lceil Loc1 \rfloor$ ,  $\lceil Loc2 \rfloor$ ,  $\lceil Loc3 \rfloor$ , [ Setting Lock ] parameter is displayed and you can change the setting.

· Factory default: Off (unit: -)

A. Recorder
B. Indicator
C. Converter
D. Controller
E. Thyristor unit
F. Pressure transmitter
G. Temp. transmitter
H. Accessories

KRN100


#### **■** Error

This product displays error messages when error occurs.

Message	Description
	When input value is higher than the rated range, flashes in 0.5 sec. (automatically cleared when input value is within the rated range)
нннн	• Analog input Within ±10% of input range F.S., LCD screen displays only PV and it records PV and HH or LL at the same time on recording paper as the 'a' of below figure. Over ±10% of input range F.S., LCD screen and recording paper display HHHH, HH or LLLL, LL as the 'b' of below figure.  For scale value, when Hi, Lo scale value is Hi < Lo, it displays in reverse.  For 0-20mA input, when Hi scale is set as 0, Lo scale is set 100 and input value is out of 20mA, it displays LLLL, not HHHH. (HHHH,
	LLLL are not displayed in analog input 1V.)  • TC, RTD input
	Set Hi, Lo Graph values within the temperature range of each temperature sensor. When PV is over Hi, Lo Graph value, LCD screen displays only PV and it records PV and HH or LL at the same time on recording paper as the 'c' of below figure.
	Set Hi, Lo Graph values same as the temperature range of each temperature sensor.
	When PV is over Hi, Lo Graph value, LCD screen and recording paper display HHHH or LLLL as the 'd' of below figure.
LLLL	When input value is lower than the rated range, flashes in 0.5 sec. (automatically cleared when input value is within the rated range)
LLLL	In case of analog input, it flashes below 10%. (HHHH, LLLL are not displayed in analog input 1V.)
BURN	Flashes when input is disconnected except 10V input. When input is connected, it cleared automatically.
Time Set!!	Displayed by wrong time setting for record backup and re-record of P.End or same start and stop time for reservation record.  Press the MODE key to clear it and it returns to existing settings.
Over range!!	Displayed when setting value is over high/ low limit value during setting Hi, Lo Graph and range in Input Type Setup.  Press the MODE key to clear it and it returns to existing settings.
Hi < Lo!!	Displayed if setting value is Hi <lo (ex:="" -122.5°c.="" -123°c="" -200="" 1350="" 1350°c,="" 5%="" <="" and="" case,="" clear="" displays.)="" during="" each="" error="" existing="" for="" graph="" hi="" hi,="" high="" in="" input="" is="" it="" key="" limit="" lo="" lo!!="" low="" max.="" mode="" not="" of="" or="" press="" range="" rated="" returns="" scale="" sensor="" setting="" settings.<="" setup.="" sv="" tc-k1="" td="" the="" this="" to="" type="" value="" value+f.s.="" within=""></lo>

When the related channel generates error operation, the corresponding message is recorded at the recording time of the channel.

As the below figure, HH and LL message displays when alarm does not occurs.



#### ■ Communication

This function is to set or monitor parameters from external upper system (PC, PLC, etc) or transmit data to external devices by communication.

Communication is available by terminals or the front PC loader port. (refer to the connections for connecting terminals.)

You cannot use communications by terminals and the front front PC loader port at the same time. When connecting the front PC loader port with communication device, communication by terminals (transmission function of master) is blocked automatically.

#### O Interface

Standard	EIA RS485
Max. connections	31 units (address: 01 to 99)
Communication method	2-wire half duplex
Synchronous method	Asynchronous
Com. distance	Within max. 1km
Com. speed	1200, 2400, 4800, 9600, 19200, 38400, 57600bps
Response wait time	0.05 to 0.99sec
Start bit	1bit (fixed)
Stop bit	1 or 2bit
Parity bit	None, Odd, Even
Data bit	8bit (fixed)
Protocol	ModBus RTU

#### © Communication address [ Address ]

Set range: 01 to 99

• Factory default: 01 (unit: -)

## © Communication speed (Bit Per Second) [ Baud Rate ]

· Set range:

1200, 2400, 4800, 9600, 19200, 38400, 57600

• Factory default: 9600 (unit: bps)

#### O Parity Bit [ Parity Bit ]

· Set range: None, Even, Odd

Factory default: None

#### O Stop Bit [ Stop Bit ]

• Set range: 1,2

· Factory default: 2 (unit: Bit)

#### © Communication response wait time [ Resp Time ]

• Set range: 0.05 to 0.99


• Factory default: 0.05 (unit: sec.)

#### © Communication write enable/disable[ Com Write ]

This function is to enable or disable to change/write SV of the saved parameter by communication (PC/PLC). Reading of parameters is available.

- Enable: Enables to change/write SV of each parameter
- Disable: Disables to change/write SV of each parameter
- Set range: Enable / Disable
- · Factory default: Enable (unit: -)

#### O Application of system organization



XIt is recommended to use SCM-US48I (USB to RS485 converter), SCM-38I (RS232C to RS485 converter), SCM-US (USB to Serial converter) of Autonics.

#### Communication converter(sold separately)

• SCM-US48I (USB to RS485 converter)

 SCM-38I (RS232C to RS485 converter)





• SCM-US (USB to Serial converter)

CE



#### Image download

#### O User unit download

You can download the desired unit as 16×16 size image (through DAQMaster, the integrated device management program). Select the user unit in setting mode.

#### O User logo download

User logo is recorded at the dotted box (384×80 size) of the below figure. You can download the desired logo as 384×80 size image (through DAQMaster, the integrated device management program) and check this when printing the list.

L					
DATE 03-10-	-2009 12:10:1	0	DATE 03-10-	-2009 12:10:1	0
TAG NAME INPUT UNIT RANGE SCALE ALARM 1 VALUE	TC-K1 °C -200~1350	CH 2 HUMI mA %	TAG NAME INPUT UNIT RANGE SCALE ALARM 1 VALUE ALARM 2	0~400	CH 2 HUMI mA %
INTERFACE	RS485	Modbus RTU	INTERFACE	RS485	Modbus RTU
Recorder KRI A/S: 82-32-	N50 www.auton -820-2422	ics.co.kr		Autonics	5
	.D . C	6.		- After innu	+~

<Before input>


<After input>

\*\*Be sure that downloading the user logo of 384×80 size may cause the problem due to increased current consumption and this image may not be printed normally. Please refrain from the image which has lots of dots. It is recommended to download the image which consists of characters as above.

#### CD booting image download

You can download the desired booing image to display on LCD screen (approx. 3 sec.) when supplying the power.





<Basic image>

<User-made image>

- To download the image, use DAQMaster, the integrated device management program. (When initializing boot image download function of DAQMaster, the booting logo image changes as the left basic image.)
- Basic boot image displays program revision date as fixed.
- Image size should be 128×32 size.
- **X** For more functions, refer to the user manual of KRN50.

A. Recorder

B. Indicator

C. Converter

D. Controller

E. Thyristor unit

F. Pressure transmitter

G. Temp. transmitter


H. Accessories

KRN100

KRN50

A-29

#### **Parameters**

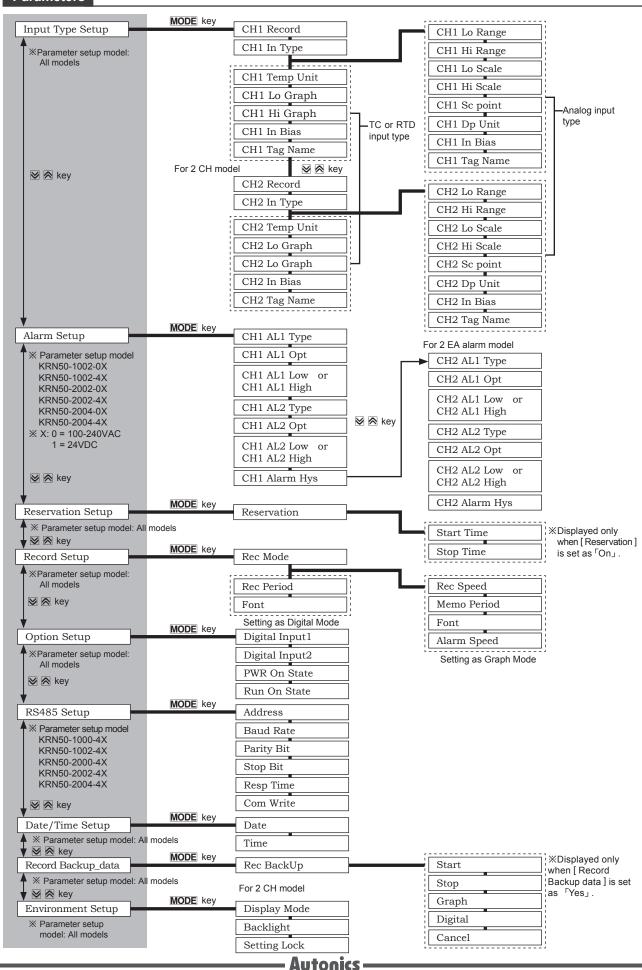

#### **Factory default**

#### ■ Input type setup group [ Input Type Setup ]

Parameter	Default	Parameter	Default	Parameter	Default	Parameter	Default
CH1 Record	On	CH1 Lo Scale *2	0.000	CH2 Record *3	On	CH2 Lo Scale *3	0.000
CH1 In Type	TC.K1	CH1 Hi Scale *2	100.0	CH2 In Type *3	TC.K1	CH2 Hi Scale *3	100.0
CH1 Temp Unit *1	$^{\circ}$	CH1 Hi Scale Decimal Point *2	0.0	CH2 Temp Unit *3	$\mathbb{C}$	CH2 Hi Scale Decimal Point *3	0.0
CH1 Lo Graph *1	-200	CH1 DP Unit *2	%	CH2 Lo Graph *3	-200	CH2 DP Unit **3	%
CH1 Hi Graph *1	1350	CH1 In Bias	0000	CH2 Hi Graph *3	1350	CH2 In Bias *3	0000
CH1 Lo Range *2	-	CH1 Tag Name	CH-1	CH2 Lo Range *3	-	CH2 Tag Name *3	CH-2
CH1 Hi Range *2	-			CH2 Hi Range *3	-		

- X 1. Displayed only when input type(In Type) is temperature sensor (TC or RTD).
- $\ensuremath{\mathbb{X}}$  2. Displayed only when input type(In Type) is analog (voltage/current).
- X 3. Displayed only for 2-channel model

#### ■ Alarm output setup group [ Alarm Setup ]

Parameter	Default	Parameter	Default	Parameter	Default	Parameter	Default
CH1 AL1 Type	PV.Hi	CH1 AL2 Opt	None	CH2 AL1 Type *2	PV.Hi	CH2 AL2 Opt *2	None
CH1 AL1 Opt	None	CH1 AL2 Low *1	-200	CH2 AL1 Opt *2	None	CH2 AL2 Low *1,*2	-200
CH1 AL1 Low *1	-200	CH1 AL2 High *1	1350	CH2 AL1 Low *1,*2	-200	CH2 AL2 High *1,*2	1350
CH1 AL1 High *1	1350	CH1 Alarm Hys	001	CH2 AL1 High	1350	CH2 Alarm Hys *2	001
CH1 AL2 Type	PV.Lo			CH2 AL2 Type *2	PV.Lo		

- X These parameters are displayed only for alarm output model.
- $\ensuremath{\mathbb{X}}$  1. These are related with the setting of alarm output operation mode(AL $\Box$  Type) .
  - $\cdot$  CH  $\square$ AL  $\square$  Type(Off, SBA or P.end): CH  $\square$ AL  $\square$  Low, CH  $\square$ AL  $\square$  High parameters are not displayed.
  - $\cdot$  CH  $\square$  AL  $\square$  Type(PV.Hi): CH  $\square$  AL  $\square$  High parameter is not displayed.
  - $\cdot$  CH  $\square$ AL  $\square$  Type(PV.Lo): CH  $\square$ AL  $\square$  Low parameter is not displayed.
- × 2. Displayed only for 2-channel model.

#### ■ Reservation record setup group [Reservation Setup]

Parameter	Default	Parameter	Default	Parameter	Default
Reservation *1	Off	Start Time	00:00	Stop Time *1	00:01

<sup>※ 1.</sup> Displayed only when (Reservation) is set as 「On」.

#### ■ Record mode setup group [ Record Setup ]

Parameter	Default	Parameter	Default	Parameter	Default
Rec Mode	Graph	Memo Period *1	30min	Font	Korea
Rec Speed *1	10mm/h	Rec Period *2	01m00s	Alarm Speed	10mm/h

- ※ 1. Displayed only when (Rec Mode) is set as 「Graph」.
- imes 2. Displayed only when (Rec Mode) is set as  $\lceil \text{Digital} \rfloor$  .

#### ■ Option setup group [ Option Setup ]

Parame	eter	Default	Parameter	Default	Parameter	Default	Parameter	Default
Digital	Input 1	Off	Digital Input 2	Off	PWR On State	Run	Run On State	List

#### ■ RS485 communication setup group [ RS485 Setup ] (Read Only)

Parameter	Default	Parameter	Default	Parameter	Default
Address	01	Parity bit	None	Response Time	0.05s
Baud Rate	9600bps	Stop Bit	2	Com Write	Enable

#### ■ Environment setup group [Environment Setup]

Parameter	Default	Parameter	Default	Parameter	Default
Display Mode	2CH	Backlight	Temp	Setting Lock	Off

A. Recorder

B. Indicator

C. Converter

D. Controller

E. Thyristor unit

F. Pressure transmitter

G. Temp. transmitter

H. Accessories

KRN100