

Technical Information

Deltabar PMD75B

Differential pressure, level and flow measurement
in liquids or gases



Digital differential pressure transmitter with metal
process isolating diaphragm

Applications

- Pressure measuring ranges up to 250 bar (3 750 psi) (gauge/absolute) and 40 bar (600 psi) (dp)
- Static pressure up to 420 bar (6 300 psi)
- Accuracy: up to $\pm 0.035\%$

Advantages

The new Deltabar generation introduces a robust pressure transmitter that combines numerous benefits: Easiest local or remote operation, allows condition-based maintenance and offers smart safety in processes. The software is designed to simplify the handling. Intuitive and clear wizard navigation guides the user through the commissioning and verification of the device. The Bluetooth connectivity provides a safe and remote operation. The large display with backlight guarantees excellent readability. Heartbeat Technology offers an on-demand verification and monitoring function to detect unwanted anomalies, including plugged impulse lines or changes in the supply voltage, for example.

Table of contents

About this document	4	Climate class	28
Symbols	4	Atmosphere	29
List of abbreviations	5	Degree of protection	29
Turn down calculation	5	Vibration resistance	29
		Electromagnetic compatibility (EMC)	30
Function and system design	7	Process	31
Measuring principle	7	Process temperature range	31
Measuring system	7	Process temperature range (temperature at transmitter)	32
Communication and data processing	7	Process temperature range, seals	32
Dependability for measuring devices with HART or Bluetooth	7	Process pressure range	33
		Ultrapure gas applications	33
Input	9	Hydrogen applications	33
Measured variable	9		
Measuring range	9	Mechanical construction	34
		Design, dimensions	34
Output	14	Dimensions	34
Output signal	14	Weight	39
Signal on alarm	14	Materials in contact with process	40
Load	14	Materials not in contact with process	41
Damping	14	Accessories	42
Ex connection data	14		
Linearization	14	Human interface	43
Flow measurement with Deltabar and differential pressure sensor	14	Operating concept	43
Protocol-specific data	15	Languages	43
Wireless HART data	15	Local operation	44
		Local display	44
Power supply	16	Remote operation	45
Terminal assignment	16	System integration	45
Available device plugs	16	Supported operating tools	45
Supply voltage	17	HistoROM	45
Potential equalization	18		
Terminals	18	Certificates and approvals	46
Cable entries	18	CE mark	46
Cable specification	18	RCM-Tick marking	46
Overvoltage protection	18	Ex approvals	46
		EAC conformity	46
Performance characteristics	19	Certificate of current Good Manufacturing Practices (cGMP)	46
Response time	19	Drinking water approval	46
Reference operating conditions	19	Overfill prevention (in preparation)	46
Maximum measured error (total performance)	19	Functional safety SIL/ IEC 61508 Declaration of Conformity (optional)	46
Resolution	22	Marine approval (pending)	47
Total error	22	Radio approval	47
Long-term stability	22	CRN approval	47
Response time T63 and T90	23	Test reports	47
Warm-up period	23	Pressure Equipment Directive 2014/68/EU (PED)	47
		Oxygen application	48
Installation	24	PWIS-free applications	48
Orientation	24	China RoHS symbol	48
Sensor selection and arrangement	24	RoHS	48
Special mounting instructions	26	Additional certification	48
Environment	28	Ordering information	49
Ambient temperature range	28	Ordering information	49
Storage temperature	28	Scope of delivery	49
Operating altitude	28	Measuring point (tag)	49

Application packages	50
Heartbeat Technology	50
Accessories	51
Device-specific accessories	51
Device Viewer	51
Supplementary documentation	52
Standard documentation	52
Supplementary device-dependent documentation	52
Field of Activities	52
Special Documentation	52
Registered trademarks	52

About this document

Symbols

Safety symbols



This symbol alerts you to a dangerous situation. Failure to avoid this situation will result in serious or fatal injury.



This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in serious or fatal injury.



This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in minor or medium injury.



This symbol contains information on procedures and other facts which do not result in personal injury.

Electrical symbols

Ground connection: \perp

Terminal for connection to the grounding system.

Symbols for certain types of information

Permitted:

Procedures, processes or actions that are permitted.

Forbidden:

Procedures, processes or actions that are forbidden.

Additional information:

Reference to documentation:

Reference to page:

Series of steps: **1.**, **2.**, **3.**

Result of an individual step:

Symbols in graphics

Item numbers: 1, 2, 3 ...

Series of steps: **1.**, **2.**, **3.**


Views: A, B, C, ...

Symbols on the device

Safety instructions: →

Observe the safety instructions contained in the associated Operating Instructions.

List of abbreviations

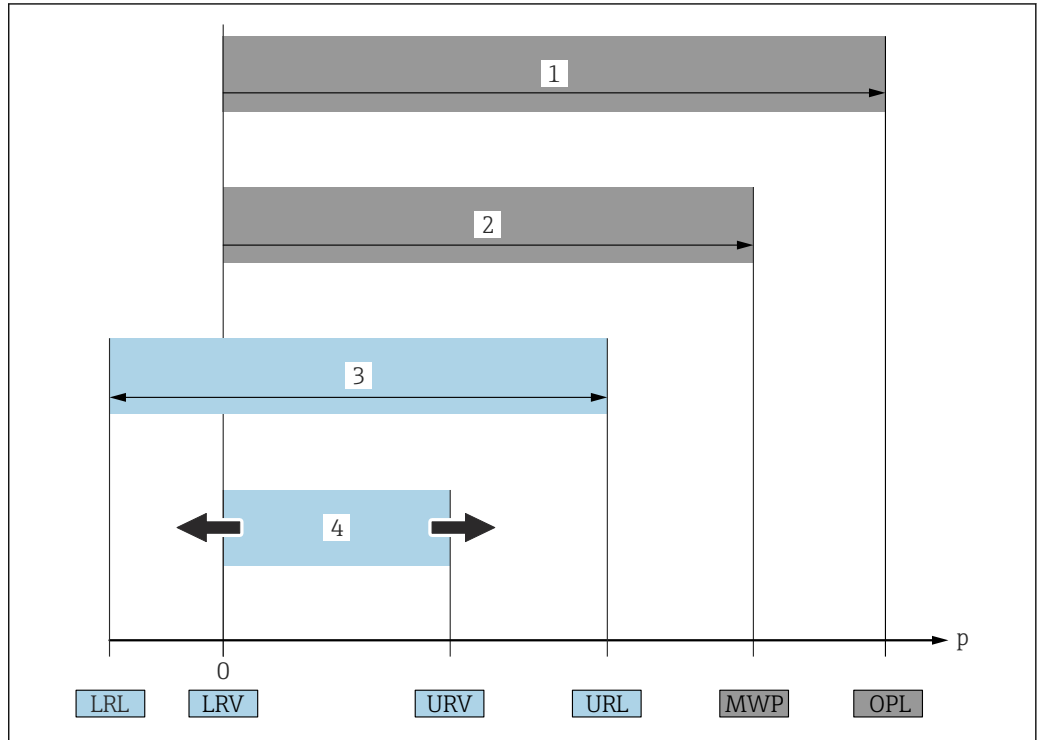


A0029505

- 1 OPL: The OPL (over pressure limit = sensor overload limit) for the measuring device depends on the lowest-rated element, with regard to pressure, of the selected components, i.e. the process connection has to be taken into consideration in addition to the measuring cell. Pay attention to the pressure/temperature dependency.
- 2 MWP: The MWP (maximum working pressure) for the sensors depends on the lowest-rated element, with regard to pressure, of the selected components, i.e. the process connection has to be taken into consideration in addition to the measuring cell. Pay attention to the pressure/temperature dependency. The MWP may be applied at the device for an unlimited period of time. The MWP can be found on the nameplate.
- 3 The maximum sensor measuring range corresponds to the span between the LRL and URL. This sensor measuring range is equivalent to the maximum calibratable/adjustable span.
- 4 The calibrated/adjusted span corresponds to the span between the LRV and URV. Factory setting: 0 to URL. Other calibrated spans can be ordered as customized spans.

p Pressure
 LRL Lower range limit
 URL Upper range limit
 LRV Lower range value
 URV Upper range value
 TD Turn down. Example - see the following section.

Turn down calculation

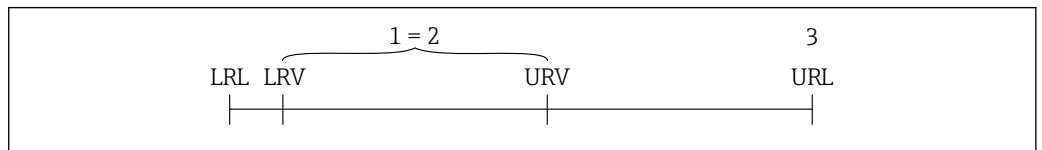

A0029545

- 1 Calibrated/adjusted span
- 2 Zero point-based span
- 3 Upper range limit (URL)

Example:

- Sensor: 16 bar (240 psi)
- Upper range limit (URL) = 16 bar (240 psi)
- Calibrated/adjusted span: 0 to 8 bar (0 to 120 psi)
- Lower range value (LRV) = 0 bar (0 psi)
- Upper range value (URV) = 8 bar (120 psi)


$$TD = \frac{URL}{|URV - LRV|}$$

In this example, the TD is 2:1. This span is based on the zero point.

Function and system design

Measuring principle

Measuring cell for differential pressure with metal process isolating diaphragm

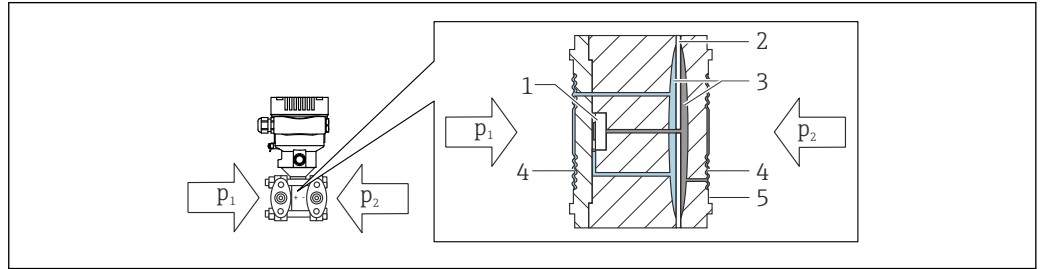

A0043083


- 1 Measuring element
- 2 Middle diaphragm
- 3 Fill fluid
- 4 Process isolating diaphragm
- 5 Seal
- p_1 Pressure 1
- p_2 Pressure 2

The process isolating diaphragms are deflected on both sides by the acting pressures. A fill fluid transfers the pressure to a side of the measuring element where a resistance bridge is located (semiconductor technology). The change in the bridge output voltage, which depends on the differential pressure, is measured and processed further.

Measuring system

Flow measurement

Flow measurement with Deltabar and differential pressure sensor:

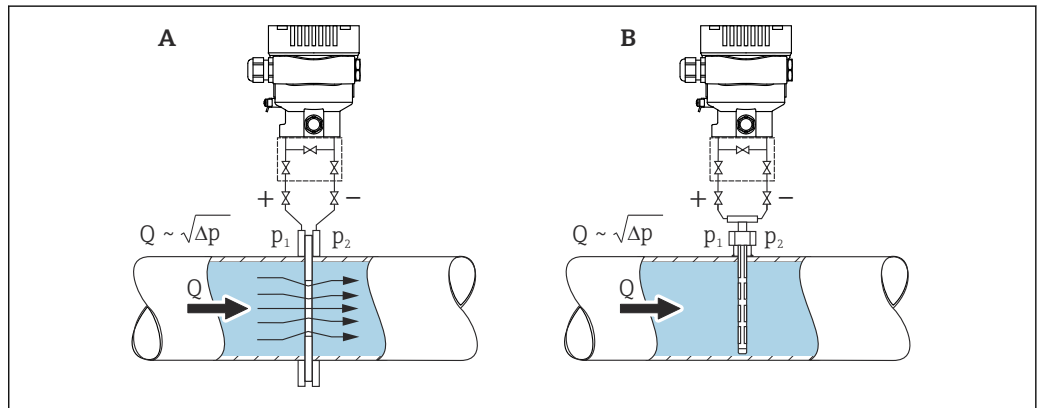

A0038340

- A Orifice plate
- B Pitot tube
- Q Flow
- Δp Differential pressure, $\Delta p = p_1 - p_2$

Advantages:

- A customized unit can be specified
- Measured value suppression can be set in the lower measuring range with the **Low flow cut off** parameter.

Communication and data processing

- 4 to 20 mA with HART communication protocol
- Bluetooth (optional)

Dependability for measuring devices with HART or Bluetooth

IT security

Endress+Hauser can only provide a warranty if the device is installed and used as described in the Operating Instructions. The device is equipped with security mechanisms to protect it against any

inadvertent changes to the device settings. IT security measures in line with operators' security standards and designed to provide additional protection for the device and device data transfer must be implemented by the operators themselves.

Device-specific IT security

The device offers specific functions to support protective measures by the operator. These functions can be configured by the user and guarantee greater in-operation safety if used correctly. An overview of the most important functions is provided in the following section:

- Write protection via hardware write protection switch
- Access code (applies for operation via display, Bluetooth or FieldCare, DeviceCare, ASM, PDM)

Input

Measured variable	Measured process variables <ul style="list-style-type: none"> ■ Differential pressure ■ Absolute pressure ■ Gauge pressure
Measuring range	Depending on the device configuration, the MWP and OPL can differ from the values indicated in the table. Standard: PN 160 / 16 MPa / 2400 psi

Sensor	Maximum sensor measuring range		Smallest calibratable span ¹⁾
	lower (LRL)	upper (URL)	
[mbar (psi)]	[mbar (psi)]	[mbar (psi)]	[mbar (psi)]
10 (0.15)	-10 (-0.15)	+10 (+0.15)	0.25 (0.00375)
30 (0.45)	-30 (-0.45)	+30 (+0.45)	0.3 (0.0045)
100 (1.5)	-100 (-1.5)	+100 (+1.5)	1 (0.015)
500 (7.5)	-500 (-7.5)	+500 (+7.5)	5 (0.075)
3000 (45)	-3000 (-45)	+3000 (+45)	30 (0.45)
16000 (240)	-16000 (-240)	+16000 (+240)	160 (2.4)
40000 (600)	-40000 (-600)	+40000 (+600)	400 (6)

1) Turn down > 100:1 on request

Sensor	MWP	OPL	
		on one side	on both sides
[mbar (psi)]	[bar (psi)]	[bar (psi)]	[bar (psi)]
10 (0.15)	100 (1500)	150 (2250)	150 (2250)
30 (0.45)	100 (1500)	150 (2250)	150 (2250)
100 (1.5)	160 (2400) ¹⁾	160 (2400)	240 (3600)
500 (7.5)	160 (2400) ¹⁾	160 (2400)	240 (3600)
3000 (45)	160 (2400) ¹⁾	160 (2400)	240 (3600)
16000 (240)	160 (2400) ¹⁾	160 (2400)	240 (3600)
40000 (600)	160 (2400) ^{1) 2)}	"+" side: 160 (2400) "-" side: 100 (1500)	240 (3600)

1) If CRN approval is selected, the following limited MWP values apply: with copper seals: 124 bar (1798.5 psi)

2) If pressure is applied on the negative side only, the MWP is 100 bar (1500 psi).

Standard: PN 250 / 25 MPa / 3626 psi

Sensor	Maximum sensor measuring range		Smallest calibratable span ¹⁾
	lower (LRL)	upper (URL)	
[mbar (psi)]	[mbar (psi)]	[mbar (psi)]	[mbar (psi)]
100 (1.5)	-100 (-1.5)	+100 (+1.5)	1 (0.015)
500 (7.5)	-500 (-7.5)	+500 (+7.5)	5 (0.075)
3000 (45)	-3000 (-45)	+3000 (+45)	30 (0.45)

Sensor	Maximum sensor measuring range		Smallest calibratable span ¹⁾
	lower (LRL)	upper (URL)	
[mbar (psi)]	[mbar (psi)]	[mbar (psi)]	[mbar (psi)]
16000 (240)	-16000 (-240)	+16000 (+240)	160 (2.4)
40000 (600)	-40000 (-600)	+40000 (+600)	400 (6)

1) Turn down > 100:1 on request

Sensor	MWP ¹⁾	OPL	
		on one side	on both sides
[mbar (psi)]	[bar (psi)]	[bar (psi)]	[bar (psi)]
100 (1.5)	250 (3626) ²⁾	250 (3626)	375 (5625)
500 (7.5)	250 (3626) ²⁾	250 (3626)	375 (5625)
3000 (45)	250 (3626) ²⁾	250 (3626)	375 (5625)
16000 (240)	250 (3626) ²⁾	250 (3626)	375 (5625)
40000 (600)	250 (3626) ^{2) 3)}	"+" side: 250 (3626) "-" side: 100 bar (1 500 psi)	375 (5625)

1) MWP only on both sides.

2) If CRN approval is selected, the following limited MWP values apply: with side venting: 179 bar (2 596.2 psi); with copper seals: 124 bar (1 798.5 psi)

3) If pressure is applied on the negative side only, the MWP is 100 bar (1 500 psi).

Option PN 320 / 32 MPa / 4641 psi

Sensor	Maximum sensor measuring range		Smallest calibratable span ¹⁾
	lower (LRL)	upper (URL)	
[mbar (psi)]	[mbar (psi)]	[mbar (psi)]	[mbar (psi)]
100 (1.5)	-100 (-1.5)	+100 (+1.5)	1 (0,015)
500 (7.5)	-500 (-7.5)	+500 (+7.5)	5 (0.075)
3000 (45)	-3000 (-45)	+3000 (+45)	30 (0.45)
16000 (240)	-16000 (-240)	+16000 (+240)	160 (2.4)
40000 (600)	-40000 (-600)	+40000 (+600)	400 (6)

1) Turn down > 100:1 on request

Sensor	MWP ¹⁾	OPL	
		on one side	on both sides
[mbar (psi)]	[bar (psi)]	[bar (psi)]	[bar (psi)]
100 (1.5)	320 (4641) ²⁾	320 (4641)	480 (7200)
500 (7.5)	320 (4641) ²⁾	320 (4641)	480 (7200)
3000 (45)	320 (4641) ²⁾	320 (4641)	480 (7200)
16000 (240)	320 (4641) ²⁾	320 (4641)	480 (7200)
40000 (600)	320 (4641) ^{2) 3)}	"+" side: 320 (4641) "-" side: 100 (1500)	480 (7200)

1) MWP only on both sides.

2) If CRN approval is selected, the following limited MWP values apply: without side vent valves: 262 bar (3800 psi); with side vent: 179 bar (2596.2 psi); with copper seals: 124 bar (1798.5 psi)

3) If pressure is applied on the negative side only, the MWP is 100 bar (1500 psi).

Option PN 420 / 42 MPa / 6092 psi

Sensor	Maximum sensor measuring range		Smallest calibratable span ¹⁾
	lower (LRL)	upper (URL)	
[mbar (psi)]	[mbar (psi)]	[mbar (psi)]	[mbar (psi)]
100 (1.5)	-100 (-1.5)	+100 (+1.5)	1 (0.015)
500 (7.5)	-500 (-7.5)	+500 (+7.5)	5 (0.075)
3000 (45)	-3000 (-45)	+3000 (+45)	30 (0.45)
16000 (240)	-16000 (-240)	+16000 (+240)	160 (2.4)
40000 (600)	-40000 (-600)	+40000 (+600)	400 (6)

1) Turn down > 100:1 on request

Sensor	MWP ¹⁾	OPL	
		on one side	on both sides
[mbar (psi)]	[bar (psi)]	[bar (psi)]	[bar (psi)]
100 (1.5)	420 (6092) ²⁾	420 (6092)	630 (9450)
500 (7.5)	420 (6092) ²⁾	420 (6092)	630 (9450)
3000 (45)	420 (6092) ²⁾	420 (6092)	630 (9450)
16000 (240)	420 (6092) ²⁾	420 (6092)	630 (9450)
40000 (600)	420 (6092) ^{2) 3)}	"+" side: 420 (6092) "- " side: 100 (1500)	630 (9450)

1) MWP only on both sides.

2) If CRN approval is selected, the following limited MWP values apply: without side vent valves: 262 bar (3 800 psi); with side vent: 179 bar (2 596.2 psi); with copper seals: 124 bar (1 798.5 psi)

3) If pressure is applied on the negative side only, the MWP is 100 bar (1 500 psi).

PMD75B: optionally available as a gauge or absolute pressure sensor

Sensor	Maximum sensor measuring range		Smallest calibratable span
	lower (LRL)	upper (URL)	
bar (psi)	bar (psi)	bar (psi)	bar (psi)
160 (2400) gauge	-1 (-15)	160 (2400)	40 (600)
160 (2400) abs	0	160 (2400)	4 (60)
250 (3750) gauge ¹⁾	-1 (-15)	250 (3750)	40 (600)
250 (3750) abs ¹⁾	0	250 (3750)	4 (60)

1) The 250 bar sensor can be used over the entire measuring range with up to 100,000 load changes without specification restrictions.

Sensor	MWP	OPL	
		on one side	on both sides
bar (psi)	bar (psi)	bar (psi)	
160 (2400) gauge	160 (2400) ¹⁾	240 (3600)	- ²⁾
160 (2400) abs	160 (2400) ¹⁾	240 (3600)	- ²⁾
250 (3750) gauge ³⁾	250 (3750) ¹⁾	375 (5625)	- ²⁾
250 (3750) abs ³⁾	250 (3750) ¹⁾	375 (5625)	- ²⁾

1) If CRN approval is selected, the following limited MWP values apply: without side vent valves: 262 bar (3800 psi); with side vent: 179 bar (2596.2 psi); with copper seals: 124 bar (1798.5 psi)

2) Available only with blind flange on LP side.

3) The 250 bar sensor can be used over the entire measuring range with up to 100,000 load changes without specification restrictions.

Minimum system pressure

- Minimum system pressure at reference operating conditions for silicone oil:

25 mbar (0.0375 psi)_{abs}

- Minimum system pressure at 85 °C (185 °F) for silicone oil: up to 250 mbar (4 psi)_{abs}

Optionally available as a gauge or absolute pressure sensor (all measuring cells)

- Minimum system pressure at reference operating conditions for silicone oil: 10 mbar (0.15 psi)_{abs}

- Minimum system pressure at 85 °C (185 °F) for silicone oil: up to 10 mbar (0.15 psi)_{abs}

Output

Output signal

Current output

4 to 20 mA with superimposed digital communication protocol HART, 2-wire

The current output offers a choice of three different operating modes:

- 4.0 to 20.5 mA
- NAMUR NE 43: 3.8 to 20.5 mA (factory setting)
- US mode: 3.9 to 20.8 mA

Signal on alarm

Signal on alarm in accordance with NAMUR recommendation NE 43.


4 to 20 mA HART:

Options:

- Max alarm: can be set from 21.5 to 23 mA
- Min. alarm: < 3.6 mA (factory setting)

Load

4 to 20 mA HART

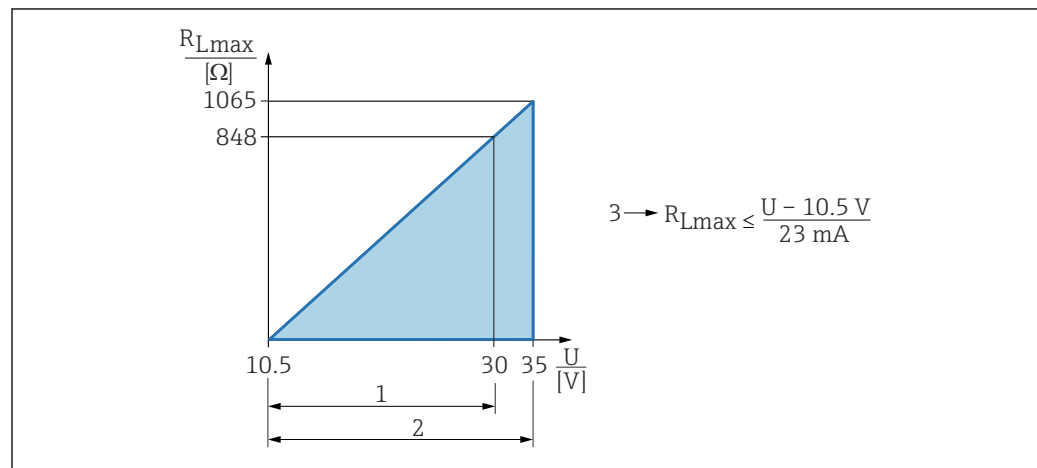

1 Power supply 10.5 to 30 VDC Ex i

2 Power supply 10.5 to 35 VDC, for other types of protection and for non-certified device versions

3 R_{Lmax} maximum load resistance

U Supply voltage

i Operation via handheld terminal or PC with operating program: take minimum communication resistance of 250 Ω into consideration.

Damping

A damping affects all outputs (output signal, display). Damping can be enabled as follows:

- Via the onsite display, Bluetooth, handheld terminal or PC with operating program, continuous from 0 to 999 seconds
- Factory setting: 1 s

Ex connection data

See the separate technical documentation (Safety Instructions (XA)) on www.endress.com/download.

Linearization

The device's linearization function allows the user to convert the measured value to any units of height or volume. User-defined linearization tables of up to 32 value pairs can be entered if necessary.

Flow measurement with Deltabar and differential pressure sensor

Low flow cut off parameter: When the **Low flow cut off** parameter is activated, small flows which can lead to large fluctuations in the measured value are suppressed.

The **Low flow cut off** parameter is set to 5% by default when the **Output current transfer function** parameter is set to **Square root** option.

Protocol-specific data

HART

- Manufacturer ID: 17 (0x11{hex})
- Device type ID: 0x1131
- Device revision: 1
- HART specification: 7
- DD revision: 1
- Device description files (DTM, DD) information and files at:
 - www.endress.com
 - www.fieldcommgroup.org
- HART load: min. 250 Ohm

HART device variables (preset at the factory)

The following measured values are assigned to the device variables at the factory:

Device variable	Measured value
Primary variable (PV) ¹⁾	Pressure ²⁾
Secondary variable (SV)	Sensor temperature
Tertiary variable (TV)	Electronic temperature
Quaternary variable (QV)	Sensor pressure ³⁾

- 1) The PV is always applied to the current output.
- 2) The pressure is the calculated signal after damping and position adjustment.
- 3) The sensor pressure is the raw sensor signal before damping and position adjustment.

Choice of HART device variables

- **Pressure** option (after position correction and damping)
- Scaled variable
- Sensor temperature
- **Sensor pressure** option Sensor Pressure is the raw signal from sensor before damping and position adjustment.
- Electronics temperature
- **Terminal current** option The terminal current is the read-back current on terminal block. Visibility depends on order options or device settings
- **Terminal voltage 1** option Visibility depends on order options or device settings
- **Noise of pressure signal** option and **Median of pressure signal** option Visibility depends on order options or device settings
- Percent of range
- **Loop current** option The loop current is the output current set by the applied pressure.

Supported functions

- Burst mode
- Additional transmitter status
- Device locking


Wireless HART data

- Minimum starting voltage: 10.5 V
- Start-up current: >3.6 mA
- Starting time: <5 s
- Minimum operating voltage: 10.5 V
- Multidrop current: 4 mA

Power supply

Terminal assignment

Single compartment housing

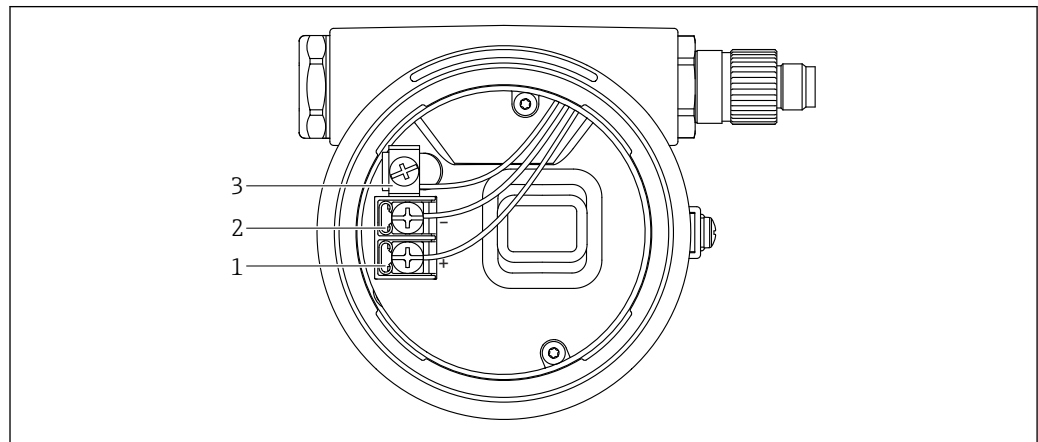


A0042594

1 Connection terminals and ground terminal in the connection compartment

- 1 Positive terminal
- 2 Negative terminal
- 3 Internal ground terminal

Dual compartment housing

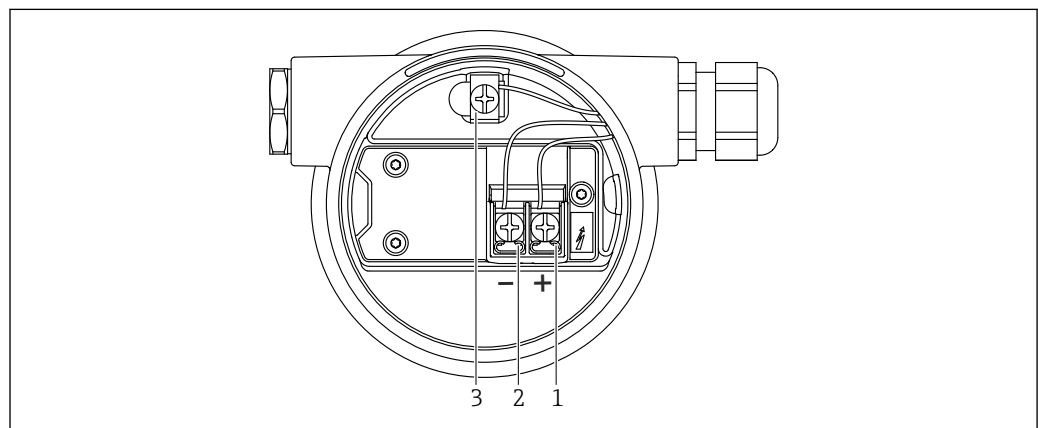

A0042805

2 Connection terminals and ground terminal in the connection compartment

- 1 Positive terminal
- 2 Negative terminal
- 3 Internal ground terminal


Available device plugs



In the case of devices with a plug, the housing does not have to be opened to establish the connection.

Use the enclosed seals to prevent the penetration of moisture into the device.

Measuring devices with M12 plug

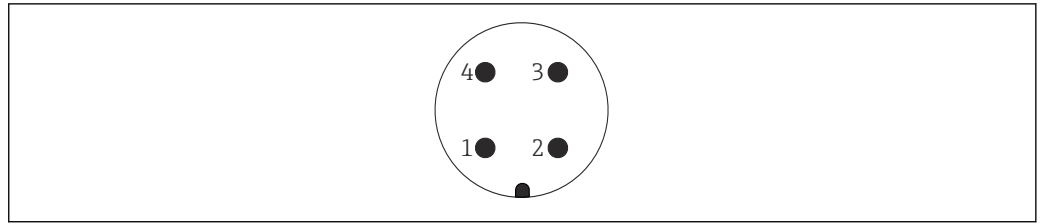

A0011175

- 1 Signal +
- 2 Not assigned
- 3 Signal -
- 4 Ground

Endress+Hauser offers the following accessories for devices with an M12 plug:

Plug-in jack M 12x1, straight

- Material:
 - Body: PBT; union nut: nickel-plated die-cast zinc; seal: NBR
- Degree of protection (fully locked): IP67
- Order number: 52006263


Plug-in jack M 12x1, elbowed

- Material:
 - Body: PBT; union nut: nickel-plated die-cast zinc; seal: NBR
- Degree of protection (fully locked): IP67
- Order number: 71114212

Cable 4x0.34 mm² (20 AWG) with M12 plug-in jack, elbowed, screw plug, length 5 m (16 ft)

- Material: body: TPU; union nut: nickel-plated die-cast zinc; cable: PVC
- Degree of protection (fully locked): IP67/68
- Order number: 52010285
- Cable colors
 - 1 = BN = brown
 - 2 = WT = white
 - 3 = BU = blue
 - 4 = BK = black

Measuring devices with Harting plug Han7D

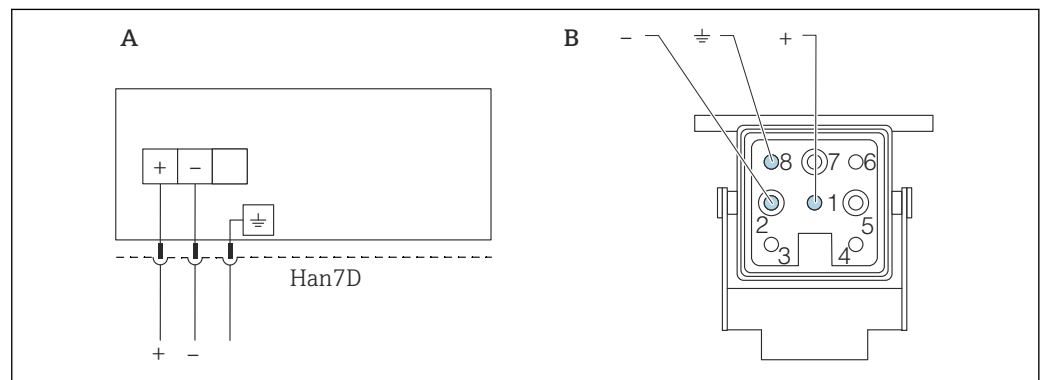

A0041011

A Electrical connection for devices with Harting plug Han7D
 B View of the plug-in connection on the device

Material: CuZn, contacts for plug-in jack and connector are gold-plated


Supply voltage

- Ex d, Ex e, non-Ex: supply voltage: 10.5 to 35 VDC
- Ex i: supply voltage: 10.5 to 30 VDC
- Nominal current: 4 to 20 mA HART

The power unit must be tested to ensure it meets safety requirements (e.g. PELV, SELV, Class 2).

A suitable circuit breaker should be provided for the device in accordance with IEC/EN 61010.

Potential equalization

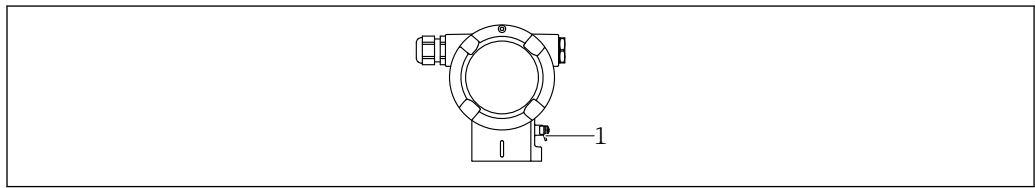

A0045412


1 Ground terminal for connecting the potential matching line

- i** If necessary, the potential matching line can be connected to the outer ground terminal of the transmitter before the device is connected.
- i** For optimum electromagnetic compatibility:
 - Keep the potential matching line as short as possible
 - Maintain a cross-section of at least 2.5 mm² (14 AWG)

Terminals

- Supply voltage and internal ground terminal: 0.5 to 2.5 mm² (20 to 14 AWG)
- External ground terminal: 0.5 to 4 mm² (20 to 12 AWG)

Cable entries

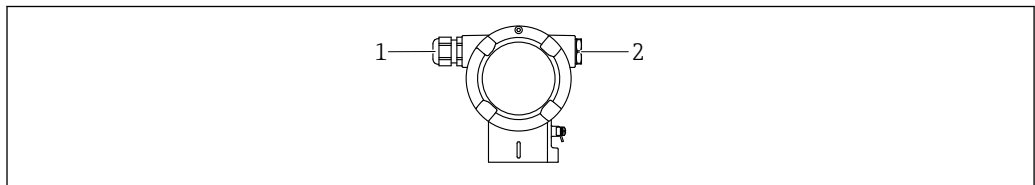

A0045414

1 Cable entry
2 Dummy plug

A0045413

The type of cable entry depends on the device version ordered.

- i** Always route connecting cables downwards so that moisture cannot penetrate the connection compartment.

If necessary, create a drip loop or use a weather protection cover.

Cable specification

- The cable outer diameter depends on the cable entry used
- Cable outer diameter
 - Plastic: Ø5 to 10 mm (0.2 to 0.38 in)
 - Nickel-plated brass: Ø7 to 10.5 mm (0.28 to 0.41 in)
 - Stainless steel: Ø7 to 12 mm (0.28 to 0.47 in)

Overvoltage protection

Devices without optional overvoltage protection

Equipment from Endress+Hauser fulfills the requirements of the product standard IEC / DIN EN 61326-1 (Table 2 Industrial Environment).

Depending on the type of port (DC power supply, input/output port) different testing levels according to IEC / DIN EN 61326-1 against transient overvoltages (Surge) are applied (IEC / DIN EN 61000-4-5 Surge):

Test level on DC power ports and input / output ports is 1000 V line to earth

Devices with optional overvoltage protection

- Spark-over voltage: min. 400 V DC
- Tested according to IEC / DIN EN 60079-14 sub chapter 12.3 (IEC / DIN EN 60060-1 chapter 7)
- Nominal discharge current: 10 kA

Overvoltage category

Overvoltage category II

Performance characteristics

Response time	<ul style="list-style-type: none"> ▪ Acyclic: min. 330 ms, typically 590 ms (depends on commands and number of preambles) ▪ Cyclic (burst): min. 160 ms, typically 350 ms (depends on commands and number of preambles)
Reference operating conditions	<ul style="list-style-type: none"> ▪ As per IEC 62828-2 ▪ Ambient temperature T_A = constant, in the range +21 to +33 °C (+70 to +91 °F) ▪ Humidity φ = constant, in the range: 5 to 80 % RH \pm 5 % ▪ Ambient pressure p_U = constant, in the range: 860 to 1 060 mbar (12.47 to 15.37 psi) ▪ Position of the measuring cell: horizontal \pm1° ▪ Input of LOW SENSOR TRIM and HIGH SENSOR TRIM for lower range value and upper range value ▪ Membrane material: AISI 316L (1.4435), Alloy C276, Monel ▪ Supply voltage: 24 V DC \pm3 V DC ▪ Load with HART: 250 Ω ▪ Turn down (TD) = URL/ URV - LRV ▪ Zero based span
Maximum measured error (total performance)	<p>The performance characteristics refer to the accuracy of the measuring device. The factors influencing accuracy can be divided into two groups</p> <ul style="list-style-type: none"> ▪ Total performance of measuring device ▪ Installation factors <p>All performance characteristics are in conformance with $\geq \pm 3$ sigma.</p> <p>The total performance of the measuring device comprises the reference accuracy and the ambient temperature effect and is calculated using the following formula:</p> $\text{Total performance} = \pm \sqrt{(E1)^2 + (E2)^2 + (E3)^2}$ <p>E1 = Reference accuracy E2 = Ambient temperature effect E3 = Static pressure effect</p> <p>Calculation of E2:</p> <p>Ambient temperature effect per ± 28 °C (50 °F) (corresponds to the range from -3 to +53 °C (+27 to +127 °F))</p> $E2 = E2_M + E2_E$ <p>$E2_M$ = Main temperature error $E2_E$ = Electronics error</p> <ul style="list-style-type: none"> ▪ The values apply for process isolating diaphragms made of 316L (1.4435) ▪ The values refer to the calibrated span.

Calculation of the total performance with the Endress+Hauser Applicator

Detailed measured errors, such as for other temperature ranges, for example, can be calculated with the Applicator "[Sizing Pressure Performance](#)".



A0038927

Reference accuracy [E1]

The reference accuracy comprises the non-linearity according to the limit point method, pressure hysteresis and non-repeatability in accordance with [IEC62828-1 / IEC 61298-2]. Reference accuracy for standard up to TD 100:1, for platinum up to TD 5:1.

10 mbar (0.15 psi) sensor

- Standard: TD 1:1 = $\pm 0.075\%$; TD > 1:1 = $\pm 0.075\% \cdot \text{TD}$
- Platinum: TD 1:1 = $\pm 0.05\%$; TD > 1:1 to TD 5:1 = $\pm 0.075\% \cdot \text{TD}$

30 mbar (0.45 psi) sensor

- Standard: TD $\leq 3:1$ = $\pm 0.075\%$; TD > 3:1 = $\pm 0.025\% \cdot \text{TD}$
- Platinum: TD 1:1 = $\pm 0.05\%$; TD > 1:1 to TD $\leq 3:1$ = $\pm 0.075\%$; TD > 3:1 to TD 5:1 = $\pm 0.025\% \cdot \text{TD}$

100 mbar (1.5 psi) sensor

- Standard: TD $\leq 5:1$ = $\pm 0.05\%$; TD > 5:1 = $\pm (0.009\% \cdot \text{TD} + 0.005\%)$
- Platinum: TD $\geq 1:1$ to 5:1 = $\pm 0.04\%$

500 mbar (7.5 psi), 3 bar (45 psi), 16 bar (240 psi), 40 bar (600 psi) sensor

- Standard: TD $\leq 15:1$ = $\pm 0.05\%$; TD > 15:1 = $\pm 0.0015\% \cdot \text{TD} + 0.0275\%$
- Platinum: TD $\geq 1:1$ to 5:1 = $\pm 0.035\%$

160 bar (2 400 psi) and 250 bar (3 750 psi) gauge pressure sensor and absolute pressure sensor

- Standard: TD $\leq 5:1$ = $\pm 0.10\%$; TD > 5:1 = $\pm 0.02\% \cdot \text{TD}$
- Platinum: not available

Temperature effect [E2]*E2_M - Main temperature error*

The output changes due to the effect of the ambient temperature [IEC 62828-1 / IEC 61298-3] with respect to the reference temperature [IEC 62828-1 / DIN 16086]. The values specify the maximum error due to min./max. ambient or process temperature conditions.

10 mbar (0.15 psi) and 30 mbar (0.45 psi) sensor

- Standard: $\pm(0.14 \% \cdot TD + 0.04 \%)$
- Platinum: $\pm(0.14 \% \cdot TD + 0.04 \%)$

100 mbar (1.5 psi) sensor

- Standard: $\pm(0.07 \% \cdot TD + 0.07 \%)$
- Platinum: $\pm(0.07 \% \cdot TD + 0.07 \%)$

500 mbar (7.5 psi) sensor

- Standard: $\pm(0.03 \% \cdot TD + 0.017 \%)$
- Platinum: $\pm(0.03 \% \cdot TD + 0.017 \%)$

3 bar (45 psi), 16 bar (240 psi) and 40 bar (600 psi) sensor

- Standard: $\pm(0.012 \% \cdot TD + 0.017 \%)$
- Platinum: $\pm(0.012 \% \cdot TD + 0.017 \%)$

160 bar (2 400 psi) gauge pressure sensor and absolute pressure sensor

- Standard: $\pm(0.042 \% \cdot TD + 0.04 \%)$
- Platinum: $\pm(0.042 \% \cdot TD + 0.04 \%)$

250 bar (3 750 psi) gauge pressure sensor and absolute pressure sensor

- Standard: $\pm(0.022 \% \cdot TD + 0.04 \%)$
- Platinum: $\pm(0.022 \% \cdot TD + 0.04 \%)$

E2_E - Electronics error

- 4 to 20 mA: 0.05 %
- Digital output (HART): 0 %

E3_M - Main static pressure error

The static pressure effect refers to the effect on the output due to changes in the static pressure of the process (difference between the output at each static pressure and the output at atmospheric pressure [IEC 62828-2 / IEC 61298-3] and therefore the combination of the influence of the operating pressure on the zero point and the span).

10 mbar (0.15 psi) sensor

- Standard
 - Influence on the zero point: $\pm 0.15 \cdot TD \% \text{ per } 7 \text{ bar (105 psi)}$
 - Influence on the span: $\pm 0.035 \% \text{ per } 7 \text{ bar (105 psi)}$
- Platinum
 - Influence on the zero point: $\pm 0.07 \% \cdot TD \text{ per } 7 \text{ bar (105 psi)}$
 - Influence on the span: $\pm 0.035 \% \text{ per } 7 \text{ bar (105 psi)}$

30 mbar (0.45 psi) sensor

- Standard
 - Influence on the zero point: $\pm 0.70 \% \cdot TD \text{ per } 70 \text{ bar (1 050 psi)}$
 - Influence on the span: $\pm 0.14 \% \text{ per } 70 \text{ bar (1 050 psi)}$
- Platinum
 - Influence on the zero point: $\pm 0.25 \% \cdot TD \text{ per } 70 \text{ bar (1 050 psi)}$
 - Influence on the span: $\pm 0.14 \% \text{ per } 70 \text{ bar (1 050 psi)}$

100 mbar (1.5 psi) sensor

- Standard
 - Influence on the zero point: $\pm 0.203 \% \cdot TD \text{ per } 70 \text{ bar (1 050 psi)}$
 - Influence on the span: $\pm 0.15 \% \text{ per } 70 \text{ bar (1 050 psi)}$
- Platinum
 - Influence on the zero point: $\pm 0.077 \% \cdot TD \text{ per } 70 \text{ bar (1 050 psi)}$
 - Influence on the span: $\pm 0.15 \% \text{ per } 70 \text{ bar (1 050 psi)}$

500 mbar (7.5 psi) sensor

- Standard
 - Influence on the zero point: $\pm 0.07\% \cdot \text{TD}$ per 70 bar (1050 psi)
 - Influence on the span: $\pm 0.10\%$ per 70 bar (1050 psi)
- Platinum
 - Influence on the zero point: $\pm 0.028\% \cdot \text{TD}$ per 70 bar (1050 psi)
 - Influence on the span: $\pm 0.10\%$ per 70 bar (1050 psi)

3 bar (45 psi) sensor

- Standard
 - Influence on the zero point: $\pm 0.049\% \cdot \text{TD}$ per 70 bar (1050 psi)
 - Influence on the span: $\pm 0.05\%$ per 70 bar (1050 psi)
- Platinum
 - Influence on the zero point: $\pm 0.021\% \cdot \text{TD}$ per 70 bar (1050 psi)
 - Influence on the span: $\pm 0.05\%$ per 70 bar (1050 psi)

16 bar (240 psi) and 40 bar (600 psi) sensor

- Standard
 - Influence on the zero point: $\pm 0.049\% \cdot \text{TD}$ per 70 bar (1050 psi)
 - Influence on the span: $\pm 0.02\%$ per 70 bar (1050 psi)
- Platinum
 - Influence on the zero point: $\pm 0.021\% \cdot \text{TD}$ per 70 bar (1050 psi)
 - Influence on the span: $\pm 0.02\%$ per 70 bar (1050 psi)

Resolution

Current output: $< 1 \mu\text{A}$

Total error

The total error of the measuring device comprises the total performance and the influence of long-term stability and is calculated using the following formula:

Total error = total performance + long-term stability

Calculation of the total error with the Endress+Hauser Applicator

Detailed measured errors, such as for other temperature ranges, for example, can be calculated with the Applicator "[Sizing Pressure Performance](#)".



A0038927

Long-term stability

10 mbar (0.15 psi) and 30 mbar (0.45 psi) sensor

- 1 year: $\pm 0.20\%$
- 5 years: $\pm 0.28\%$
- 10 years: $\pm 0.31\%$

100 mbar (1.5 psi) sensor

- 1 year: $\pm 0.08\%$
- 5 years: $\pm 0.12\%$
- 10 years: $\pm 0.20\%$

500 mbar (7.5 psi), 3 bar (45 psi), 16 bar (240 psi) and 40 bar (600 psi) sensor


- 1 year: $\pm 0.025\%$
- 5 years: $\pm 0.05\%$
- 10 years: $\pm 0.1\%$

160 bar (2400 psi) and 250 bar (3750 psi) gauge pressure sensor and absolute pressure sensor

- 1 year: $\pm 0.05\%$
- 5 years: $\pm 0.07\%$
- 10 years: $\pm 0.10\%$

Response time T63 and T90**Dead time, time constant**

Presentation of the dead time and the time constant as per DIN 16086:

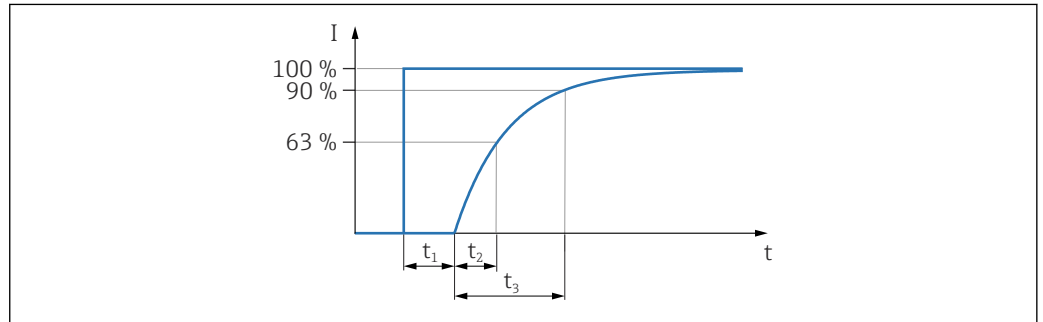

A0019786

Dynamic behavior, current output (HART electronics)

10 mbar (0.15 psi) and 30 mbar (0.45 psi) sensor:

- Dead time (t_1): maximum 50 ms
- Time constant T63 (t_2): maximum 450 ms
- Time constant T90 (t_3): maximum 1100 ms

All other sensors:

- Dead time (t_1): maximum 50 ms
- Time constant T63 (t_2): maximum 85 ms
- Time constant T90 (t_3): maximum 200 ms

Dynamic behavior, digital output (HART electronics)

A typical burst rate of 300 ms results in the following behavior:

10 mbar (0.15 psi) and 30 mbar (0.45 psi) sensor:

- Dead time (t_1):
 - Minimum 205 ms
 - Maximum 1005 ms
- Time constant T63 (t_2):
 - Minimum 655 ms
 - Maximum 1455 ms
- Time constant T90 (t_3):
 - Minimum 1200 ms
 - Maximum 2000 ms

All other sensors:

- Dead time (t_1):
 - Minimum 205 ms
 - Maximum 1005 ms
- Time constant T63 (t_2):
 - Minimum 265 ms
 - Maximum 1065 ms
- Time constant T90 (t_3):
 - Minimum 298 ms
 - Maximum 1098 ms

Reading cycle

- Acyclic: max. 3/s, typical 1/s (depends on command # and number of preambles)
- Cyclic (burst): max. 3/s, typical 2/s

The device commands the BURST MODE function for cyclic value transmission via the HART communication protocol.

Cycle time (update time)

Cyclic (burst): min. 300 ms


Warm-up period

≤5 s

Installation

Orientation

The installation depends on how the impulse lines are connected.

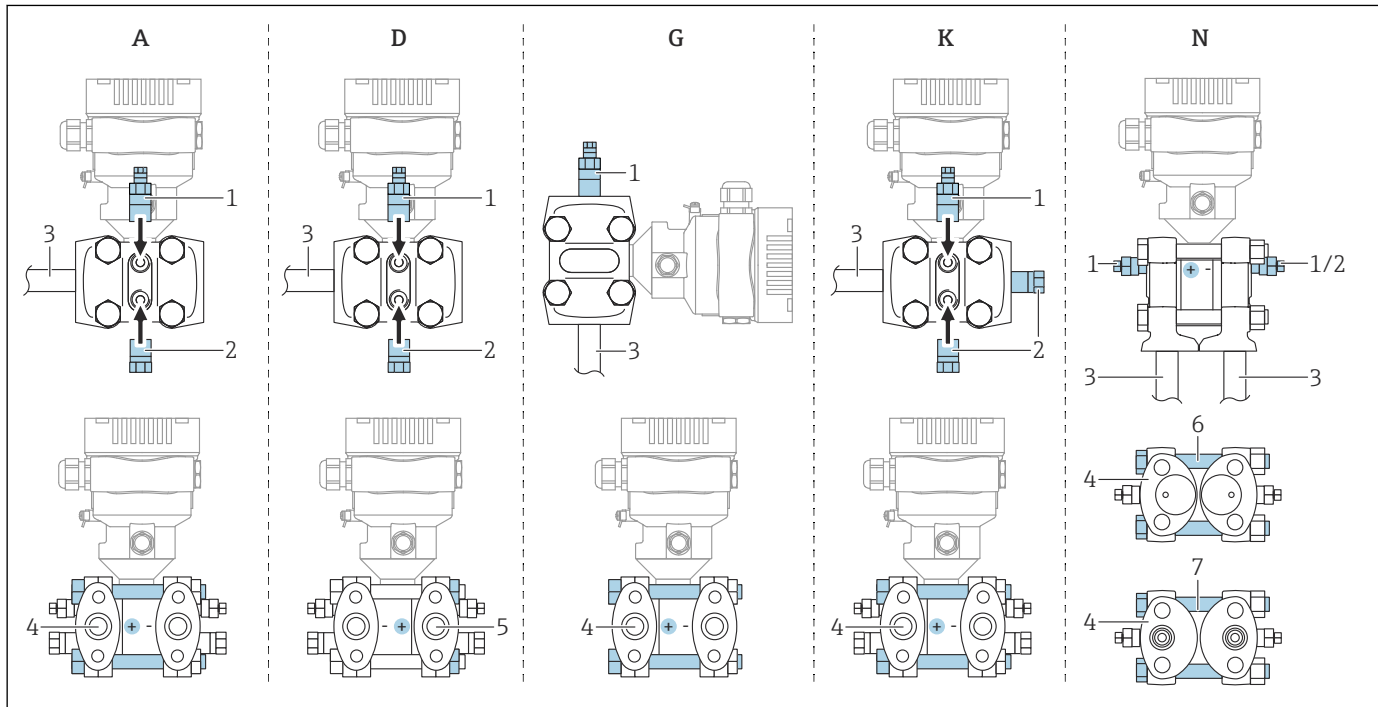

A0038688

3 A, D, G, K, N: order options

- A Horizontal impulse line, left side HP (screw head side), with side vent. Thread on one side and side thread for horizontal impulse line.
- D Horizontal impulse line, right side HP (nut side), with side vent. Thread on one side and side thread for horizontal impulse line.
- G Vertical impulse line, left or right side HP (screw head side), with vent. Thread on each side for vertical impulse line.
- K Universal side flange, left or right side HP (screw head side), with vent. Thread on each side and side thread for universal mounting.
- N Bottom process connection, left side HP (screw head side), vent. Thread on each side and side thread for mounting on existing manifolds.
- 1 Vent valve
- 2 Sealing plug
- 3 Impulse line
- 4 High-pressure (HP) side (screw head side)
- 5 High-pressure (HP) side (nut side)
- 6 Coplanar compatible, view from below
- 7 IEC upright, view from below

Sensor selection and arrangement

Flow measurement

Flow measurement in gases

Mount the measuring device above the measuring point so that condensate can flow into the process piping.

Flow measurement in vapors

- Mount the measuring device below the measuring point
- Mount the condensate traps at the same level as the tapping points and at the same distance to the measuring device
- Prior to commissioning, fill the impulse lines to the height of the condensate traps

Flow measurement in liquids

- Mount the measuring device below the measuring point so that the pulse lines are always filled with liquid and gas bubbles can run back into the process piping
- When measuring in media with solid parts, such as dirty liquids, installing separators and drain valves is useful for capturing and removing sediment

Level measurement

Level measurement in open vessels

- Mount the measuring device below the lower measuring connection so that the impulse lines are always filled with liquid
- The low-pressure side is open to atmospheric pressure
- When measuring in media with solid parts, such as dirty liquids, installing separators and drain valves is useful for capturing and removing sediment

Level measurement in a closed vessel

- Mount the measuring device below the lower measuring connection so that the impulse lines are always filled with liquid
- Always connect the low-pressure side above the maximum level
- When measuring in media with solid parts, such as dirty liquids, installing separators and drain valves is useful for capturing and removing sediment

Level measurement in a closed vessel with superimposed vapor

- Mount the measuring device below the lower measuring connection so that the impulse lines are always filled with liquid
- Always connect the low-pressure side above the maximum level
- The condensate trap ensures constant pressure on the low-pressure side
- When measuring in media with solid parts, such as dirty liquids, installing separators and drain valves is useful for capturing and removing sediment

Pressure measurement

Pressure measurement with 160 bar (2 400 psi) and 250 bar (3 750 psi) measuring cell

Mount the measuring device above the measuring point so that the condensate can flow into the process piping

Differential pressure measurement

Differential pressure measurement in gases and vapors


Mount the measuring device above the measuring point so that condensate can flow into the process piping.

Differential pressure measurement in liquids

Mount the measuring device below the measuring point so that the pulse lines are always filled with liquid and gas bubbles can run back into the process piping

Mounting bracket for measuring device or separate housing

The measuring device or separate housing can be mounted on walls or pipes (for pipes with a diameter ranging from 1 ¼" to 2") with the mounting bracket.

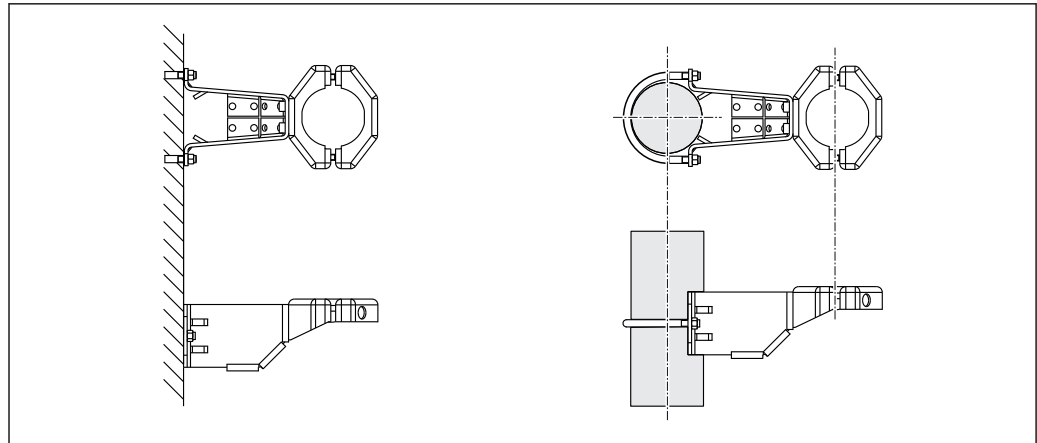

A0032492


Ordering information:

- Can be ordered via the Product Configurator
- Can be ordered as a separate accessory, part number 71102216

i If the measuring device is ordered with a separate housing, the mounting bracket is included in the delivery.

Wall and pipe mounting

Endress+Hauser offers the following mounting bracket for installing the device on pipes or walls:

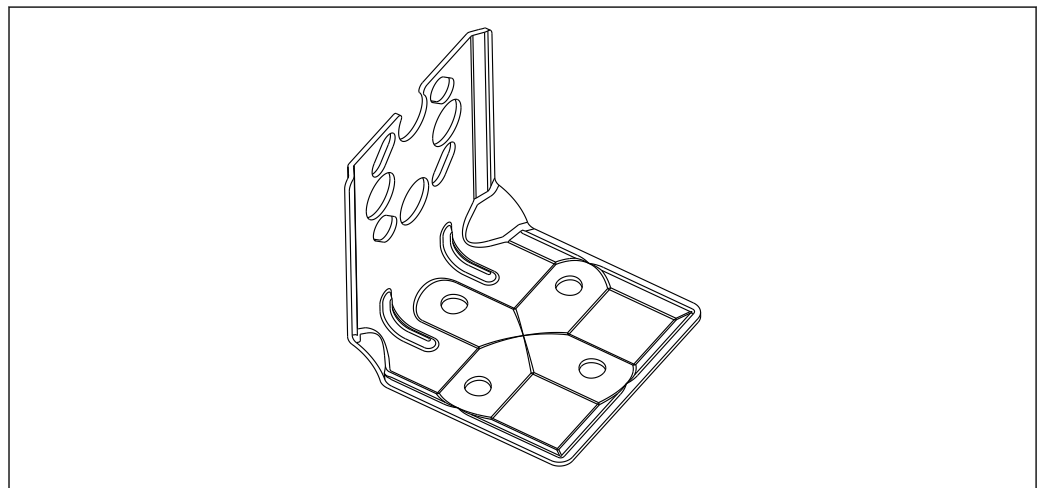

A0031326

- If a valve manifold is used, its dimensions should also be taken into consideration
- Bracket for wall and pipe mounting including retaining bracket for pipe mounting and two nuts
- The material of the screws used to secure the device depends on the order code

b For technical data (e.g. materials, dimensions or order numbers), see the accessory document SD01553P.

Special mounting instructions

Wall and pipe mounting with a manifold (optional)

If the measuring device is mounted on a shutoff device (e.g. manifold or shutoff valve), then use the holder provided for this purpose. This makes it easier to disassemble the measuring device.

For technical data, see the SD01553P accessory document.

Sensor, remote (separate housing)

The measuring device housing (including the electronic insert) is mounted at a distance from the measuring point.


This version therefore facilitates trouble-free measurement

- Under particularly difficult measuring conditions (at installation locations that are cramped or difficult to access)
- If the measuring point is exposed to vibrations

Cable versions:

- PE: 2 m (6.6 ft), 5 m (16 ft) and 10 m (33 ft)
- FEP: 5 m (16 ft).

The sensor is delivered with the process connection and cable already mounted. The housing (including the electronic insert) and a mounting bracket are enclosed as separate units. The cable is provided with a socket at both ends. These sockets are simply connected to the housing (including the electronic insert) and the sensor.

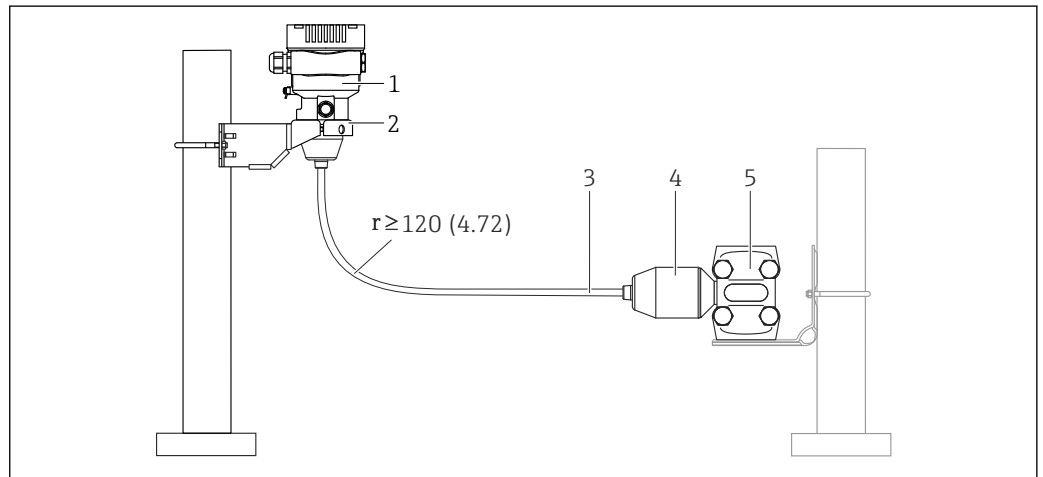

- 1 Sensor, remote (including electronic insert)
- 2 Mounting bracket enclosed, suitable for wall or pipe mounting
- 3 Cable, both ends are fitted with a socket
- 4 Process connection adapter
- 5 Process connection with sensor

Ordering information:

- Remote sensor (including electronic insert) including the mounting bracket can be ordered via the Product Configurator
- The mounting bracket can also be ordered as a separate accessory, part number 71102216

Technical data for cables:

- Minimum bending radius: 120 mm (4.72 in)
- Cable extraction force: max. 450 N (101.16 lbf)
- Resistance to UV light

Use in hazardous area:

- Intrinsically safe installations (Ex ia/IS)
- FM/CSA IS for Div. 1 installation only

Reduction of installation height


If this version is used, the installation height of the process connection is reduced compared to the dimensions of the standard version.

Environment

Ambient temperature range	<p>The following values apply up to a process temperature of +85 °C (+185 °F). At higher process temperatures, the permitted ambient temperature is reduced.</p> <ul style="list-style-type: none"> ■ Without LCD display: <ul style="list-style-type: none"> ■ Standard: -40 to +85 °C (-40 to +185 °F) ■ Optionally available: -50 to +85 °C (-58 to +185 °F) with restricted operating life and performance ■ Optionally available: -54 to +85 °C (-65 to +185 °F); under -50 °C (-58 °F): Ex d measuring devices can be permanently damaged ■ With LCD display: -40 to +85 °C (-40 to +185 °F) with limitations in optical properties such as display speed and contrast. Can be used without limitations up to -20 to +60 °C (-4 to +140 °F) ■ Separate housing: -20 to +60 °C (-4 to +140 °F) <p>Devices with inert oil: minimum process and ambient temperature -20 °C (-4 °F)</p>
----------------------------------	--

Ambient temperature T_a depending on the process temperature T_p

The process connection must be fully insulated for ambient temperatures below -40 °C (-40 °F).

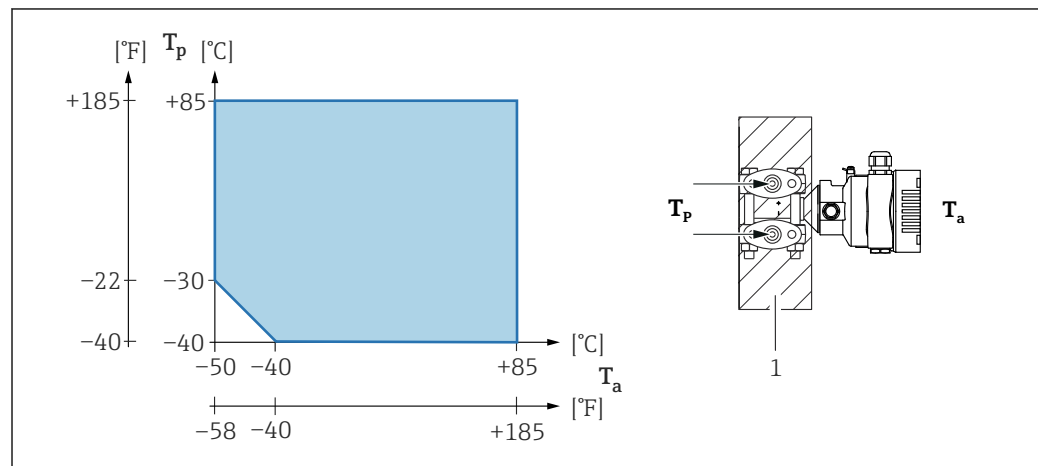

1 Insulation material

Hazardous area

- For measuring devices for use in hazardous areas, see Safety Instructions, Installation or Control Drawing
- Measuring devices with common explosion protection certificates (e.g. ATEX-/ IEC Ex, etc.) can be used in hazardous areas with ambient temperatures from -54 to +85 °C (-65 to +185 °F) (optionally available). The functionality of the explosion protection Ex ia is guaranteed for ambient temperatures to -50 °C (-58 °F) (optionally available).
At temperatures ≤ -50 °C (-58 °F), explosion protection is guaranteed by the housing in the case of flameproof enclosure (Ex d) type of protection. The functionality of the transmitter cannot be fully guaranteed. The Ex ia capability can no longer be guaranteed.

Storage temperature	<ul style="list-style-type: none"> ■ Without LCD display: -40 to +90 °C (-40 to +194 °F) Optional -54 to +85 °C (-65 to +185 °F) ■ Without LCD display: -40 to +90 °C (-40 to +194 °F); optional -50 °C (-58 °F) ■ With LCD display: -40 to +85 °C (-40 to +185 °F) ■ Separate housing: -40 to +60 °C (-40 to +140 °F) <p>With M12 plug, elbowed: -25 to +85 °C (-13 to +185 °F)</p>
----------------------------	--

Operating altitude	Up to 5 000 m (16 404 ft) above sea level.
---------------------------	--

Climate class	<p>Class 4K4H (air temperature: -20 to +55 °C (-4 to +131 °F), relative humidity: 4 to 100 %) satisfied as per DIN EN 60721-3-4.</p> <p>Condensation is possible.</p>
----------------------	---

Atmosphere

Operation in very corrosive environment

Anodic corrosion protection can be ordered as a "mounted accessory".

Degree of protection

Test as per IEC 60529 and NEMA 250-2014

Housing and process connection

IP66/68, TYPE 4X/6P

(IP68: (1.83 mH₂O for 24 h))

Cable entries

- Gland M20, plastic, IP66/68 TYPE 4X/6P
- Gland M20, brass nickel plated, IP66/68 TYPE 4X/6P
- Gland M20, 316L, IP66/68 TYPE 4X/6P
- Thread M20, IP66/68 TYPE 4X/6P
- Thread G1/2, IP66/68 TYPE 4X/6P

If the G1/2 thread is selected, the device is delivered with an M20 thread as standard and a G1/2 adapter is included with the delivery, along with the corresponding documentation

- Thread NPT1/2, IP66/68 TYPE 4X/6P
- Dummy plug transport protection: IP22, TYPE 2
- Plug HAN7D, 90 deg. IP65 NEMA Type 4X
- Plug M12

When housing is closed and connecting cable is plugged in: IP66/67 NEMA Type 4X

When housing is open or connecting cable is not plugged in: IP20, NEMA Type 1

NOTICE

Plug M12 and plug HAN7D: incorrect mounting can invalidate the IP protection class!

- ▶ The degree of protection only applies if the connecting cable used is plugged in and screwed tight.
- ▶ The degree of protection only applies if the connecting cable used is specified according to IP67 NEMA Type 4X.
- ▶ The IP protection classes are only maintained if the dummy cap is used or the cable is connected.

Process connection and process adapter when using the separate housing

FEP cable

- IP69 (on sensor side)
- IP66 TYPE 4/6P
- IP68 (1.83 mH₂O for 24 h) TYPE 4/6P

PE cable

- IP69 (on sensor side)
- IP66 TYPE 4/6P
- IP68 (1.83 mH₂O for 24 h) TYPE 4/6P

Vibration resistance

Single compartment housing

Measuring range	Sine wave oscillation IEC 61298-3:2008	Shock
10 mbar (0.15 psi) and 30 mbar (0.45 psi) (only up to PN100)	10 Hz to 60 Hz: ±0.21 mm (0.0083 in) 60 Hz to 2000 Hz: 3 g	30 g
0.1 to 250 bar (1.5 to 3 750 psi)	10 Hz to 60 Hz: ±0.35 mm (0.0138 in) 60 Hz to 1000 Hz: 5 g	30 g

Aluminum dual compartment housing

Measuring range	Sine wave oscillation IEC 61298-3:2008	Shock
10 mbar (0.15 psi) and 30 mbar (0.45 psi)	10 Hz to 60 Hz: ± 0.21 mm (0.0083 in) 60 Hz to 2000 Hz: 3 g	30 g
0.1 to 250 bar (1.5 to 3 750 psi)	10 Hz to 60 Hz: ± 0.35 mm (0.0138 in) 60 Hz to 1000 Hz: 5 g	30 g

Stainless steel dual compartment housing

Measuring range	Sine wave oscillation IEC 61298-3:2008	Shock
10 mbar (0.15 psi) and 30 mbar (0.45 psi) (only up to PN63)	10 Hz to 60 Hz: ± 0.15 mm (0.0059 in) 60 Hz to 500 Hz: 1 g	15 g
0.1 to 250 bar (1.5 to 3 750 psi)	10 Hz to 60 Hz: ± 0.15 mm (0.0059 in) 60 Hz to 500 Hz: 2 g	15 g

Dual compartment housing, L-shape

Sine wave oscillation IEC 61298-3:2008	Shock
10 Hz to 60 Hz: ± 0.21 mm (0.0083 in) 60 Hz to 2000 Hz: 3 g	30 g

Electromagnetic compatibility (EMC)

- Electromagnetic compatibility as per EN 61326 series and NAMUR recommendation EMC (NE21)
- With regard to the safety function (SIL), the requirements of EN 61326-3-x are satisfied
- Maximum deviation with interference influence: < 0.5% of span with full measuring range (TD 1:1)

For more details refer to the EU Declaration of Conformity.

Process


Process temperature range

NOTICE

The permitted process temperature depends on the process connection, the ambient temperature and the type of approval.

- ▶ All the temperature data in this document must be taken into consideration when selecting the measuring device.

Devices without a manifold

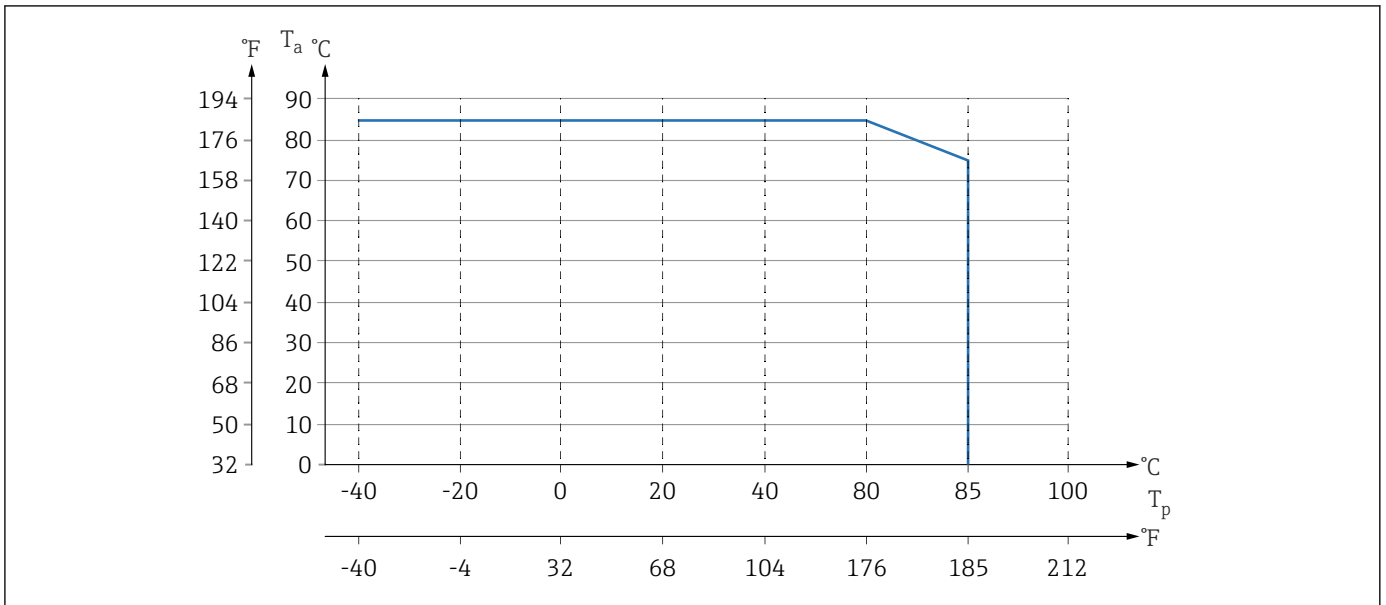


4 Values apply for vertical mounting without insulation.

T_p Process temperature
 T_a Ambient temperature

Devices with a manifold

The maximum permitted process temperature at the manifold is 110 °C (230 °F).

For process temperatures >85 °C (185 °F) where non-insulated side flanges are installed horizontally on a valve manifold, a reduced ambient temperature applies (see the following graphic).

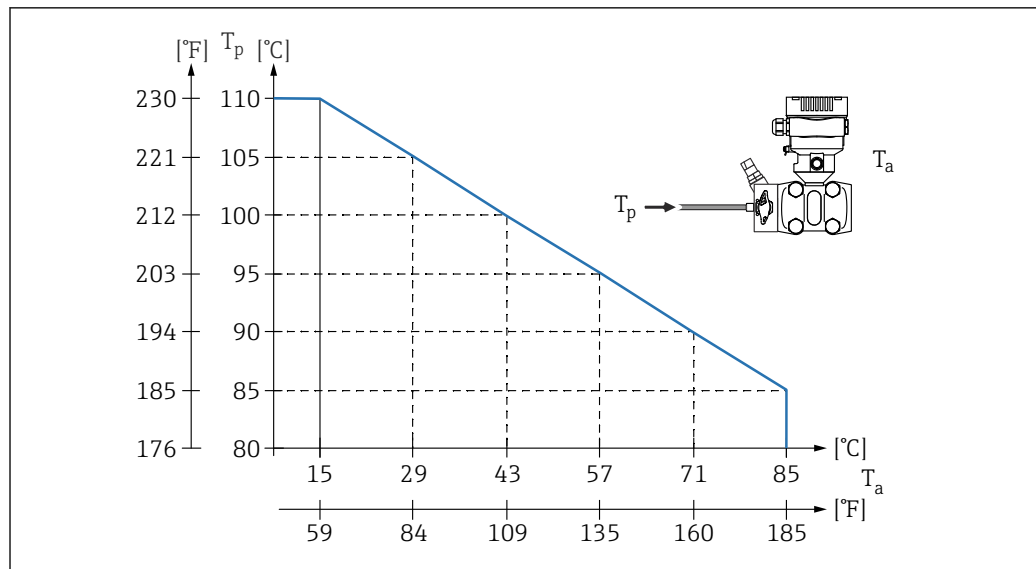

A0043580

T_a Maximum ambient temperature at the manifold

T_p Maximum process temperature at the manifold

Oxygen applications (gaseous)

Oxygen and other gases can react explosively to oils, grease and plastics. The following precautions must be taken:

- All components of the plant, such as the measuring devices, must be cleaned according to national requirements.
- Depending on the materials used, a certain maximum temperature and a maximum pressure must not be exceeded for oxygen applications.

Cleaning of the measuring device (not device accessories) is offered as an optional service.

- p_{max} : 80 bar (1200 psi)
- T_{max} environment: 60 °C (140 °F)

Process temperature range (temperature at transmitter)

Measuring device without a manifold

- -40 to +85 °C (-40 to +185 °F)
Lower temperatures are optionally available.
- Pay attention to the process temperature range of the seal

Measuring device with a manifold

The maximum permitted process temperature at the manifold is 110 °C (230 °F) (limited by IEC standard).

For process temperatures >85 °C (185 °F) where non-insulated side flanges are installed horizontally on a valve manifold, a reduced ambient temperature applies up to a maximum ambient temperature calculated according to the following formula:

$$T_{\text{Ambient_Temperature_max}} = 85 \text{ °C} - 2.8 \cdot (T_{\text{Process_Temperature}} - 85 \text{ °C})$$

$$T_{\text{Ambient_Temperature_max}} = 185 \text{ °F} - 2.8 \cdot (T_{\text{Process_Temperature}} - 185 \text{ °F})$$

$$T_{\text{Ambient_Temperature_max}} = \text{maximum ambient temperature in °C or °F}$$

$$T_{\text{Process_Temperature}} = \text{process temperature at a manifold in °C or °F}$$

Process temperature range, seals

- FKM: -20 to +85 °C (-4 to +185 °F)
For PN > 160 bar (2320 psi): T_{min} -15 °C (+5 °F)
- PTFE: -40 to +85 °C (-40 to +185 °F)
For pressures > 160 bar (2320 psi): process temperature is limited to -20 °C (-4 °F)
- FKM, cleaned from oil+grease: -10 to +85 °C (+14 to +185 °F)
- FKM, cleaned for oxygen service: -10 to +60 °C (+14 to +140 °F)

- FFKM:
 - T -10 to +85 °C (+14 to +185 °F): MWP 87 bar (1 262 psi); OPL 130 bar (1 885 psi)
 - T +25 to +85 °C (+77 to +185 °F): MWP 107 bar (1 552 psi); OPL 160 bar (2 320 psi)
- EPDM: -40 to +85 °C (-40 to +185 °F)
- PTFE, cleaned for oxygen applications: -20 to +60 °C (-4 to +140 °F)
For pressures > 160 bar (2 320 psi): process temperature is limited to -20 °C (-4 °F)

Process pressure range
Pressure specifications
 **WARNING**

The maximum pressure for the measuring device depends on the lowest-rated element with regard to pressure (components are: process connection, optional mounted parts or accessories).

- ▶ Only operate the measuring device within the prescribed limits of the components!
- ▶ MWP (maximum working pressure): The MWP is specified on the nameplate. This value refers to a reference temperature of +20 °C (+68 °F) and may be applied to the device for an unlimited time. Note temperature dependence of MWP. For flanges, refer to the following standards for the permitted pressure values at higher temperatures: EN 1092-1 (with regard to their stability/temperature property, the materials 1.4435 and 1.4404 are grouped together under EN 1092-1; the chemical composition of the two materials can be identical.), ASME B 16.5a, JIS B 2220 (the latest version of the standard applies in each case). MWP data that deviate from this are provided in the relevant sections of the Technical Information.
- ▶ The test pressure corresponds to the overpressure limit (OPL) of the overall system. This value refers to a reference temperature of +20 °C (+68 °F).
- ▶ The Pressure Equipment Directive (2014/68/EU) uses the abbreviation "PS". The abbreviation "PS" corresponds to the MWP (maximum working pressure) of the measuring device.
- ▶ In the case of sensor range and process connection combinations where the over pressure limit (OPL) of the process connection is smaller than the nominal value of the sensor, the device is set at the factory, at the very maximum, to the OPL value of the process connection. If the entire sensor range must be used, select a process connection with a higher OPL value (1.5 x PN; MWP = PN).
- ▶ Oxygen applications: do not exceed values for P_{max} and T_{max} .

Burst pressure

PN160

- Measuring range: ≤40 bar (580 psi)
- Burst pressure: 690 bar (10 005 psi)

Applies for the process seal materials FKM, PTFE, FFKM, EPDM and for pressure applied on both sides

If the side vent valves option (sv) and the PTFE seal is selected, the burst pressure is 600 bar (8 700 psi)

PN250, PN320, PN420

- Measuring range: ≤40 bar (580 psi)
- Burst pressure: 1 600 bar (23 200 psi)

Applies for the process seal materials FKM, FFKM, EPDM and for pressure applied on both sides

If the side vent valves option (sv) is selected, the burst pressure is 690 bar (10 005 psi)

For the process seal material PTFE (PN250), the burst pressure is 1 250 bar (18 125 psi)

Ultrapure gas applications

Endress+Hauser also offers measuring devices for special applications, such as for ultrapure gas, which are cleaned from oil and grease. No special restrictions regarding the process conditions apply to these measuring devices.

Hydrogen applications

A **gold-coated** metal process membrane offers universal protection against hydrogen diffusion, both in gas applications and in applications with aqueous solutions.

Mechanical construction

i For the dimensions, see the Product Configurator: www.endress.com

Search for product → Start configuration → after configuration, click "CAD"

The following dimensions are rounded values. For this reason, the dimensions may deviate from the values on www.endress.com.


Design, dimensions

Device height

The device height is calculated from

- the height of the housing
- the height of the individual process connection

The individual heights of the components can be found in the following sections. To calculate the device height, add the individual heights of the components. Take the installation clearance into consideration (space that is used to install the device).

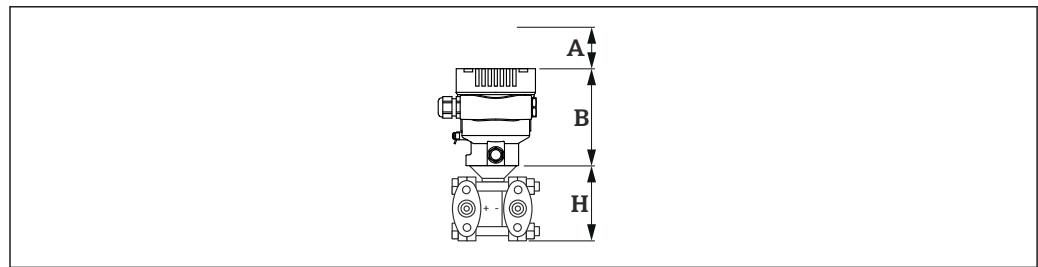


A0038376

- A Installation clearance
 B Height of the housing
 H Height of the sensor assembly

Dimensions

Single compartment housing

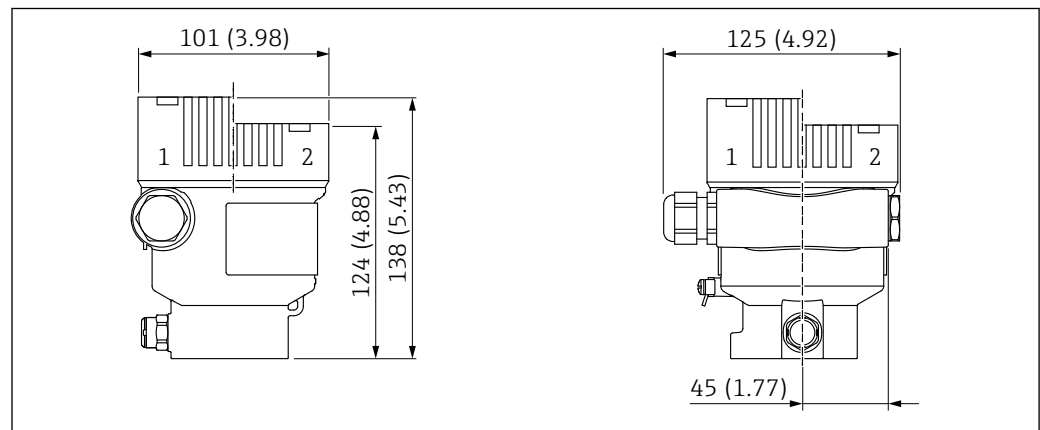


A0038380

Unit of measurement mm (in)

- 1 122 mm (4.80 in) height with cover with plastic viewing window; 138 mm (5.43 in) height with cover with glass viewing window (devices for Ex d, dust Ex)
 2 Cover without viewing window

Dual compartment housing

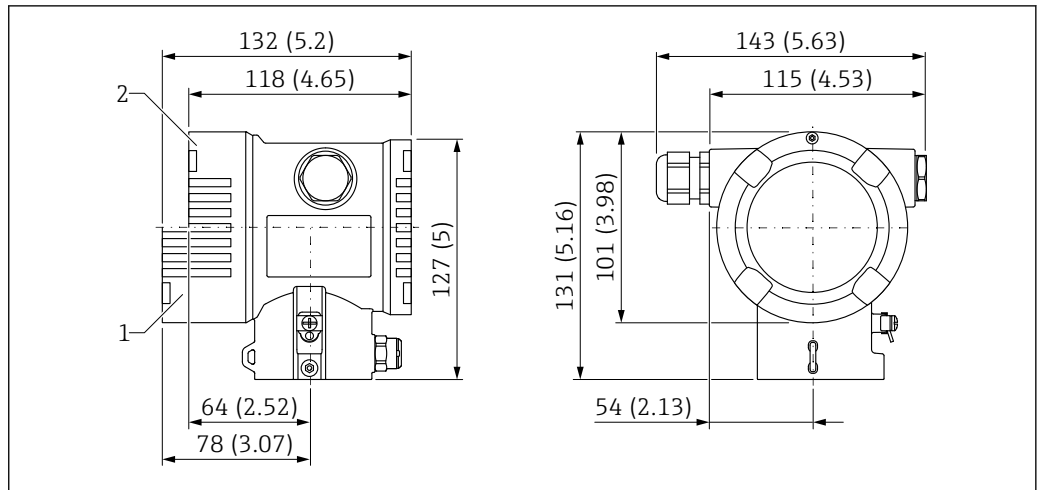


A0038377

Unit of measurement mm (in)

- 1 121 mm (4.76 in) width with cover with plastic viewing window; 132 mm (5.2 in) width with cover with glass viewing window (devices for Ex d, dust Ex)
- 2 Cover without viewing window

Dual compartment housing, L-shape

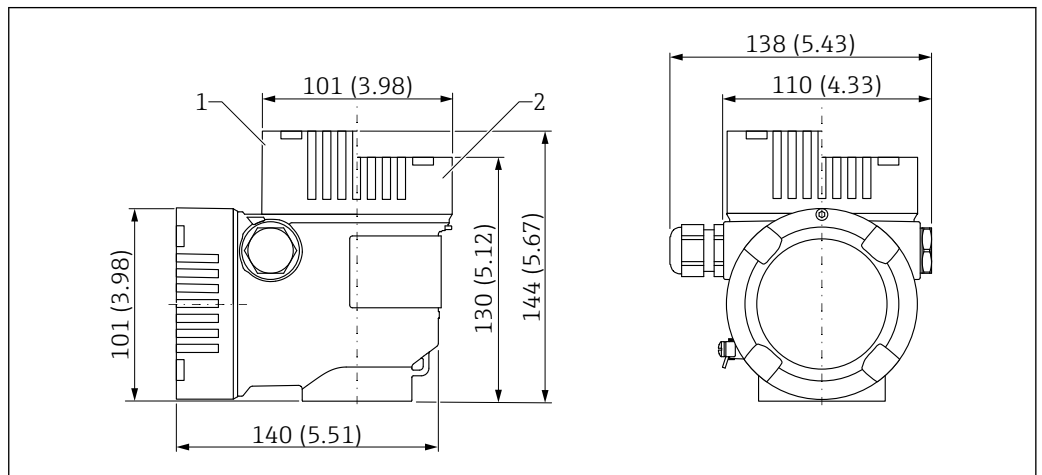


A0038381

Unit of measurement mm (in)

- 1 144 mm (5.67 in) height with cover with glass viewing window (devices for Ex d, dust Ex)
- 2 133 mm (5.24 in) height with cover with plastic viewing window
- 3 Cover without viewing window


Sensor, remote (separate housing)

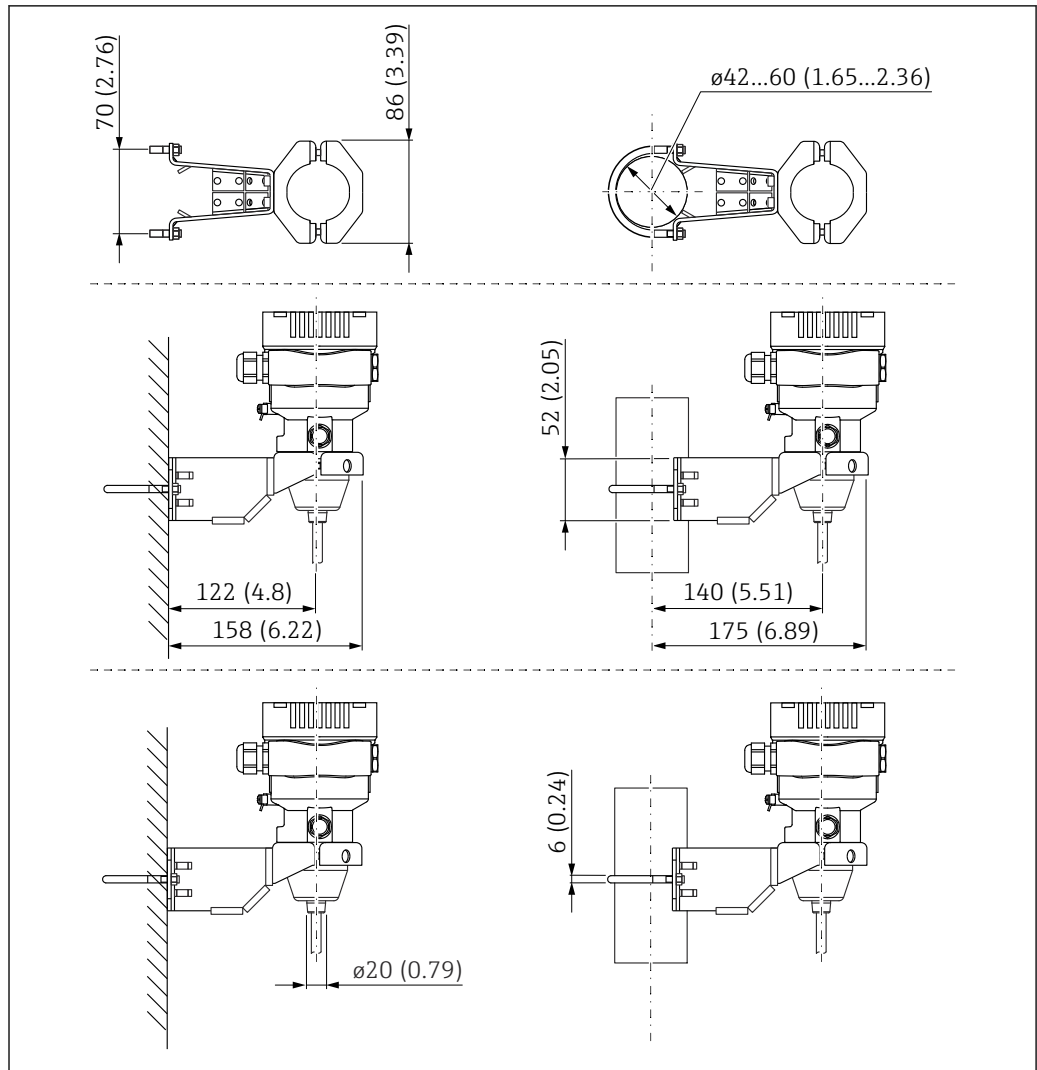

A0038214

Unit of measurement mm (in)

Mounted on manifold

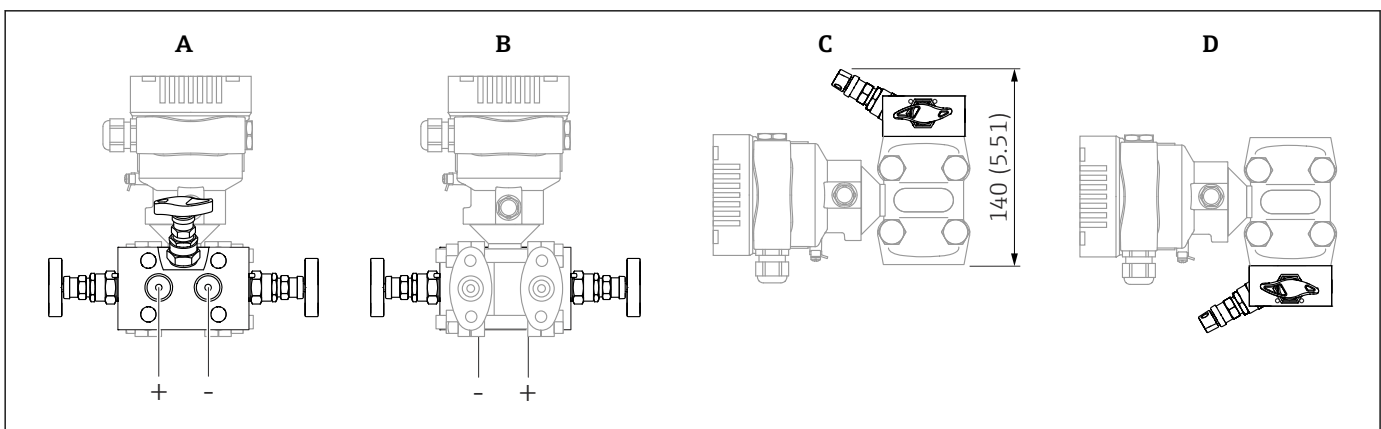


A0038641

Unit of measurement mm (in)

- A Mounted backside of manifold
- B Mounted frontside of manifold
- C Mounted bottom of manifold
- D Mounted top of manifold

Oval flange, connection 1/4-18 NPT or RC 1/4

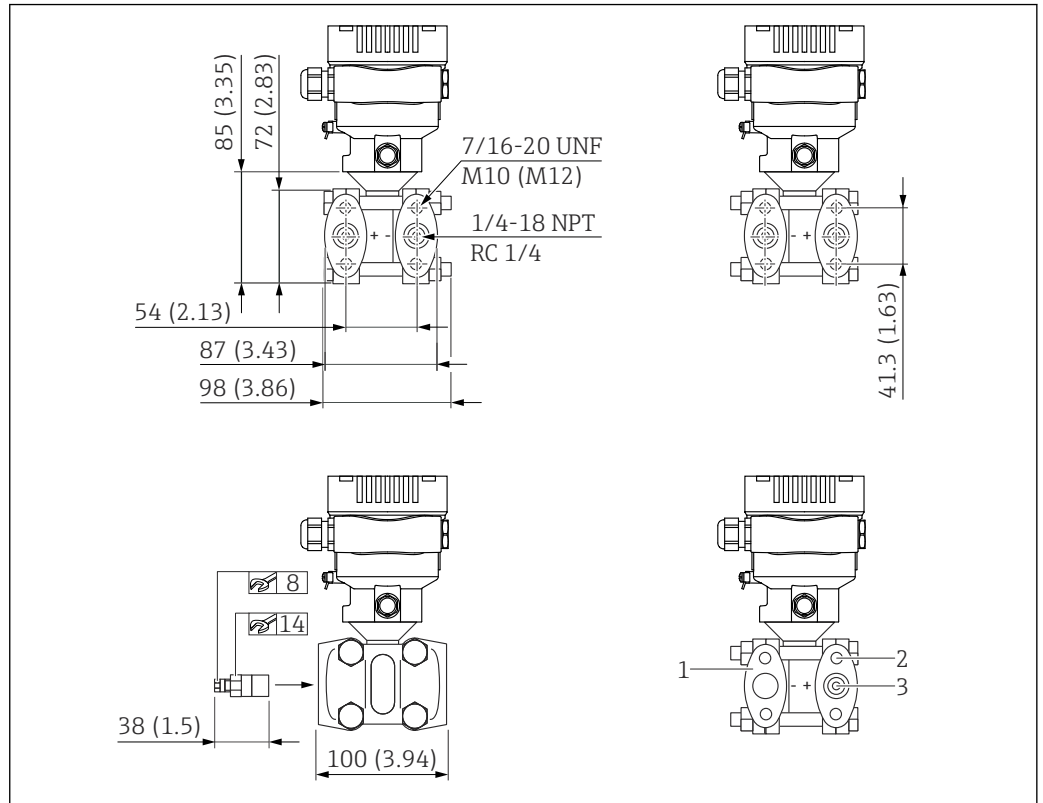

5 Front view, left-hand side view, right-hand side view. Unit of measurement mm (in)

- 1 Blind flange
- 2 Thread depth: 15 mm (0.59 in)
- 3 Thread depth: 12 mm (0.47 in) (±1 mm (0.04 in))

7/16-20 UNF

Connections including 2 vent valves:

- <PN 160: 1/4-18 NPT IEC 61518
- PN 160: M10
- PN 420: M12

7/16-20 UNF with blind flange on LP side (version with absolute pressure sensor or gauge pressure sensor)


Connections including vent valve:

1/4-18 NPT IEC 61518

RC 1/4

Connections including 2 vent valves:

- <PN 160: 1/4-18 NPT IEC 61518
- PN 160: RC 1/4
- PN 420: RC 1/4

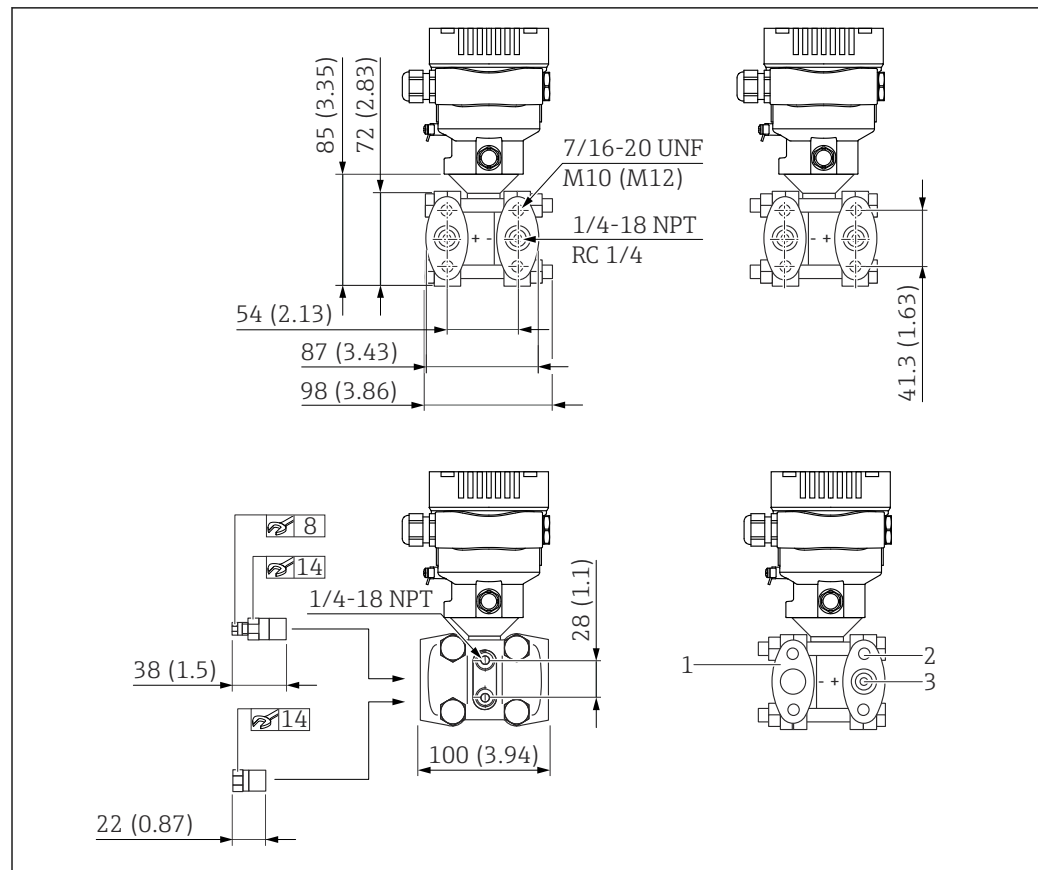Oval flange, connection 1/4-18 NPT or RC 1/4, with side vent

6 Front view, left-hand side view, right-hand side view. Nuts are always located on the minus side. Unit of measurement mm (in)

- 1 blind flange
- 2 Thread depth: 15 mm (0.59 in)
- 3 Thread depth: 12 mm (0.47 in) (± 1 mm (0.04 in))

7/16-20 UNF

Connections including 4 locking screws and 2 vent valves:
1/4-18 NPT IEC 61518

7/16-20 UNF with blind flange on LP side (version with absolute pressure sensor or gauge pressure sensor)

Connections including vent valve:
1/4-18 NPT IEC 61518

RC 1/4


Connections including 4 locking screws and 2 vent valves:

- <PN 160: 1/4-18 NPT IEC 61518
- PN 160: RC 1/4
- PN 420: RC 1/4

Bottom process connection NPT1/4-18 coplanar compatible

For mounting on existing coplanar manifolds.

Seal is supplied, as per selected seal material.

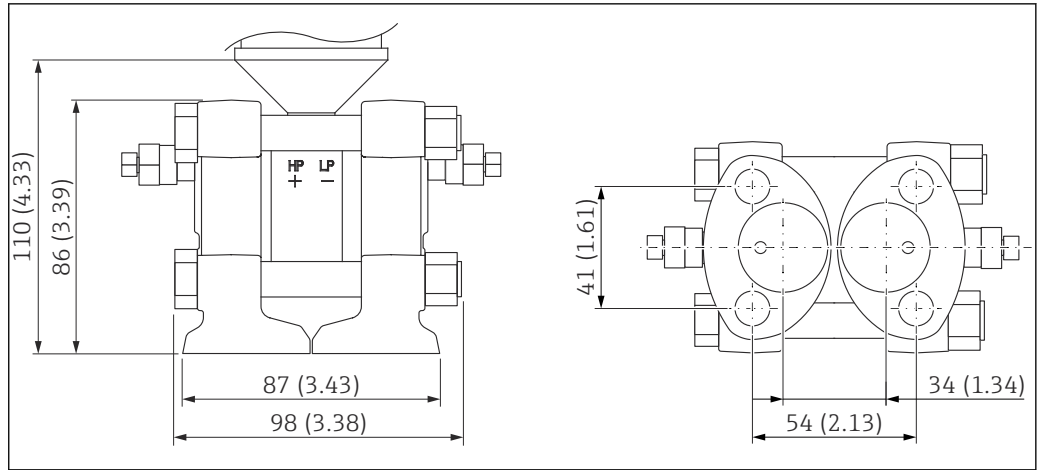


A0039493

Seal of sensor flange	Seal of coplanar process connection ¹⁾
PTFE	PTFE
FKM	FKM
EPDM	
FFKM	

1) Flange manifold: cannot be selected!

Bottom process connection, NPT1/4-18 IEC61518 UNF7/16-20

For mounting on IEC manifolds in an upright position.

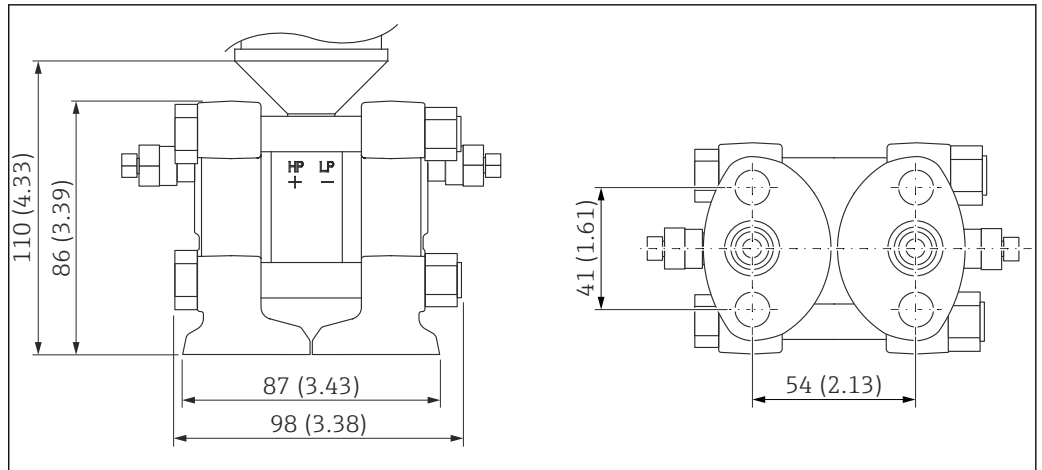

A0039494

Weight

Housing

Weight including electronics and display.

- Single compartment housing: 1.1 kg (2.43 lb)
- Dual compartment housing
 - Aluminum: 1.4 kg (3.09 lb)
 - Stainless steel: 3.3 kg (7.28 lb)
- Dual compartment housing, L-shape: 1.7 kg (3.75 lb)

Sensor, remote (separate housing)

- Housing: see the Housing section
- Housing adapter: 0.55 kg (1.21 lb)
- Process connection adapter: 0.36 kg (0.79 lb))
- Cable:
 - PE cable 2 meters: 0.18 kg (0.40 lb)
 - PE cable 5 meters: 0.35 kg (0.77 lb)
 - PE cable 10 meters: 0.64 kg (1.41 lb)
 - FEP cable 5 meters: 0.62 kg (1.37 lb)
- Mounting bracket: 0.46 kg (1.01 lb)

Process connections

- Process connections made of 316L: 3.2 kg (7.06 lb)
- Process connections made of Alloy C276: 3.5 kg (7.72 lb)

Ex d version: 0.63 kg (1.39 lb)

Accessories

Mounting bracket: 0.5 kg (1.10 lb)

Materials in contact with process**Membrane material**

- 316L (1.4435)
- Alloy C276
The flange raised face is made from the same material as the process isolating diaphragm.
- Tantalum
The flange raised face is made from the same material as the process isolating diaphragm.
- Monel (Alloy 400)
The flange raised face is made from the same material as the process isolating diaphragm.

Membrane coating

Gold, 25 µm

Seal

- PTFE
- FKM
- EPDM
- FFKM

Process connections

NPT1/4-18 IEC61518 UNF7/16-20:

Side flange: AISI 316/316L (1.4408) / CF3M (cast equivalent to material AISI 316L)

NPT1/4-18 IEC61518 UNF7/16-20, Superduplex:

Side flange:

NPT1/4-18 DIN19213 M10:

Side flange: 316L

Alloy C276 (2.4819)

NPT1/4-18 DIN19213 M12:

Side flange: 316L

RC 1/4:

Side flange: AISI 316/316L (1.4408) / CF3M (cast equivalent to material AISI 316L)

Alloy C276 (2.4819)

NPT1/4-18 Coplanar compatible, Superduplex:

Side flange: 1.4469 (resistant to sea water, Super Duplex cast)

NPT1/4-18 Coplanar IEC:

- Side flange: 1.4469 (resistant to sea water, Super Duplex cast)
- Measuring cell body: 316L (1.4404)
- Screws: A4-70

Vent valves

Depending on process connection ordered:

- AISI 316L (1.4404)
- Alloy C22 (2.4602)

Locking screws

AISI 316L (1.4404), Alloy C22 (2.4602)

Accessories



For technical data (e.g. materials, dimensions or order numbers), see the accessory document SD01553P.

Materials not in contact with process

Dual compartment housing and cover

- Polyester powder coating on aluminum as per EN1706 AC43400 (reduced copper content to prevent corrosion)
- Stainless steel (ASTM A351 : CF3M (cast equivalent to material AISI 316L) / DIN EN 10213 : 1.4409)

Dual compartment housing and cover, L-shape

Polyester powder coating on aluminum as per EN1706 AC43400 (reduced copper content to prevent corrosion)

Separate housing

- Mounting bracket
 - Bracket: AISI 316L (1.4404)
 - Screw and nuts: A4-70
 - Half-shells: AISI 316L (1.4404)
- Seal for cable from separate housing: EPDM
- Gland for cable of separate housing: AISI 316L (1.4404)
- PE cable for separate housing: abrasion-proof cable with strain-relief Dynema members; shielded using aluminum-coated foil; insulated with polyethylene (PE-LD), black; copper wires, twisted, UV-resistant
- FEP cable for separate housing: abrasion-proof cable; shielded using galvanized steel wire netting; insulated with fluorinated ethylene propylene (FEP), black; copper cores, twisted, UV-resistant
- Process connection adapter for separate housing: AISI 316L (1.4404)

Aluminum housing nameplate

- Plastic adhesive label
- Versions that can be ordered for use at reduced ambient temperatures: metal wired-on tag plate made of 316L (1.4404)

Nameplate of stainless steel housing

- Metal nameplate made of 316L (1.4404)
Nameplate fasteners (rivets) made of 316Ti (1.4571)
- Versions that can be ordered for use at reduced ambient temperatures: metal wired-on tag plate made of 316L (1.4404)

Cable entries

- M20 gland:
 - Plastic, brass nickel plated or 316L (depends on version ordered)
 - Dummy plug made of plastic, aluminum or 316L (depends on version ordered)
- Thread M20:
 - Dummy plug made of aluminum or 316L (depends on version ordered)
- Thread G1/2:
 - Adapter made of aluminum or 316L (depends on version ordered)
 - If the G1/2 thread is selected, the device is delivered with an M20 thread as standard and a G1/2 adapter is included with the delivery, along with the corresponding documentation

- Thread NPT1/2:
Dummy plug made of aluminum or 316L (depends on version ordered)
- Plug M12:
CuZn nickel-plated or 316L (depends on version ordered)
Dummy plug made of aluminum or 316L (depends on version ordered)
- Plug HAN7D:
Aluminum, die-cast zinc, steel
Dummy plug made of aluminum or 316L (depends on version ordered)

Fill fluid

- Silicone oil
- Synthetic oil, FDA
- Inert oil

Connecting parts

- Connection between housing and process connection: AISI 316L (1.4404)
- Screws and nuts
 - PN 160: hex.-headed bolt DIN 931-M12x90-A4-70
 - PN 160: hex.-headed nut DIN 934-M12-A4-70
 - PN 250, PN 320 and PN 420: hex.-headed bolt ISO 4014-M12x90-A4
 - PN 250, PN 320 and PN 420: hex.-headed nut ISO 4032-M12-A4-bs
- Measuring cell body: AISI 316L (1.4404)
- Setscrew: DIN 915 M 6x8 A2-70
- Bearing: DIN 5401 (1.3505)
- Side flanges: AISI 316/316L (1.4408) / CF3M (cast equivalent to material AISI 316L)

Accessories

For technical data (e.g. materials, dimensions or order numbers), see the accessory document SD01553P.

Human interface

Operating concept

Operator-oriented menu structure for user-specific tasks

- User navigation
- Diagnostics
- Application
- System

Fast and safe commissioning

- Interactive wizard with graphical user interface for guided commissioning in FieldCare, DeviceCare or DTM, AMS and PDM-based third-party tools or SmartBlue
- Menu guidance with brief descriptions of the individual parameter functions
- Standardized operation at the device and in the operating tools

Integrated HistoROM data memory

- Adoption of data configuration when electronics modules are replaced
- Up to 100 event messages recorded in the device

Efficient diagnostics increase measurement availability

- Remedial measures are integrated in plain text
- Diverse simulation options

Bluetooth module (optionally integrated in onsite display)

- Quick and easy setup with SmartBlue App or PC with DeviceCare, version 1.07.00 and higher or FieldXpert SMT70
 - No additional tools or adapters required
 - Encrypted single point-to-point data transmission (tested by Fraunhofer Institute) and password-protected communication via *Bluetooth*® wireless technology
-

Languages


Operating languages

- English (English is set at the factory if no other language is ordered)
- Deutsch
- Français
- Español
- Italiano
- Nederlands
- Portuguesa
- Polski
- русский язык (Russian)
- Türkçe
- 中文 (Chinese)
- 日本語 (Japanese)
- 한국어 (Korean)
- Bahasa Indonesia
- tiếng Việt (Vietnamese)
- čeština (Czech)
- Svenska

Local operation

Operating keys and DIP switches on the electronic insert

HART

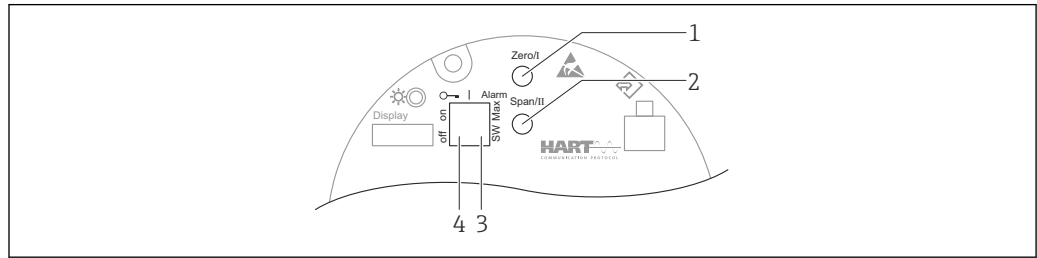

A0039285

- 1 Operating key for lower range value (Zero)
- 2 Operating key for upper range value (Span)
- 3 DIP switch for alarm current
- 4 DIP switch for locking and unlocking the measuring device

i The setting of the DIP switches has priority over other operation methods (e.g. FieldCare/ DeviceCare).


Local display

Device display (optional)

Functions:


- Display of measured values and fault and notice messages
- Background lighting, which switches from green to red in the event of an error
- The device display can be removed for easier operation

i The device displays are available with the additional option of Bluetooth® wireless technology.

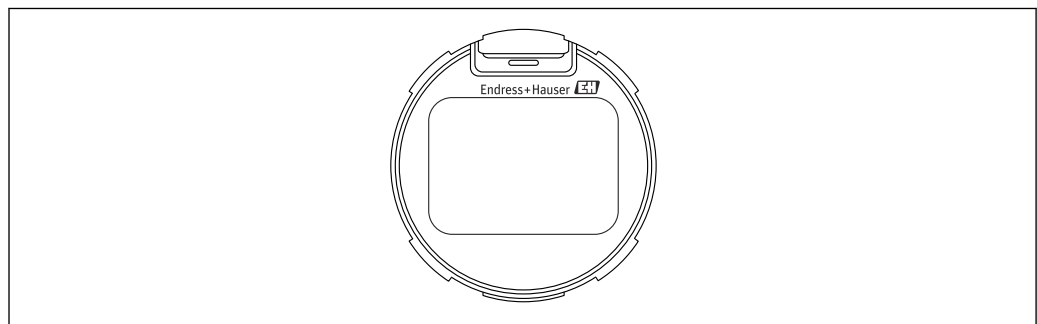

A0043059

7 Segment display

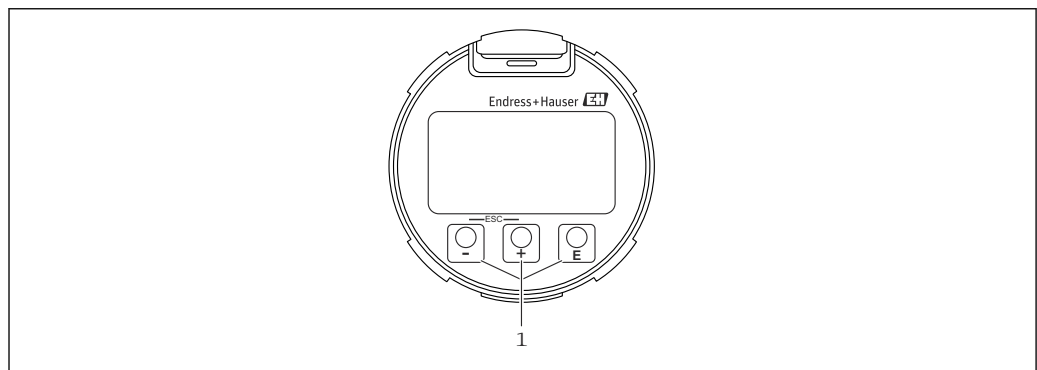

A0039284

8 Graphic display with optical operating keys (1)

Remote operation

Via HART protocol


Via service interface (CDI)

Operation via Bluetooth® wireless technology (optional)

Prerequisite

- Measuring device with Bluetooth display
- Smartphone or tablet with Endress+Hauser SmartBlue App or PC with DeviceCare, version 1.07.00 and higher, or FieldXpert SMT70

The connection range is up to 25 m (82 ft). The range can vary depending on ambient conditions such as fixtures, walls or ceilings.

 The operating keys on the display are locked as soon as the device is connected via Bluetooth.

System integration

HART

Version 7

Supported operating tools

Smartphone or tablet with Endress+Hauser SmartBlue (App), DeviceCare version 1.07.00 and higher, FieldCare, DTM, AMS and PDM

HistoROM

If the electronic insert is replaced, the stored data (excluding the event list) are transferred by unplugging the HistoROM module and plugging it into the new electronic insert.

The device serial number is saved in the HistoROM. The electronics serial number is saved in the electronics.

Certificates and approvals

 Certificates, approvals and other documentation currently available can be accessed on the Endress+Hauser website: www.endress.com → Downloads.

CE mark The device meets the legal requirements of the relevant EC directives. Endress+Hauser confirms that the device has been successfully tested by applying the CE mark.

RCM-Tick marking The supplied product or measuring system meets the ACMA (Australian Communications and Media Authority) requirements for network integrity, interoperability, performance characteristics as well as health and safety regulations. Here, especially the regulatory arrangements for electromagnetic compatibility are met. The products bear the RCM-Tick marking on the nameplate.



A0029561

Ex approvals

- ATEX
- CSA (in preparation)
- NEPSI (in preparation)
- INMETRO (in preparation)
- KC (in preparation)
- EAC (in preparation)
- JPN (in preparation)
- Also combinations of different approvals

All the data related to explosion protection is provided in separate Ex documentation which is also available upon request. The Ex documentation is supplied as standard with all devices approved for use in explosion hazardous areas.

Additional approvals in preparation.

Explosion-protected smartphones and tablets

If used in hazardous areas, mobile end devices with an Ex approval must be used.

EAC conformity

The measuring device meets the legal requirements of the applicable EAC Directives. These are listed in the corresponding EAC Declaration of Conformity along with the standards applied.

Endress+Hauser confirms successful testing of the measuring device by affixing to it the EAC mark.

Certificate of current Good Manufacturing Practices (cGMP)

The certificate is available in English only and covers the following topics:

- Materials of construction of product wetted parts
- TSE compliance
- Polishing and surface finish
- Material/ compound compliance table e.g. USP Class VI, FDA conformity

Drinking water approval

- NSF/ANSI 61 drinking water approval
- KTW drinking water approval W 270

Overfill prevention (in preparation)

The measuring device is tested in accordance with the approval guidelines for overfill protection units (ZG-ÜS:2012-07) as overfill protection as per Section 63 of the German Water Resources Act (WHG).

Functional safety SIL/ IEC 61508 Declaration of Conformity (optional)

The measuring devices with a 4-20 mA output signal have been developed in accordance with the IEC 61508 standard. These measuring devices can be used to monitor the process level and pressure up to SIL 3. For a detailed description of the safety functions, settings and functional safety data, see the "Functional Safety Manual".

Marine approval (pending)	<ul style="list-style-type: none"> ■ ABS (American Bureau of Shipping) ■ LR (Lloyd's Register) ■ BV (Bureau Veritas) ■ DNV GL (Det Norske Veritas / Germanischer Lloyd)
Radio approval	Displays with Bluetooth LE have radio licenses according to CE and FCC. The relevant certification information and labels are provided on display.
CRN approval	A CRN approval (Canadian Registration Number) is available for some device versions. These devices are fitted with a separate plate bearing the registration number CRN 0F20813.5C. In order to obtain a CRN-approved device, a CRN-approved process connection must be ordered along with the option "CRN" in the order code for "Additional approvals".
Test reports	<p>Test, report, declarations</p> <ul style="list-style-type: none"> ■ Inspection certificate 3.1, EN10204 (material certificate, wetted metallic parts) ■ NACE MR0175 / ISO 15156 (wetted metallic parts), declaration ■ NACE MR0103 / ISO 17945 (wetted metallic parts), declaration ■ AD 2000 (wetted metal parts), declaration, excluding process isolating diaphragm ■ ASME B31.3 process piping, declaration ■ ASME B31.1 power piping, declaration ■ Transmitter ambient temperature range (-50 to +85 °C (-58 to +185 °F)); for sensor, see specification ■ Transmitter ambient temperature range (-54 to +85 °C (-65 to +185 °F)); for sensor, see specification ■ Pressure test, internal procedure, test report ■ Helium leak test, internal procedure, test report ■ PMI test, internal procedure (wetted metallic parts), test report ■ Welding documentation, wetted/pressurized seams, declaration <p>Test reports, declarations and inspection certificates are available in electronic format in the Device Viewer: enter the serial number of the nameplate (www.endress.com/deviceviewer).</p> <p>Applicable for the order codes "Calibration" and "Test, certificate".</p> <p>Product documentation on paper</p> <p>Test reports, declarations and inspection certificates in hard copy can optionally be ordered with the order option "Product documentation on paper". These documents are supplied with the ordered product.</p> <p>Calibration</p> <p>5-point calibration certificate</p> <p>10-point calibration certificate, traceable to ISO/IEC 17025</p> <p>Manufacturer declarations</p> <p>Depending on the desired configuration, the following documents can be additionally ordered with the measuring device:</p> <ul style="list-style-type: none"> ■ FDA conformity ■ TSE-free: materials free from animal origin ■ Regulation (EC) No. 2023/2006 (GMP) <p><i>Downloading the Declaration of Conformity</i></p> <p>www.endress.com → Download</p>
Pressure Equipment Directive 2014/68/EU (PED)	<p>Pressure equipment with allowable pressure ≤ 200 bar (2 900 psi)</p> <p>Pressure equipment (with a maximum allowable pressure $PS \leq 200$ bar (2 900 psi)) can be classified as pressure accessories in accordance with Pressure Equipment Directive 2014/68/EU. If the maximum allowable pressure is ≤ 200 bar (2 900 psi) and the pressurized volume of the pressure equipment is ≤ 0.1 l, the pressure equipment is subject to the Pressure Equipment Directive (cf. Pressure Equipment Directive 2014/68/EU, Article 4, point 3). The Pressure Equipment Directive only requires that the pressure equipment shall be designed and manufactured in accordance with the "sound engineering practice of a Member State".</p>

Reasons:

- Pressure Equipment Directive (PED) 2014/68/EU Article 4, point 3
- Pressure equipment directive 2014/68/EU, Commission's Working Group "Pressure", Guideline A-05 + A-06

Note:

A partial examination shall be performed for pressure instruments that are part of safety equipment for the protection of a pipe or vessel from exceeding allowable limits (safety accessory in accordance with Pressure Equipment Directive 2014/68/EU, Article 2, point 4).

Pressure equipment with allowable pressure > 200 bar (2 900 psi)

Pressure equipment designated for application in every process fluid having a pressurized volume of <0.1 l and a max. allowable pressure PS > 200 bar (2 900 psi) must satisfy the essential safety requirements set out in Annex I of the Pressure Equipment Directive 2014/68/EU. According to Article 13 pressure equipment shall be classified by category in accordance with Annex II. Taking into account the low pressurized volume discussed above, the pressure devices are classed as category I pressure equipment. These devices must then bear the CE marking.

Reasons:

- Pressure Equipment Directive 2014/68/EU, Article 13, Annex II
- Pressure equipment directive 2014/68/EU, Commission's Working Group "Pressure", Guideline A-05

Note:

A partial examination shall be performed for pressure instruments that are part of safety equipment for the protection of a pipe or vessel from exceeding allowable limits (safety accessory in accordance with Pressure Equipment Directive 2014/68/EU, Article 2, point 4).

The following also applies:

Measuring devices, PN 420
Suitable for stable gases in group 1, category I, module A

Oxygen application	Verified cleaned, suitable for O ₂ service (wetted parts)
PWIS-free applications	Special cleaning of the transmitter to remove paint-wetting impairment substances, for use in paint shops, for instance.
China RoHS symbol	The measuring device is visibly identified according to SJ/T 11363-2006 (China-RoHS).
RoHS	The measuring system complies with the substance restrictions of the Restriction on Hazardous Substances Directive 2011/65/EU (RoHS 2).
Additional certification	<p>Classification of process sealing between electrical systems and (flammable or combustible) process liquids in accordance with UL 122701 (previously ANSI/ISA 12.27.01)</p> <p>Endress+Hauser devices are designed according to UL 122701 (previously ANSI/ISA 12.27.01) and allow the user to waive the use of - and save the cost of installing - external secondary process seals in the conduit as required by the process sealing sections of ANSI/NFPA 70 (NEC) and CSA 22.1 (CEC). These devices comply with the North-American installation practice and provide a very safe and cost-saving installation for pressurized applications with hazardous process media. The devices are assigned to "single seal" as follows:</p> <p>CSA C/US IS, XP, NI: 420 bar (6 300 psi)</p> <p>Further information can be found in the control drawings of the relevant devices.</p> <p>Metrological accreditation</p> <p>With the order option "China", the measuring device is supplied with a Chinese nameplate in accordance with the Chinese Quality Law.</p>

Ordering information

Ordering information

Detailed ordering information is available from your nearest sales organization www.addresses.endress.com or in the Product Configurator under www.endress.com :

1. Click Corporate
2. Select the country
3. Click Products
4. Select the product using the filters and search field
5. Open the product page

The Configuration button opens the Product Configurator.



Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
- Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

Scope of delivery

The scope of delivery comprises:

- Measuring device
- Optional accessories

Documentation supplied:

- Brief Operating Instructions
- Final inspection report
- Additional safety instructions for devices with approvals (e.g. ATEX, IECEx, NEPSI, etc.)
- Optional: factory calibration form, test certificates



The Operating Instructions are available on the Internet at:

www.endress.com → Download

Measuring point (tag)

- Order code: marking
- Option: Z1, tagging (TAG), see additional specification
- Location of tag identifier: to be selected in the additional specifications
 - Tag plate, stainless steel
 - Self-adhesive paper label
 - Supplied plate
 - RFID TAG
 - RFID TAG + tag plate stainless steel
 - RFID TAG + self-adhesive paper label
 - RFID TAG + supplied label/plate
- Definition of tag name: to be defined in the additional specifications
3 lines, each containing up to maximum 18 characters
The specified tag name appears on the selected label and/or the RFID TAG
- Identification on electronic nameplate (ENP): 32 digits

Application packages

Heartbeat Technology

Availability

Available in all measuring device versions.

Heartbeat Verification + Monitoring, optional.

Heartbeat diagnostics

- Continuous self-monitoring of the measuring device
- Diagnostic messages output to
 - the onsite display
 - an asset management system (e.g. FieldCare or DeviceCare)
 - an automation system (e.g. PLC)

Heartbeat Verification

- Monitoring of the installed device without interrupting the process, including a report
- Clear measuring point assessment (pass/fail) with high test coverage within the framework of manufacturer specifications
- Can be used to document normative requirements

Heartbeat Monitoring

- Statistical Sensor Diagnostics: statistical analysis and evaluation of the pressure signal, including signal noise, to detect process anomalies (e.g. blocked impulse lines)
- Loop Diagnostics: detection of elevated measuring circuit resistance values or declining power supply
- Process window: user-definable pressure and temperature limits to detect dynamic pressure surges or faulty trace heating systems or insulation
- Continuously supplies additional monitoring data to an external condition monitoring system for the purpose of predictive maintenance or process monitoring

Detailed description

See Special Documentation for SD Heartbeat Technology.

Accessories

Device-specific accessories

Mechanical accessories

- Mounting bracket for housing
- Mounting bracket for manifolds
- Manifolds
- Oval flange adapter
- Calibration adapter 5/16"-24 UNF, to screw into vent valves
- Weather protection covers



For technical data (e.g. materials, dimensions or order numbers), see the accessory document SDO1553P.

Plug connectors

- Plug connector M12 90 deg, IP67 5m cable, union nut, Cu Sn/Ni
- Plug connector M12, IP67 union nut, Cu Sn/Ni
- Plug connector M12, 90 deg IP67 union nut, Cu Sn/Ni



The IP protection classes are only maintained if the dummy cap is used or the cable is connected.

Weld-in accessory




For details, refer to TI00426F/00/EN "Weld-in adapters, process adapters and flanges".

Device Viewer

All the accessories for the measuring device, along with the order code, are listed in the *Device Viewer* (www.endress.com/deviceviewer).

Supplementary documentation

-  For an overview of the scope of the associated Technical Documentation, refer to the following:
- *Device Viewer* (www.endress.com/deviceviewer): Enter the serial number from the nameplate
 - *Endress+Hauser Operations App*: Enter the serial number from the nameplate or scan the 2D matrix code (QR code) on the nameplate


Standard documentation

- **Technical Information: planning guide**
The document contains all the technical data on the device and provides an overview of the accessories and other products that can be ordered for the device
- **Brief Operating Instructions: takes you quickly to the 1st measured value**
The Brief Operating Instructions contain all the essential information from incoming acceptance to initial commissioning
- **Operating Instructions: reference manual**
The Operating Instructions contain all the information that is required in the various phases of the life cycle of the device: from product identification, incoming acceptance and storage, to mounting, connection, operation and commissioning through to troubleshooting, maintenance and disposal


Supplementary device-dependent documentation

Additional documents are supplied depending on the device version ordered: Always comply strictly with the instructions in the supplementary documentation. The supplementary documentation is an integral part of the device documentation.

Field of Activities

-  Document FA00004P
Pressure measurement, powerful instruments for process pressure, differential pressure, level and flow

Special Documentation

-  Document SD01553P
Mechanical accessories for pressure measuring devices
The documentation provides an overview of available manifolds, oval flange adapters, pressure gauge valves, shutoff valves, siphons, condensate pots, cable shortening kits, test adapters, flushing rings, Block&Bleed valves and protective roofs.

Registered trademarks

HART®

Registered trademark of the FieldComm Group, Austin, Texas, USA

Bluetooth®

The Bluetooth® wordmark and logos are registered trademarks of Bluetooth SIG, Inc. and any use of these trademarks by Endress+Hauser is licensed. Other trademarks and trade names are those of their respective owners.





71521429

www.addresses.endress.com
