# Technical Information Deltabar M PMD55

# Differential pressure measurement





# Differential pressure transmitter with metal sensor

#### Application

The device is used for the following measuring tasks:

- Flow measurement (volume or mass flow) in conjunction with primary elements in gases, vapours and liquids
- Level, volume or mass measurement in liquids
- Differential pressure monitoring, e.g. of filters and pumps

#### Your benefits

- Very good reproducibility and long-term stability
- High reference accuracy: 0.10 % as PLATINUM version: up to 0.075 %
- Turn down up to 100:1
- Compact transmitter design
- Fast commissioning via DIP switches
- Uniform platform for differential pressure, hydrostatics and pressure (Deltabar M

   Deltapilot M Cerabar M)
- Simple, fast commissioning through a user interface designed for real-world applications
- Used for process pressure monitoring up to SIL 2, certified to IEC 61508 Edition 2.0 and IEC 61511 by TÜV NORD



# Table of contents

Document information         Document function         Symbols used         Documentation         Terms and abbreviations         Turn down calculation         Function and system design         Measuring principle         Level measurement (level, volume and mass)         Flow measurement         Communication protocol	6 7 <b>8</b> . 8
Input	<b>11</b> 11 11
Output . Output signal . Signal range 4 to 20 mA . Signal on alarm . Load - 420 mA HART . Damping . Firmware version . Protocol-specific data HART . Wireless HART data . Protocol-specific data PROFIBUS PA . Protocol-specific data FOUNDATION Fieldbus . Protocol-specific data FOUNDATION Fieldbus .	<ol> <li>12</li> <li>12</li> <li>12</li> <li>12</li> <li>12</li> <li>13</li> <li>13</li> <li>13</li> <li>14</li> </ol>
Power supply . Terminal assignment . Supply voltage . Current consumption . Electrical connection . Terminals . Cable entry . Device plugs . Cable specification . Start-up current . Residual ripple . Influence of power supply . Overvoltage protection (optional) .	<b>16</b> 16 17 17 17 17 18 19 19 19 19
Performance characteristics	21 21 21 23 23 23 24 26
InstallationGeneral installation instructionsMeasuring arrangementWall and pipe-mounting	<b>27</b> 27 27 28

Wall and pipe-mounting manifold (optional)Typical installation arrangementsOxygen applicationsPWIS cleaningUltrapure gas applications	28 29 30 30 30
Environment	<ul> <li>31</li> <li>31</li> <li>31</li> <li>31</li> <li>31</li> <li>31</li> <li>31</li> </ul>
Process	<b>32</b> 32 32 32
Mechanical construction	<b>33</b> 33 33 34
Dimensions H1 option; Impulse pipe horizontal; alignment 180°	35
Dimensions H2 option; Impulse pipe horizontal; alignment 90°	36 37 38 39 39 39
Operability Operating concept Local operation Operating languages Remote operation System integration	<b>40</b> 40 42 43 44
Certificates and approvals . CE mark . RoHS . RCM-Tick marking . Ex approvals . EAC conformity . Suitable for hygiene applications . Certificate of current Good Manufacturing Practices (cGMP) . Functional safety SIL .	<b>45</b> 45 45 45 45 45 45 45 46 46
CRN approvals	46 46 46 47 47

Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01	47 47 47 48 48
Ordering information	<b>49</b> 49 49 49 49
Additional documentation Field of Activities Technical Information Operating Instructions Brief operating instruction Functional safety manual (SIL) Safety instructions	<b>53</b> 53 53 53 53 53 53
Accessories . Manifolds . Additional mechanical accessories . Mounting bracket for wall and pipe mounting . M12 connector . Service-specific accessories .	<b>56</b> 56 56 56 56
Registered trademarks         HART <sup>®</sup> PROFIBUS <sup>®</sup> FOUNDATION <sup>TM</sup> Fieldbus	<b>56</b> 56 56 56

# **Document information**

**Document function** 

The document contains all the technical data on the device and provides an overview of the accessories and other products that can be ordered for the device.

#### Symbols used

#### Safety symbols

Symbol	Meaning
<b>A</b> DANGER	<b>DANGER!</b> This symbol alerts you to a dangerous situation. Failure to avoid this situation will result in seriousor fatal injury.
<b>WARNING</b>	<b>WARNING!</b> This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in seriousor fatal injury.
	<b>CAUTION!</b> This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in minoror medium injury.
NOTICE	<b>NOTICE!</b> This symbol contains information on procedures and other facts which do not result in personalinjury.

#### **Electrical symbols**

Symbol	Meaning	Symbol	Meaning
÷	<b>Protective ground connection</b> A terminal which must be connected to ground prior to establishing any other connections.	<u> </u>	<b>Ground connection</b> A grounded terminal which, as far as the operator is concerned, is grounded via a grounding system.

#### Symbols for certain types of information

Symbol	Meaning
$\checkmark$	<b>Permitted</b> Procedures, processes or actions that are permitted.
	<b>Preferred</b> Procedures, processes or actions that are preferred.
×	Forbidden Procedures, processes or actions that are forbidden.
i	Tip Indicates additional information.
	Reference to documentation
	Reference to page
	Reference to graphic
	Visual inspection

#### Symbols in graphics


Symbol	Meaning
1, 2, 3	Item numbers
1. , 2. , 3	Series of steps

Symbol	Meaning
A, B, C,	Views
A-A, B-B, C-C,	Sections

Documentation

See chapter "Additional documentation"  $\rightarrow \square 53$ 

The document types listed are available: In the Download Area of the Endress+Hauser Internet site: www.endress.com  $\rightarrow$  Download

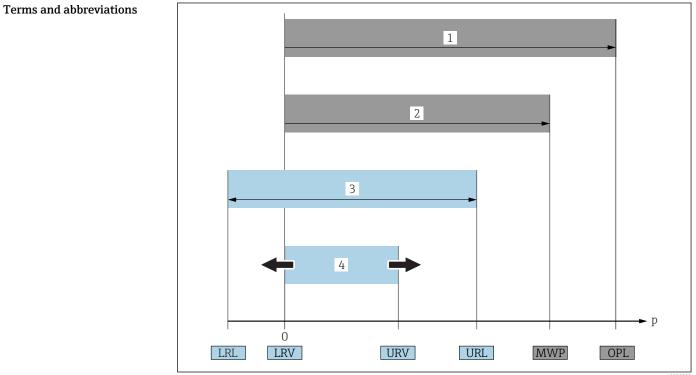


A00	029	950	)5

Item	Term/abbreviation	Explanation
1	OPL	The OPL (over pressure limit = sensor overload limit) for the measuring device depends on the lowest-rated element, with regard to pressure, of the selected components, i.e. the process connection has to be taken into consideration in addition to the measuring cell. Also observe pressure-temperature dependency. For the relevant standards and additional notes see the $\rightarrow \cong 32$ section. The OPL may only be applied for a limited period of time.
2	MWP	The MWP (maximum working pressure) for the sensors depends on the lowest-rated element, with regard to pressure, of the selected components, i.e. the process connection has to be taken into consideration in addition to the measuring cell. Also observe pressure-temperature dependency. For the relevant standards and additional notes see the $\rightarrow \cong 32$ section. The MWP may be applied at the device for an unlimited period. The MWP can also be found on the nameplate.
3	Maximum sensor measuring range	Span between LRL and URL This sensor measuring range is equivalent to the maximum calibratable/adjustable span.
4	Calibrated/adjusted span	Span between LRV and URV Factory setting: 0 to URL Other calibrated spans can be ordered as customized spans.
р	-	Pressure
-	LRL	Lower range limit
-	URL	Upper range limit
-	LRV	Lower range value
-	URV	Upper range value
-	TD (Turn down)	Turn down Example - see the following section.

Endress+Hauser


#### Turn down calculation

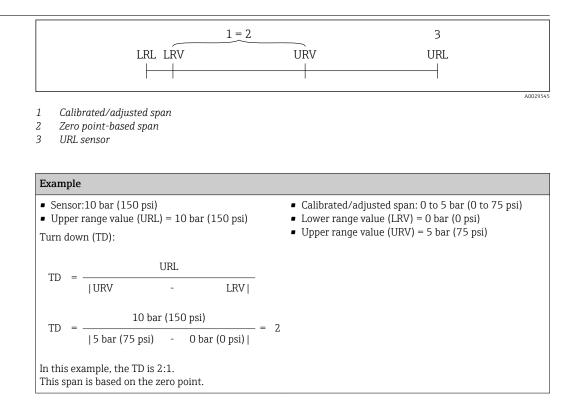

# Function and system design

#### Measuring principle


#### Metallic process isolating diaphragm

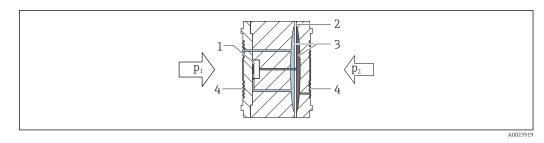

- 1 Sensing element
- 2 Overload diaphragm/Middle diaphragm
- 3 Filling oil
- 4 Process isolating diaphragm

The metal separating diaphragms (4) are deflected on both sides by the acting pressures p1 and p2. A filling oil (3) transfers the pressure to a resistance circuit bridge (semiconductor technology). The differential- pressure-dependent change of the bridge output voltage is measured and further processed.

# Level measurement (level, volume and mass)

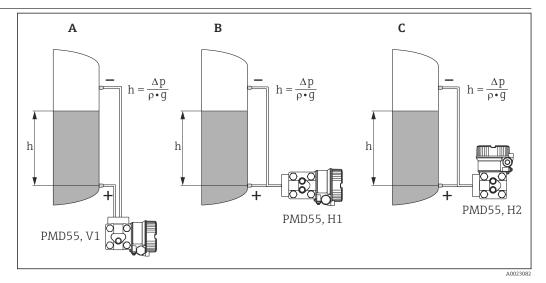


- *A Option V1; vertical impulse line; 90° alignment*
- B Option H1; horizontal impulse line; 180° alignment
- C Option H2; horizontal impulse line; 90° alignment
- h Height (level)
- $\Delta p$  Differential pressure
- $\rho$  Density of the medium
- g Gravitation constant

#### Your benefits

- Volume and mass measurements in any tank shapes by means of a freely programmable characteristic curve
- Choice of diverse level units
- Has a wide range of uses, even in the following cases:
  - for level measurement in tanks with superimposed pressure
  - in the event of foam formation
  - in tanks with agitators of screen fittings
  - in the event of liquid gases
  - for standard level measurement

Flow measurement

Flow measurement with Deltabar M PMD55 and primary element

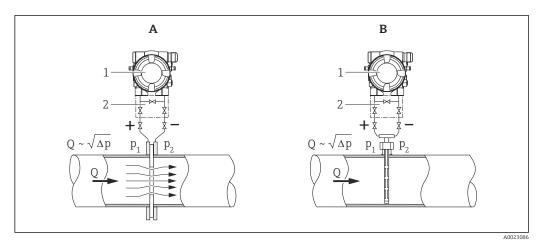


- A Orifice plate
- B Pitot tube
- 1 Deltabar M
- 2 3-valve manifold
- Q Flow
- $\Delta p$  Differential pressure,  $\Delta p = p_1 p_2$

#### Your benefits


- Choice between five flow modes of operation:
  - Volume flow
  - Norm volume flow (European norm conditions)
  - Standard volume flow (American standard conditions)
  - Mass flow
  - %
- Choice of diverse flow units with automatic unit conversion.
- Low flow cut off: when activated, this function suppresses small flows which can lead to large fluctuations in the measured value.
- Contains two totalizers as standard. One totalizer can be reset to zero.
- The totalizing unit can be individually set for each totalizer. This allows independent daily and annual quantity totalizing.

#### Typical arrangements for flow measurements

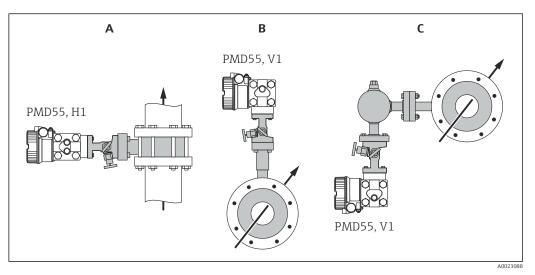

- A Liquid in vertical pipe; H1 option; horizontal impulse line; 180° alignment
- *B Gas in horizontal pipe;* V1 *option; vertical impulse line; 90° alignment*
- *C* Vapour in horizontal pipe; V1 option; vertical impulse line; 90° alignment

#### Mounting example

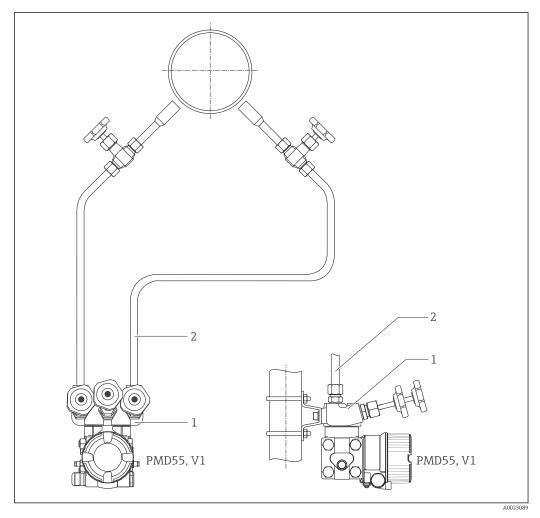

- Valve manifold 1 2
  - Impulse line

**Communication protocol** 

• 4 to 20 mA with HART communication protocol

- PROFIBUS PA
  - The Endress+Hauser devices meet the requirements of the FISCO model.
  - Due to a low current consumption of  $11 \text{ mA} \pm 1 \text{ mA}$ , the following number of devices can be operated on one bus segment if installing as per FISCO: up to 8 devices for Ex ia, CSA IS and FM IS applications or up to 31 devices for all other applications e.g. in non-hazardous areas, Ex nA etc. Further information on PROFIBUS PA can be found in Operating Instructions BA00034S "PROFIBUS DP/PA: Guidelines for planning and commissioning" and in the PNO Guideline.
- FOUNDATION Fieldbus
  - The Endress+Hauser devices meet the requirements of the FISCO model.
  - Due to a low current consumption of  $16 \text{ mA} \pm 1 \text{ mA}$ , the following number of devices can be operated on one bus segment if installing as per FISCO: up to 6 devices for Ex ia, CSA IS and FM IS applications or up to 22 devices for all other applications e.g. in non-hazardous areas, Ex nA etc. Further information on FOUNDATION Fieldbus, such as requirements for bus system components, can be found in Operating Instructions BA00013S "FOUNDATION Fieldbus Overview".

# Input

Measured variable

#### Measured process variables

Differential pressure, from which flow (volume or mass current) and level (level, volume or mass) are derived

#### Measuring range

Sensor	Maximum sensor measuring range		Smallest calibratable	libratable	OPL		Min. operating pressure <sup>2)</sup>	Option <sup>3)</sup>						
	lower (LRL)	upper (URL)	measuring span (preset at the factory) <sup>1)</sup>		on one side	on both sides								
[mbar (psi)]	[mbar (psi)]	[mbar (psi)]	[mbar (psi)]	[bar (psi)]	[bar (psi)]	[bar (psi)]	[mbar <sub>abs</sub> (psi <sub>abs</sub> )]							
10 (0.15)	-10 (-0.15)	+10 (+0.15)	0.5 (0.0075)	1 (15) <sup>4)</sup>	1 (15) <sup>4)</sup>	1.5 (22.5) <sup>4)</sup>	0.1 (0.0015) <sup>4)</sup>	7B						
30 (0.45)	-30 (-0.45)	+30 (+0.45)	1.5 (0.0225)				0.1 (0.0015)	7C						
100 (1.5)	-100 (-1.5)	+100 (+1.5)	5 (0.075)	70 (1050) <sup>5)</sup>	70 (1050) <sup>5)</sup>	105 (1575) <sup>5)</sup>		7D						
500 (7.5)	-500 (-7.5)	+500 (+7.5)	25 (0.375)	160 (2400) <sup>6)</sup> 160 (240	160 (2400) °	160 (2400) <sup>6)</sup>	240 (3600) <sup>6)</sup>		7F					
1000 (15)	-1000 (- 15)	+1000 (+ 15)	50 (0.75)							7G				
3000 (45)	-3000 (-45)	+3000 (+45)	150 (2.25)				0.1 (0.0015) <sup>5)</sup> 0.1 (0.0015) <sup>6)</sup>	7H						
16000 (240)	-16000 (-240)	+16000 (+240)	800 (12)										0.1 (0.0015)	7L
40000 (600)	-40000 (-600)	+40000 (+600)	2000 (30)					7M						

1) Recommended Turn down: Max 100:1. Factory calibration Turn down: Max 20:1

2) The minimum operating pressure indicated in the table applies to silicone oil under reference operating conditions. Minimum operating pressure at 85°C (185°F) for silicone oil: 10 mbar (0.15 psi) (abs)

3) Product Configurator, "Sensor Nominal Value" ordering feature

4) Option "2" in the Order Code - Feature 60

5) Option "6" in the Order Code - Feature 60

6) Option "7" in the Order Code - Feature 60

Nominal Pressure PN	Option <sup>1)</sup>
1 bar / 100 kPa/ 14.5 psi	2
70 bar / 7 MPa / 1015 psi	6
160 bar / 16 MPa / 2400 psi	7

1) Product Configurator "Nominal Pressure PN" ordering feature

Output         4 to 20mA HART         PROFIBUS PA         FOUNDATION Fieldbus         I)         Product Configurator, "Output" ordering feature         4 to 20 mA HART: 3.8 to 20.5 mA         As per NAMUR NE 43         4 to 20 mA HART: Options:         • Max. alarm: can be set from 21 to 23 mA (factory setting: 22 mA)         • Hold measured value: last measured value is held         • Min. alarm: 3.6 mA         • PROFIBUS PA: can be set in the Analog Input block         Options: Last Valid Out Value (factory setting), Fail-safe Value, Status         • FOUNDATION Fieldbus: can be set in the Analog Input block	Option <sup>1)</sup> 2 3 4
4 to 20mA HART         PROFIBUS PA         FOUNDATION Fieldbus         I)       Product Configurator, "Output" ordering feature         4 to 20 mA HART: 3.8 to 20.5 mA         As per NAMUR NE 43         4 to 20 mA HART: Options:         • Max. alarm: can be set from 21 to 23 mA (factory setting: 22 mA)         • Hold measured value: last measured value is held         • Min. alarm: 3.6 mA         • PROFIBUS PA: can be set in the Analog Input block         Options: Last Valid Out Value (factory setting), Fail-safe Value, Status         • FOUNDATION Fieldbus: can be set in the Analog Input block	2 3 4
FOUNDATION Fieldbus         I)       Product Configurator, "Output" ordering feature         II       Product Configurator, "Output" ordering feature         II       Image: A to 20 mA HART: 3.8 to 20.5 mA         II       As per NAMUR NE 43         II       Image: A to 20 mA HART: 3.8 to 20.5 mA         III       Image: A to 20 mA HART: 3.8 to 20.5 mA         IIII       Image: A to 20 mA HART: 0.00000000000000000000000000000000000	4
<ul> <li>Product Configurator, "Output" ordering feature</li> <li>A to 20 mA HART: 3.8 to 20.5 mA</li> <li>As per NAMUR NE 43</li> <li>4 to 20 mA HART: Options: <ul> <li>Max. alarm: can be set from 21 to 23 mA (factory setting: 22 mA)</li> <li>Hold measured value: last measured value is held</li> <li>Min. alarm: 3.6 mA</li> </ul> </li> <li>PROFIBUS PA: can be set in the Analog Input block Options: Last Valid Out Value (factory setting), Fail-safe Value, Status</li> <li>FOUNDATION Fieldbus: can be set in the Analog Input block</li> </ul>	
As per NAMUR NE 43 • 4 to 20 mA HART: 3.8 to 20.5 mA As per NAMUR NE 43 • 4 to 20 mA HART: Options: • Max. alarm: can be set from 21 to 23 mA (factory setting: 22 mA) • Hold measured value: last measured value is held • Min. alarm: 3.6 mA • PROFIBUS PA: can be set in the Analog Input block Options: Last Valid Out Value (factory setting), Fail-safe Value, Status • FOUNDATION Fieldbus: can be set in the Analog Input block	Bad
As per NAMUR NE 43 4 to 20 mA HART: Options: Max. alarm: can be set from 21 to 23 mA (factory setting: 22 mA) Hold measured value: last measured value is held Min. alarm: 3.6 mA PROFIBUS PA: can be set in the Analog Input block Options: Last Valid Out Value (factory setting), Fail-safe Value, Status FOUNDATION Fieldbus: can be set in the Analog Input block	Bad
<ul> <li>4 to 20 mA HART: Options:</li> <li>Max. alarm: can be set from 21 to 23 mA (factory setting: 22 mA)</li> <li>Hold measured value: last measured value is held</li> <li>Min. alarm: 3.6 mA</li> <li>PROFIBUS PA: can be set in the Analog Input block Options: Last Valid Out Value (factory setting), Fail-safe Value, Status</li> <li>FOUNDATION Fieldbus: can be set in the Analog Input block</li> </ul>	Bad
<ul> <li>Options:</li> <li>Max. alarm: can be set from 21 to 23 mA (factory setting: 22 mA)</li> <li>Hold measured value: last measured value is held</li> <li>Min. alarm: 3.6 mA</li> <li>PROFIBUS PA: can be set in the Analog Input block</li> <li>Options: Last Valid Out Value (factory setting), Fail-safe Value, Status</li> <li>FOUNDATION Fieldbus: can be set in the Analog Input block</li> </ul>	Bad
Options: Last Good Value, Fail-safe Value (factory setting), Wrong Val	ue
Rimay	
$\left[\Omega\right]_{1456}^{1}_{1239}^{1}_{1456}^{1}_{1239}^{1}_{1456}^{1}_{1239}^{1}_{156}^{1}_{1239}^{1}_{156}^{1}_{156}^{1}_{123}^{1}_{1}_{156}^{1}_{1}_{156}^{1}_{1}_{1}_{1}_{1}_{2}_{1}_{1}_{1}_{1}_{1}_{1}_{2}_{1}_{1}_{1}_{1}_{1}_{1}_{1}_{1}_{2}_{1}_{1}_{1}_{1}_{1}_{1}_{1}_{1}_{1}_{1$	
<ul> <li>When operating via a handheld terminal or via a PC with an operat communication resistance of 250 Ω must be taken into account.</li> <li>A damping affects all outputs (output signal, display):</li> <li>Via on-site display, handheld terminal or PC with operating program, or the site of the site o</li></ul>	
	$\frac{1456}{1239}$ $\frac{14}{9}$ $\frac{14}{9}$ $\frac{14}{9}$ $\frac{12}{9}$ $\frac{12}{9}$ $\frac{12}{9}$ $\frac{11}{9}$ $11$

Firmware version	Designation	Option <sup>1)</sup>
	01.00.zz, FF, DevRev01	76
	01.00.zz, PROFIBUS PA, DevRev01	77
	01.00.zz, HART, DevRev01	78

#### 1) Product Configurator, "Firmware version" ordering feature

#### Protocol-specific data HART Manufacturer ID 17 (11 hex) Device Type Code 23 (17 hex) Device Revision 01 (01 hex) - SW version 01.00.zz HART specification 6 DD Revision • 01 (Dutch)) 02 (Russian)) Device description files (DTM, DD) Information and files can be found: www.endress.com www.fieldcommgroup.org HART load Min. 250 Ω HART device variables The measured values can be freely assigned to the device variables: Measured values for PV (primary variable) Pressure Flow Level Tank content Measured values for SV, TV (second and third variable) Pressure Totalizer Level Supported functions Burst mode Additional Transmitter Status Device Locking Alternative operating modes

#### Wireless HART data

Minimum starting voltage	11.5 V <sup>1)</sup>
Start-up current	12 mA (default) or 22 mA (customer setting)
Starting time	5 s
Minimum operating voltage	11.5 V <sup>1)</sup>
Multidrop current	4 mA
Time for connection setup	1 s

1) Or higher if operating near ambient temperature limits (-40 to +85 °C (-40 to +185))

Protocol-specific data PROFIBUS PA	Manufacturer ID	17 (11 hex)
PROFIBUS PA	Ident number	1542 hex
	Profile Version	3.02 SW Version 01.00.zz
	GSD Revision	5
	DD Revision	1
	GSD File	Information and files can be found:
	DD Files	<ul><li>www.endress.com</li><li>www.profibus.org</li></ul>

Output values	Measured values for PV (via Analog Input Function Block) Pressure Level Flow Tank content
	Measured values for SV Pressure
	<b>Measured values for QV</b> Totalizer
Input values	Input value sent from PLC, can be shown on display
Supported functions	<ul> <li>Identification &amp; Maintenance Simple device identification via control system and nameplate</li> <li>Condensed status</li> <li>Automatic ident number adaptation and switchable to following ident numbers:</li> <li>9700: Profile-specific transmitter identification number with the "Classic" or "Condensed" status.</li> <li>1554: Identification number for Deltabar M</li> <li>Device locking: The device can be locked by hardware or software.</li> </ul>

#### Protocol-specific data FOUNDATION Fieldbus

Device Type	0x1021
Device Revision	01 (hex)
DD Revision	0x01021
Device description files (DTM, DD)	Information and files can be found:
	<ul><li>www.endress.com</li><li>www.fieldcommgroup.org</li></ul>
CFF Revision	0x000102
ITK Version	5.2.0
ITK-Certification Driver-No.	IT067600
Link-Master (LAS) capable	yes
Link Master / Basic Device selectable	Yes; Factory setting: Basic Device
Number of VCRs	44
Number of Link Objects in VFD	50
Number of FB-Schedule Objects	40

#### Virtual communication references (VCRs)

Permanent Entries	44
Client VCRs	0
Server VCRs	5
Source VCRs	8
Sink VCRs	0
Subscriber VCRs	12
Publisher VCRs	19

#### Link settings

Slot time	4
Min. Inter PDU delay	12
Max. response delay	40

#### **Transducer Blocks**

Block	Content	Output values
TRD1 Block	Contains all parameters related to the measurement	<ul> <li>Pressure, Flow or level (channel 1)</li> <li>Process temperature (channel 2)</li> <li>Measured pressure value (channel 3)</li> <li>Max. pressure (channel 4)</li> <li>Level before linearization (channel 5)</li> </ul>
Dp Flow Block	Contains flow and totalizer parameters	<ul><li>Totalizer 1 (channel 6)</li><li>Totalizer 2 (channel 7)</li></ul>
Diagnostic Block	Contains diagnostic information	Error code via DI channels (channel 10 to 15)
Display Block	Contains parameters to configure the onsite display	No output values

#### **Function blocks**

Block	Content	Number of blocks	Execution time	Functionality
Resource Block	source Block The Resource Block contains all the data that uniquely identify the device. It is an electronic version of a nameplate of the device.			enhanced
Analog Input Block 1 Analog Input Block 2	lock 1channel number) and makes the data available to other function blocks at its output.nalog InputEnhancement: digital outputs for process alarms, fail safe mode.		25 ms	enhanced
Digital Input Block	This block contains the discrete data of the Diagnose Block (selectable via a channel number 10 to 15) and provides them for other blocks at the output.	1	20 ms	standard
Digital Output Block	i i i		20 ms	standard
PID Block The PID Block serves as a proportional-integralderivative controller and is used almost universally for closed-loop-control in the field including cascade and feedforward. Input IN can be indicated on the display. The selection is performed in the Display Block (DISPLAY_MAIN_LINE_CONTENT).		1	40 ms	standard
Arithmetic Block	hmetic Block This block is designed to permit simple use of popular measurement math functions. The user does not have to know how to write equations. The math algorithm is selected by name, chosen by the user for the function to be performed.		35 ms	standard
Input Selector Block The Input Selector Block facilitates the selection of up to four inputs and generates an output based on the configured action. This block normally receives its inputs from AI Blocks. The block performs maximum, minimum, average and 'first good' signal selection. Inputs IN1 to IN4 can be indicated on the display. The selection is performed in the Display Block (DISPLAY_MAIN_LINE_1_CONTENT).		1	30 ms	standard
Signal Characterizer Block	haracterizer linear function of the respective input. The non-linear function is generated by a single		40 ms	standard
ntegrator Block The Integrator Block integrates a variable as a function of the time or accumulates the counts from a Pulse Input Block. The block may be used as a totalizer that counts up until reset or as a batch totalizer that has a setpoint, where the integrated or accumulated value is compared to pre-trip and trip settings, generating a binary signal when the setpoint is reached.		1	35 ms	standard

Additional function block information:

Instantiate Function Block	YES
Number of additional instantiatable function blocks	20


# **Power supply**

#### **WARNING**

#### An incorrect connection compromises electrical safety!

- ▶ When using the measuring device in hazardous areas, the relevant national standards and regulations as well as the Safety Instructions or Installation or Control Drawings must be observed  $\rightarrow \blacksquare 53$ .
- ► All explosion protection data are given in separate documentation which is available upon request. The Ex documentation is supplied as standard with all Ex-systems  $\rightarrow \square$  53.
- In accordance with IEC/EN61010 a suitable circuit breaker must be provided for the device. HART: Overvoltage protection HAW569-DA2B for the non-hazardous area, ATEX II 2 (1) Ex ia
- IIC and IEC Ex ia can be ordered as an option (see the "Ordering information" section).
- Protective circuits against reverse polarity, HF influences and overvoltage peaks are installed. ►

# Terminal assignment

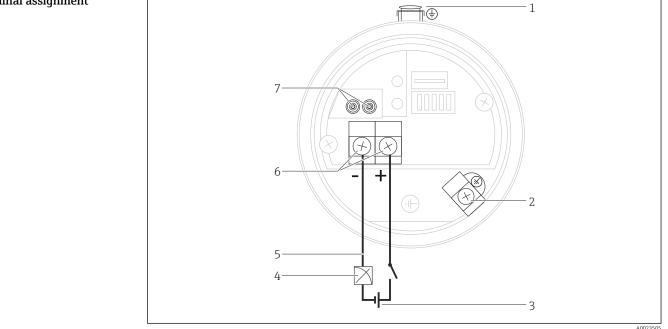

- External grounding terminal (only for devices with certainly approvals or if "Measuring point" (TAG) is 1 ordered)
- 2 Internal grounding terminal
- 3 Supply voltage  $\rightarrow \square 16$
- 4...20 mA for HART devices 4
- For HART and FOUNDATION Fieldbus devices: With a handheld terminal, all the parameters can be 5 configured anywhere along the bus line via menu operation.
- Terminals 6
- For HART devices: test terminals, see section "Taking 4 to 20 mA test signal"  $\rightarrow \square 16$ 7

#### Supply voltage

#### 4 to 20 mA HART

Type of protection	Supply voltage
Intrinsically safe	11.5 to 30 V DC
<ul><li>Other types of protection</li><li>Devices without certificate</li></ul>	11.5 to 45 V DC (versions with plug-in connection 35 V DC)

#### Taking 4 to 20 mA test signal

A 4 to 20 mA test signal may be measured via the test terminals without interrupting the measurement.

#### PROFIBUS PA

Version for non-hazardous areas: 9 to 32 V DC

**Electrical connection** 

#### FOUNDATION Fieldbus

Version for non-hazardous areas: 9 to 32 V DC

Current consumption	<ul> <li>PROFIBUS PA: 11 mA ±1 mA, switch-on current corresponds to IEC 61158-2, Clause 21</li> </ul>
	FOUNDATION Fieldbus: 16 mA ±1 mA, switch-on current corresponds to IEC 61158-2, Clause 21

#### Option 1) Cable entry Degree of protection M20 gland IP66/67 NEMA 4X/6P A M20 thread IP66/67 NEMA 4X/6P В G 1/2" thread С IP66/67 NEMA 4X/6P NPT ½" thread IP66/67 NEMA 4X/6P D M12 plug IP66/67 NEMA 4X/6P Ι 7/8" plug IP66/67 NEMA 4X/6P М Ρ HAN7D plug 90 deg IP65 V IP64 M16 valve connector

1) Product Configurator, order code for "Electrical connection"

#### PROFIBUS PA

The digital communication signal is transmitted over the bus via a 2-wire connection. The bus also provides the power supply. For further information on the network structure and grounding, and for further bus system components such as bus cables, see the relevant documentation, e.g. Operating Instructions BA00034S "PROFIBUS DP/PA: Guidelines for planning and commissioning" and the PNO Guideline.

#### **FOUNDATION Fieldbus**

The digital communication signal is transmitted over the bus via a 2-wire connection. The bus also provides the power supply. For further information on the network structure and grounding and for further bus system components such as bus cables, see the relevant documentation, e.g. Operating Instructions BA00013S "FOUNDATION Fieldbus Overview" and the FOUNDATION Fieldbus Guideline.

#### Terminals


- Supply voltage and internal ground terminal: 0.5 to 2.5 mm<sup>2</sup> (20 to 14 AWG)
- External ground terminal: 0.5 to 4 mm<sup>2</sup> (20 to 12 AWG)

Cable entry	Approval	Туре	Clamping area
	Standard, II1/2G Exia, IS	Plastic M20x1.5	5 to 10 mm (0.2 to 0.39 in)
	ATEX II1/2D, II1/2GD Exia, II3G Ex nA	Metal M20x1.5 (Ex e)	7 to 10.5 mm (0.28 to 0.41 in)

For other technical data, see the housing section

#### Device plugs

#### Devices with valve connector (HART)

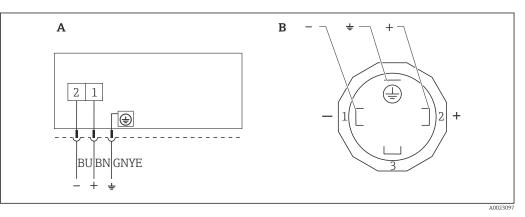


I BN = brown, BU = blue, GNYE = green

A Electrical connection for devices with valve connector

*B* View of the plug connector at the device

#### Material: PA 6.6

#### Devices with Harting plug Han7D (HART)

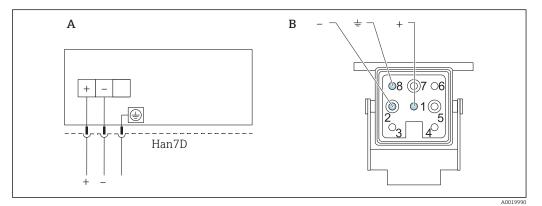


A Electrical connection for devices with Harting plug Han7D

*B* View of the plug-in connector at the device

Material: CuZn, contacts for plug-in jack and connector are gold-plated

#### Devices with M12 plug(Analog, HART, PROFIBUS PA)

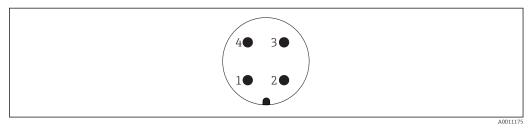

- 1 Signal +
- 2 Not assigned
- 3 Signal -
- 4 Ground

Endress+Hauser offers the following accessories for devices with an M12 plug:

Plug-in jack M 12x1, straight

- Material: body PA; coupling nut CuZn, nickel-plated
- Degree of protection (fully locked): IP66/67
- Order number: 52006263


Plug-in jack M 12x1, elbowed

- Material: body PBT/PA; coupling nut GD-Zn, nickel-plated
- Degree of protection (fully locked): IP66/67
- Order number: 71114212

Cable 4x0.34 mm<sup>2</sup> (20 AWG) with M12 socket, elbowed, screw plug, length 5 m (16 ft)

- Material: body PUR; coupling nut CuSn/Ni; cable PVC
- Degree of protection (fully locked): IP66/67
- Order number: 52010285

#### Devices with 7/8" plug (Analog, HART, FOUNDATION Fieldbus)

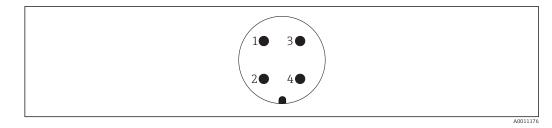

- 1 Signal -
- 2 Signal +
- 3 Not assigned
- 4 Shield

HART

External thread: 7/8 - 16 UNC

- Material: 316L (1.4401)
- Protection: IP66/68

#### Cable specification

- Endress+Hauser recommends using twisted, shielded two-wire cables.
- The cable outer diameter depends on the cable entry used.

#### PROFIBUS PA

Use a twisted, shielded two-wire cable, preferably cable type A

For further information on the cable specifications, see Operating Instructions BA00034S "PROFIBUS DP/PA: Guidelines for planning and commissioning", the PNO Guideline 2.092 PROFIBUS PA User and Installation Guideline" and IEC 61158-2 (MBP).


#### **FOUNDATION Fieldbus**

Use a twisted, shielded two-wire cable, preferably cable type A For further information on the cable specifications, see Operating Instructions BA00013S "FOUNDATION Fieldbus Overview", FOUNDATION Fieldbus Guideline and IEC 61158-2 (MBP). Start-up current 12 mA or 22 mA (selectable) **Residual ripple** No influence on 4 to 20 mA signal up to ±5 % residual ripple within the permitted voltage range [according to HART hardware specification HCF\_SPEC-54 (DIN IEC 60381-1)]. Influence of power supply ≤0.001 % of URV/V The device can be fitted with overvoltage protection. The overvoltage protection is mounted at the **Overvoltage** protection factory on the housing thread (M20x1.5) for the cable gland and is approx. 70 mm (2.76 in) in (optional) length (take additional length into account when installing). The device is connected as illustrated in the following graphic. For details refer to TI01013KDE, XA01003KA3 and BA00304KA2.

#### Ordering information:

Product Configurator, "Mounted accessories" ordering feature, option NA

#### Wiring

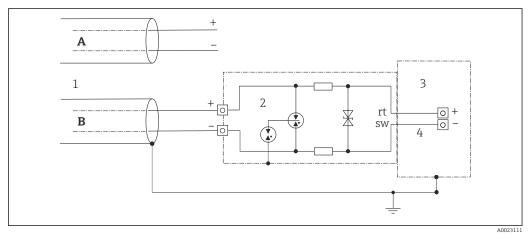

- Without direct shield grounding With direct shield grounding Incoming connection cable HAW569-DA2B Α
- В
- 1
- 2
- 3 Unit to be protected
- Connection cable 4

Response time	HART				
	<ul> <li>Acyclic: min. 330 ms, typically 590 ms (depending on command # and number of preambles)</li> <li>Cyclic (burst): min. 160 ms, typically 350 ms (depending on command # and number of preambles)</li> </ul>				
	PROFIBUS PA				
	<ul> <li>Acyclic: approx. 23 ms to 35 ms (depending on Min. Slave Interval)</li> <li>Cyclic: approx. 8 ms to 13 ms (depending on Min. Slave Interval)</li> </ul>				
	FOUNDATION Fieldbus				
	<ul> <li>Acyclic: typically 70 ms (for standard bus parameter settings)</li> <li>Cyclic: max. 20 ms (for standard bus parameter settings)</li> </ul>				
Reference operating conditions	• As per IEC 60770-1 and IEC 61298-1, Sections 5 to 7 • Ambient temperature $T_A$ = constant, in the range of +21 to +33 °C (+70 to +91 °F) • Humidity $\varphi$ = constant, in the range: 5 to 80 % RH ± 5 % • Ambient pressure $p_A$ = constant, in the range: 860 to 1060 mbar (12.47 to 15.37 psi) • Position of the measuring cell: constant, in range: ±1° horizontally and ±1° vertically • P1 = high pressure side • Input of "Lo Trim Sensor" and "Hi Trim Sensor" for lower range value and upper range value • Measuring span URV - LRV • Membrane material 316L • Filling oil: silicone oil • Side flanges material: AISI 316L • Supply voltage: 24 V DC ±3 V DC • Load with HART: 250 $\varphi$				
Maximum measured error total performance)	The performance characteristics refer to the accuracy of the measuring device. The factors influencing accuracy can be divided into two groups <ul> <li>Total performance of measuring device</li> <li>Installation factors</li> </ul>				
	All performance characteristics are in conformance with $\geq \pm 3$ sigma.				
	The total performance of the measuring device comprises the reference accuracy and the ambient temperature effect and is calculated using the following formula:				
	Total performance = $\pm \sqrt{((E1)^2 + (E2)^2 + (E3)^2)}$				
	E1 = Reference accuracy				
	$E2 = Temperature effect per \pm 28 °C (50 °F)$				
	(corresponds to the range from –3 to +53 $^\circ$ C (+27 to +127 $^\circ$ F))				
	Calculation of E2:				
	$E2 = E2_M + E2_E$				
	$E2_{M}$ = Main temperature error				
	$E2_E = Electronics$ error				
	E3 = Static pressure effect				
	<ul> <li>The values apply for process isolating diaphragm made of 316L (1.4435)</li> <li>The values refer to the calibrated span</li> </ul>				

# Performance characteristics

#### Reference accuracy [E1]

Reference accuracy comprises the non-linearity [IEC 62828-1 / DIN EN 61298-2] including the hysteresis [IEC 62828-1 / DIN EN 61298-2] and the non-repeatability [IEC 62828-1 / DIN EN 61298-2] in accordance with the limit point method as per [IEC 62828-1 / DIN EN 60770-2].

10 mbar (0.15 psi) and 30 mbar (0.45 psi) sensor

■ Standard: TD 1:1 = ±0.2 %; TD > 1:1 = ±0.2 % · TD

Platinum: -

- 100 mbar (1.5 psi) sensor
- Standard: TD 1:1 to TD 4:1 = ±0.1 %; TD > 4:1 = ±(0.012 % · TD + 0.052 %)
- Platinum: TD 1:1 to TD 4:1 = ±0.075 %; TD > 4:1 = ±(0.012 % · TD + 0.027 %)
- 500 mbar (7.5 psi), 1 bar (15 psi), 3 bar (45 psi), 16 bar (240 psi) and 40 bar (600 psi) sensor
- Standard: TD 1:1 to TD 10:1 = ±0.1 %; TD > 10:1 = ±(0.0015 % · TD + 0.085 %)
- Platinum: TD 1:1 to TD 10:1 = ±0.075 %; TD > 10:1 = ±(0.0015 % · TD + 0.060 %)

#### Temperature effect [E2]

#### $E2_M$ - Main temperature error

The output changes due to the effect of the ambient temperature [IEC 62828-1 / IEC 61298-3] with respect to the reference temperature [IEC 62828-1 / DIN 16086]. The values specify the maximum error due to min./max. ambient or process temperature conditions.

10 mbar (0.15 psi) and 30 mbar (0.45 psi) sensor

- Standard: ±(0.31 % · TD + 0.5 %)
- Platinum: -

100 mbar (1.5 psi) sensor

- Standard: ±(0.18 % · TD + 0.02 %)
- Platinum: ±(0.18 % · TD + 0.02 %)
- 500 mbar (7.5 psi), 1 bar (15 psi) and 3 bar (45 psi) sensor
- Standard: ±(0.08 % · TD + 0.05 %)
- Platinum: ±(0.08 % · TD + 0.05 %)
- 16 bar (240 psi) sensor
- Standard: ±(0.1 % · TD + 0.1 %)
- Platinum: ±(0.1 % · TD + 0.1 %)

40 bar (600 psi) sensor

- Standard: ±(0.08 % · TD + 0.05 %)
- Platinum: ±(0.08 % · TD + 0.05 %)

E2<sub>E</sub> - Electronics error

- Analog output (4 to 20 mA): 0.2 %
- Digital output (HART/PA/FF): 0 %

#### *E3<sub>M</sub>* - *Main static pressure error*

The static pressure effect refers to the effect on the output due to changes in the static pressure of the process (difference between the output at each static pressure and the output at atmospheric pressure [IEC 62828-2 / IEC 61298-3] and therefore the combination of the influence of the operating pressure on the zero point and the span).

10 mbar (0.15 psi) sensor

Standard

- Influence on the zero point: ± 0.20 % · TD per 1 bar (14.5 psi)
- Influence on the span: ± 0.20 % per 1 bar (14.5 psi)

30 mbar (0.45 psi) sensor

Standard

- Influence on the zero point: ± 0.07 % · TD per 1 bar (14.5 psi)
- Influence on the span: ± 0.07 % per 1 bar (14.5 psi)

- 100 mbar (1.5 psi) sensor
- Standard
  - Influence on the zero point: ± 0.15 % · TD per 70 bar (1015 psi)
  - Influence on the span: ± 0.14 % per 70 bar (1015 psi)
- Platinum
  - Influence on the zero point: ± 0.15 % · TD per 70 bar (1015 psi)
  - Influence on the span: ± 0.14 % per 70 bar (1015 psi)

500 mbar (7.5 psi), 1 bar (15 psi), 3 bar (45 psi), 16 bar (240 psi) and 40 bar (600 psi) sensor

- Standard
  - Influence on the zero point:  $\pm 0.075 \% \cdot \text{TD}$  per 70 bar (1015 psi)
  - Influence on the span:  $\pm 0.14$  % per 70 bar (1015 psi)
- Platinum
  - Influence on the zero point: ± 0.075 % · TD per 70 bar (1015 psi)
  - Influence on the span:  $\pm 0.14$  % per 70 bar (1015 psi)

#### Calculation of the total performance with the Endress+Hauser Applicator

Detailed measured errors, such as for other temperature ranges, for example, can be calculated with the Applicator "Sizing Pressure Performance".



Resolution

Current output: 1 μA

• Display: can be set (factory setting: presentation of the maximum accuracy of the transmitter)


Total error

The total error of the measuring device comprises the total performance and the influence of long-term stability and is calculated using the following formula:

Total error = total performance + long-term stability

#### Calculation of the total error with the Endress+Hauser Applicator

Detailed measured errors, such as for other temperature ranges, for example, can be calculated with the Applicator "Sizing Pressure Performance".

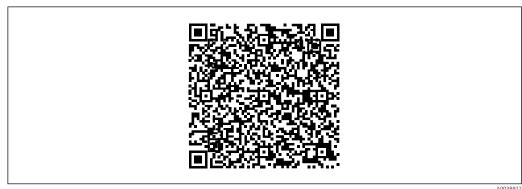

#### Long-term stability

10 mbar (0.15 psi) and 30 mbar (0.45 psi) sensor

- 1 year: ± 0.25 %
- 5 years: ± 1.25 %
- 10 years: ± 1.50 %

100 mbar (1.5 psi) sensor


- 1 year: ± 0.18 %
- 5 years: ± 0.35 %
- 10 years: ± 0.50 %

500 mbar (7.5 psi), 1 bar (15 psi), 3 bar (45 psi), 16 bar (240 psi) and 40 bar (600 psi) sensor

- 1 year: ± 0.05 %
- 5 years: ± 0.13 %
- 10 years: ± 0.23 %

#### Response time T63 and T90 Dead time, time constant

Presentation of the dead time and the time constant:

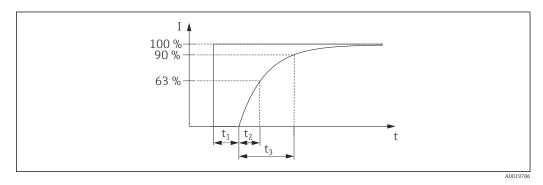

#### Dynamic behavior, current output (HART electronics)

	Dead time (t <sub>1</sub> )	Time constant T63 (= $t_2$ )	Time constant T90 (= $t_3$ )
Max.	60 ms	90 ms	210 ms

#### Dynamic behavior, digital output (HART electronics)

	Dead time (t <sub>1</sub> )	Dead time (t <sub>1</sub> ) + Time constant T63 (= t <sub>2</sub> )	Dead time (t <sub>1</sub> ) + Time constant T90 (= t <sub>3</sub> )
Min.	220 ms	310 ms	370 ms
Max.	1020 ms	1110 ms	1170 ms

#### Reading cycle

- Acyclic: max. 3/s, typical 1/s (depends on command # and number of preambles)
- Cyclic (burst): max. 3/s, typical 2/s

The device commands the BURST MODE function for cyclic value transmission via the HART communication protocol.

#### Cycle time (update time)

Cyclic (burst): min. 300 ms

#### Dynamic behavior, PROFIBUS PA

	Dead time (t <sub>1</sub> )	Dead time (t <sub>1</sub> ) + Time constant T63 (= t <sub>2</sub> )	Dead time (t <sub>1</sub> ) + Time constant T90 (= t <sub>3</sub> )
Min.	95 ms	185 ms	245 ms
Max.	1195 ms	1285 ms	1345 ms

Reading cycle (SPS)

- Acyclic: typically 25/s
- Cyclic: typically 30/s (dependent on the number and type of function blocks used in a closedcontrol loop)

Cycle time (update time)

Min. 100 ms

The cycle time in a bus segment in cyclic data communication depends on the number of devices, on the segment coupler used and on the internal PLC cycle time.

#### Dynamic behavior, FOUNDATION Fieldbus

	Dead time (t <sub>1</sub> )	Dead time (t <sub>1</sub> ) + Time constant T63 (= t <sub>2</sub> )	Dead time (t <sub>1</sub> ) + Time constant T90 (= t <sub>3</sub> )
Min.	105 ms	195 ms	255 ms
Max.	1105 ms	1195 ms	1255 ms

Reading cycle

- Acyclic: typically 5/s
- Cyclic: max. 10/s (dependent on the number and type of function blocks used in a closed-control loop)

Cycle time (update time)


Cyclic: min. 100 ms

#### Installation factors

#### Influence of the installation position

The recommended maximum angle to the axis of the diaphragm is  $10^{\circ}$  and results in a measuring error of  $\pm 0.72$  mbar (0.01 psi). The value is doubled for devices with inert oil.

Position-dependent zero point shift can be corrected  $\rightarrow \cong 27$ .

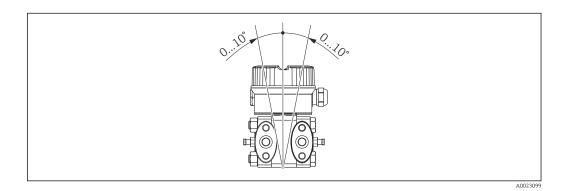

#### Vibration effects

Test standard	Vibration effects
<ul> <li>GL VI-7-2</li> <li>Part 7: Guidelines for the Performance of Type Approvals</li> <li>Chapter 2: Test Requirements for Electrical /Electronic Equipment and Systems</li> </ul>	Guaranteed for 5 to 25 Hz: ±1.6 mm (0.06 in); 25 to 100 Hz: 4 g in all 3 axes
IEC 61298-3 IEC 60068-2-6	$\leq$ reference accuracy to 10 to 60 Hz: ±0.35 mm (0.01 in); 60 to 2000 Hz: 5 g in all 3 axes

#### Warm-up period


- 4 to 20 mA HART: ≤5 s
- PROFIBUS PA: ≤8 s
- FOUNDATION Fieldbus: ≤20 s (after a TOTAL reset ≤45 s)

General installation instructions	The position-dependent zero point shift can be corrected: • directly at the device via operating keys on the electronic insert • directly at the device via operating keys on the display • via digital communication if the cover is not open.				
	<ul> <li>Endress+Hauser offers a mounting bracket for installing the device on pipes or walls.</li> <li>When measuring in media with solid proportions, such as dirty liquids, installing separators and drain valves is useful for capturing and removing sediment.</li> <li>Using a three-valve or five-valve manifold allows for easy commissioning, installation and maintenance without interrupting the process.</li> <li>General recommendations for the impulse piping can be found in DIN 19210 "Methods for measurement of fluid flow; differential piping for flow measurement devices" or the corresponding national or international standards.</li> <li>Install the impulse piping with a continuous gradient of at least 10 %.</li> <li>When routing the impulse piping outdoors, ensure that sufficient anti-freeze protection is used, e.g. by using pipe heat tracing.</li> </ul>				
Measuring arrangement	Flow measurement				
	<ul> <li>Measuring arrangement for gases: Mount device above the measuring point.</li> <li>Measuring arrangement for liquids and vapours: Mount the device below the measuring point.</li> <li>For flow measurement in vapours, mount the condensate traps at the same level as the same the tapping point and at the same distance from Deltabar M.</li> </ul>				
	Level measurement				
	Measuring arrangement level measurement in open tanks Mount device below the lower measuring connection. The low-pressure side is open to atmosphere pressure.				
	<ul> <li>Measuring arrangement level measurement in closed tanks and closed tanks with superimposed vapor</li> <li>Mount device below the lower measuring connection. Always connect the low-pressure side above the maximum level.</li> <li>In the case of level measurement in closed tanks with superimposed vapor, a condensate trap ensures pressure which remains constant on the low-pressure side.</li> </ul>				
	Pressure measurement				
	<ul> <li>Measuring arrangement for gases: Mount device above the measuring point.</li> <li>Measuring arrangement for liquids and vapours: Mount the device below the measuring point.</li> <li>For differential pressure measurement in vapor, mount the condensate traps at the same level as the same the tapping point and at the same distance from Deltabar M.</li> </ul>				

# Installation

#### Wall and pipe-mounting

Endress+Hauser offers the following mounting brackets for installing the device on pipes or walls:

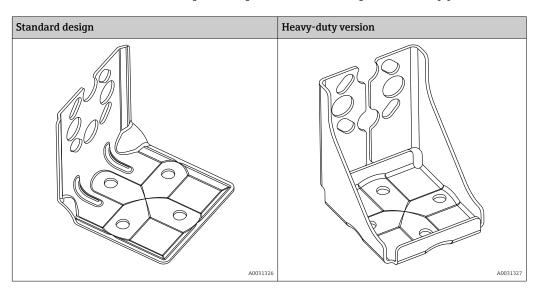

The standard mounting bracket version is **not** suitable for use in an application subject to vibrations.

The vibration resistance of the heavy-duty version of the mounting bracket has been tested according to IEC 61298-3, see the "Vibration resistance" section  $\rightarrow \cong$  31.

When using a valve block, the block's dimensions must be taken into account.

Bracket for wall and pipe mounting including retaining bracket for pipe mounting and two nuts.

Technical data (e.g. dimensions or order numbers for screws) see accessory document SD01553P/00/EN.

Ordering information:

- Standard design: Product Configurator "Accessory Enclosed" ordering feature, version "PD"
- Heavy-duty version: Product Configurator, order code for "Accessories enclosed" option "PB"
- The adapter plate is part of the delivery if the order option "PB" or "PD" was selected in combination with the variant V1 or H2 from the process connection.


# Wall and pipe-mounting manifold (optional)

Technical data (e.g. dimensions or order numbers for screws) see accessory document SD01553P/00/EN.

Ordering information:

Product Configurator, order code for "Accessories enclosed", option "PJ"

#### Typical installation arrangements

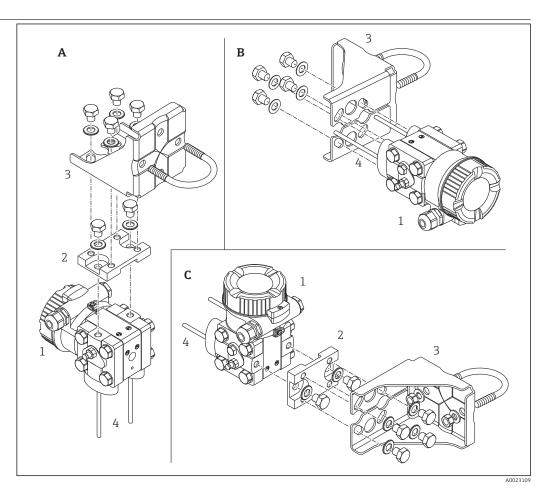

- Α
- Impulse line vertical, version V1, alignment 90° Impulse line horizontal, version H1, alignment 180°
- B C *Impulse line horizontal, version H2, alignment 90°*
- 1 . Deltabar M
- 2
- Adapter plate Mounting bracket 3
- 4 Pressure line

Position	Process connection	Gland	Installation	Material	Option <sup>1) 2)</sup>
А	NPT1/4-18 IEC61518	UNF7/16-20	Impulse line vertical, version V1, alignment 90°	1.4408 / CF3M <sup>3)</sup> / AISI 316L	HAJ
	NPT1/4-18 IEC61518	UNF7/16-20	Impulse line vertical, version V1, alignment 90°	C22.8	HA4
	NPT1/4-18 IEC61518	M10	Impulse line vertical, version V1, alignment 90°	1.4408 / CF3M <sup>3)</sup> / AISI 316L	HBJ
	NPT1/4-18 IEC61518	M10	Impulse line vertical, version V1, alignment 90°	C22.8	HB4
В	NPT1/4-18 IEC61518	UNF7/16-20	Impulse line horizontal, version H1, alignment 180°	1.4408 / CF3M <sup>3)</sup> / AISI 316L	HGJ
	NPT1/4-18 IEC61518	UNF7/16-20	Impulse line horizontal, version H1, alignment 180°	C22.8	HG4
	NPT1/4-18 IEC61518	M10	Impulse line horizontal, version H1, alignment 180°	1.4408 / CF3M <sup>3)</sup> / AISI 316L	ННЈ
	NPT1/4-18 IEC61518	M10	Impulse line horizontal, version H1, alignment 180°	C22.8	HH4
С	NPT1/4-18 IEC61518	UNF7/16-20	Impulse line horizontal, version H2, alignment 90°	1.4408 / CF3M <sup>3)</sup> / AISI 316L	HNJ
	NPT1/4-18 IEC61518	UNF7/16-20	Impulse line horizontal, version H2, alignment 90°	C22.8	HN4
	NPT1/4-18 IEC61518	M10	Impulse line horizontal, version H2, alignment 90°	1.4408 / CF3M <sup>3)</sup> / AISI 316L	НОЈ
	NPT1/4-18 IEC61518	M10	Impulse line horizontal, version H2, alignment 90°	C22.8	HO4

1) Product configurator "Process connection" ordering feature

Additional technical data see chapter "Mechanical construuction" 2)

3) Cast equivalent to AISI 316L

Oxygen applications	<ul> <li>Oxygen and other gases can react explosively to oils, grease and plastics, such that, among other things, the following precautions must be taken:</li> <li>All components of the system, such as measuring devices, must be cleaned in accordance with the BAM (DIN 19247) requirements.</li> <li>Dependent on the materials used, a certain maximum temperature and a maximum pressure for oxygen applications must not be exceeded.</li> </ul>					
	The devices suitable for gaseous oxygen applications are listed in the following table with the specification pmaxOrder code for devices 1), cleaned for oxygen applicationspmax for oxygen applicationsOption 2)					
	PMD55 3)30 bar (450 psi)-18 to +60 °C (0 to +140 °F)A (FKM Viton)1)Only device, not accessory or enclosed accessory2)Product Configurator "Seal" ordering feature3)Product Configurator "Service" ordering feature, "HB option					
PWIS cleaning	Special cleaning of the transmitter to remove paint-wetting substances, for use in paint shops, for instance. Ordering information:					
	Ordering information: Product Configurator, "Service" ordering feature, option HC					
	The stability of the materials used must be checked before using them in the medium.					
Ultrapure gas applications	Endress+Hauser also provides devices which have been cleaned of oil and grease for special applications, such as for ultrapure gas. No special restrictions regarding the process conditions apply to these devices.					
	Ordering information: Product Configurator, "Servic	e" ordering feature, option	"HA"			

# Environment

Ambient temperature range	<ul> <li>-40 to +85 °C (-40 to +185 °F)</li> <li>Onsite display: -20 to +70 °C (-4 to +158 °F). Enhanced temperature range with limitations concerning display speed and contrast: -40 to +85 °C (-40 to +185 °F)</li> </ul>
	For devices for use in hazardous areas, see Safety instructions, Installation or Control Drawing $\rightarrow  igoplus$ 53
Storage temperature range	<ul> <li>-40 to +90 °C (-40 to +185 °F)</li> <li>Onsite display: -40 to +85 °C (-40 to +185 °F)</li> </ul>
Climate class	Class 4K4H (air temperature: –20 to +55 °C (–4 to +131 °F), relative humidity: 4 to 100%) satisfied as per DIN EN 60721-3-4 (condensation possible)
Degree of protection	Ordering information: Product Configurator, "Electrical connection" ordering feature

Vibration resistance	Device	Test standard	Vibration resistance
	PMD55	GL	Guaranteed for 5 to 25 Hz: ±1.6 mm (0.06 in); 25 to 100 Hz: 4 g in all 3 axes
		IEC 61298-3	Guaranteed for 10 to 60 Hz: ±0.35 mm (0.014 in); 60 to 2000 Hz: 5 g in all 3 axes
	PMD55 with mounting bracket (heavy duty design)	IEC 61298-3	Guaranteed for 10 to 60 Hz: ±0.15 mm (0.006 in); 60 to 500 Hz: 2 g in all 3 axes

Electromagnetic compatibility

• Electromagnetic compatibility as per all the relevant requirements of the EN 61326 series and NAMUR Recommendation EMC (NE21).

• Max. deviation : < 0.5 % of the span

• Larger deviations possible with 10 mbar (0.15 psi) measuring cell.

Further details can be found in the manufacturer declaration.

	Process			
Process temperature limits (temperature at transmitter)	<ul> <li>Process connections made of 316L: -40 to +85 °C (-40 to +185 °F)</li> <li>Process connections made of C22.8: -10 to +85 °C (+14 to +185 °F)</li> </ul>			
	The process temperature	at the transmitter can be reduced through the us	e of impulse lines.	
	<ul> <li>For oxygen applications, observe →  <sup>B</sup> 30 ordering feature.</li> <li>Observe the process temperature range of the seal (see also the following section "Process temperature range, Seals").</li> </ul>			
Process temperature range, Seals	Seal	Process temperature range 1)	Option <sup>2)</sup>	
	FKM Viton	-20 to +85 °C (-4 to +185 °F)	А	
	PTFE	-40 to +85 °C (-40 to +185 °F)	С	
	PTFE (EPDM Kern)	-40 to +85 °C (-40 to +185 °F) <sup>3)</sup>	D	
	NBR	-20 to +85 °C (-4 to +185 °F)	F	
	EPDM	-20 to +85 °C (-4 to +185 °F)	J	
	<ol> <li>Restrictions for oxygen applications, →          <sup>(1)</sup> 30</li> <li>Product Configurator "Seal" ordering feature</li> <li>Only 10 mbar (0.15 psi) und 30 mbar (0.45 psi) measuring cell.</li> </ol>			
Pressure specifications	regard to pressure.	for the measuring device depends on the lowe tions, see the "Measuring range" section and the "		
	, , , , , , , , , , , , , , , , , , ,	suring device within the prescribed limits! ant Directive (2014/68/EU) uses the abbreviation	n "DS". The abbroviati	

- The Pressure Equipment Directive (2014/68/EU) uses the abbreviation "PS". The abbreviation "PS" corresponds to the MWP (maximum working pressure) of the measuring device.
- ► MWP (Maximum Working Pressure): The MWP (maximum working pressure) is specified on the nameplate. This value refers to a reference temperature of +20 °C (+68 °F) and may be applied to the device for an unlimited time. Observe the temperature dependency of the MWP. For the pressure values permitted at higher temperatures for flanges, please refer to standards EN 1092-1 (with regard to their stability-temperature property, the materials 1.4435 and 1.4404 are grouped together under EN 1092-1; the chemical composition of the two materials can be identical.), ASME B 16.5a, JIS B 2220 (the latest version of the standard applies in each case).
- ▶ OPL (Over Pressure Limit = sensor overload limit): The test pressure corresponds to the over pressure limit of the sensor and may only be applied for a limited time period so that no permanent damage develops. In the case of sensor range and process connection combinations where the over pressure limit (OPL) of the process connection is smaller than the nominal value of the sensor, the device is set at the factory, at the very maximum, to the OPL value of the process connection. If you want to use the entire sensor range, select a process connection with a higher OPL value.
- ► Oxygen applications: In oxygen applications, the values for  $p_{max}$  and  $T_{max}$  for oxygen applications may not be exceeded  $\rightarrow \cong 30$ .

### Mechanical construction



For the dimensions, see the Product Configurator: www.endress.com

Search for product  $\rightarrow$  click "Configuration" to the right of the product image  $\rightarrow$  after configuration click "CAD"

The following dimensions are rounded values. For this reason, they may deviate slightly from the dimensions given on www.endress.com.

#### Housing


Material		Weight	Option <sup>1)</sup>
Housing <sup>2)</sup>	Cover seal	kg (lbs)	
Aluminum, without viewing window	EPDM	1.0 (2.21)	А
Aluminum, with viewing window	EPDM	1.1 (2.43)	В

1) Degree of protection dependent on cable entry used

2) Product Configurator "Housing" ordering feature  $\rightarrow \square 17$ 

#### **Process connection**

#### Oval flange, connection 1/4-18 NPT IEC61518

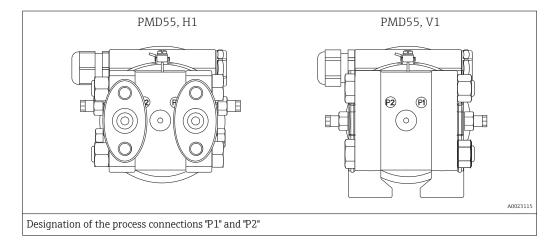


#### Ordering information

- Product Configurator "Process connection" ordering feature
- As Accessorry: Product Configurator "Accessory Enclosed" ordering feature, option "P1"

#### Factory setting

- P1: High pressure side (+)
- P2: Low pressure side (-)


This setting can be changed via a DIP switch in the connection department of the instrument and via the operating menu:



• DIP5 = off: The high pressure side is defined in the operating menu.

- (Menu "Setup", parameter 006: "High pressure side"; default: P1)
- DIP 5 = on: P2 is the high pressure side, independent of the setting in the operating menu.

#### Dimensions V1 option; Impulse pipe vertical; alignment 90

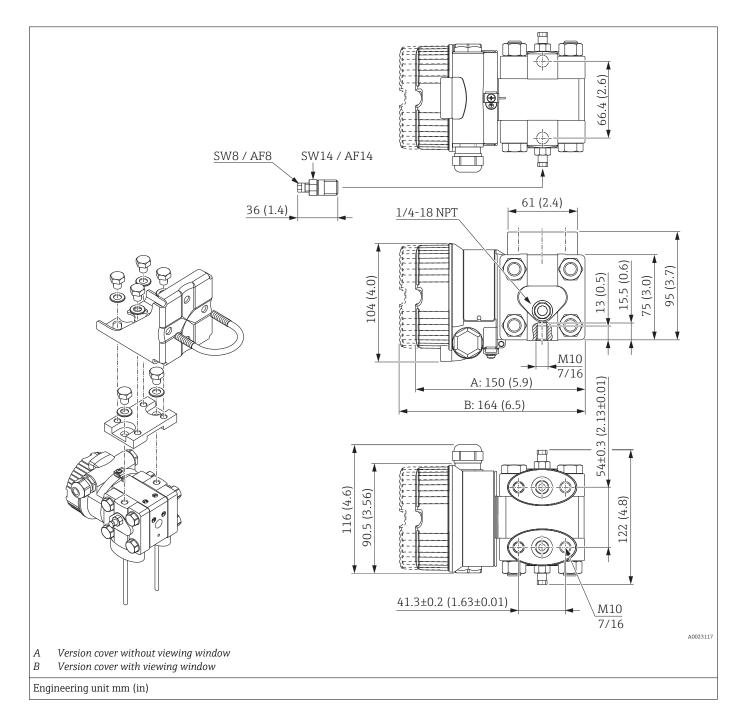


Designation	Material	Weight	Option 1)
		kg (lbs)	
NPT 1/4-18 IEC61518 UNF 7/16-20	1.4408 / CF3M <sup>2)</sup> / AISI 316L	3 (6.62)	HAJ
NPT 1/4-18 IEC61518 UNF 7/16-20	C22.8		HA4
NPT 1/4-18 IEC61518 M10	1.4408 / CF3M <sup>2)</sup> / AISI 316L		HBJ
NPT 1/4-18 IEC61518 M10	C22.8		HB4

Product Configuration "Process Connection" ordering feature 1) 2)

Cast equivalent to AISI 316L

Dimensions H1 option; Impulse pipe horizontal; alignment 180°

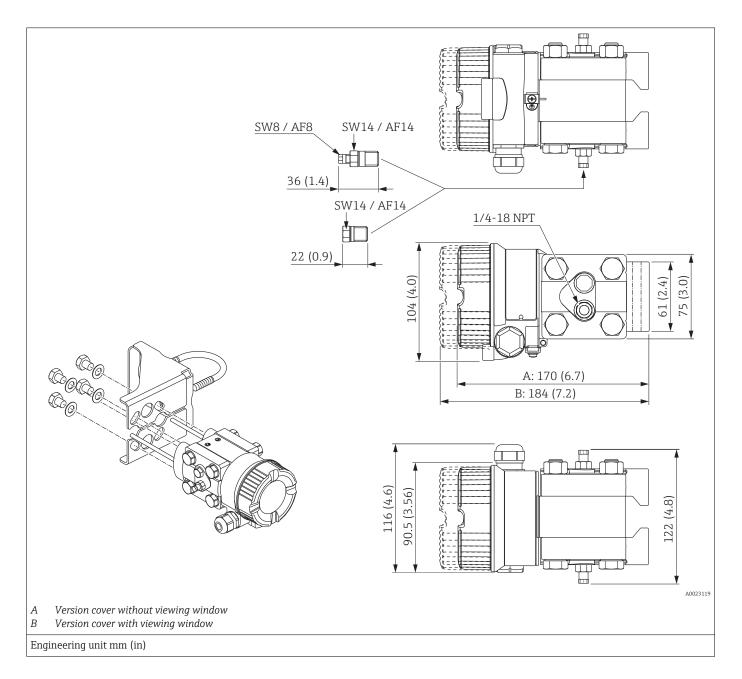


Designation	Material	Weight	Option <sup>1)</sup>
		kg (lbs)	
NPT 1/4-18 IEC61518 UNF 7/16-20	1.4408 / CF3M <sup>2)</sup> / AISI 316L	3 (6.62)	HGJ
NPT 1/4-18 IEC61518 UNF 7/16-20	C22.8		HG4
NPT 1/4-18 IEC61518 M10	1.4408 / CF3M <sup>2)</sup> / AISI 316L		HHJ
NPT 1/4-18 IEC61518 M10	C22.8		HH4

1) Product Configuration "Process Connection" ordering feature

2) Cast equivalent to AISI 316L

#### Dimensions H2 option; Impulse pipe horizontal; alignment 90°

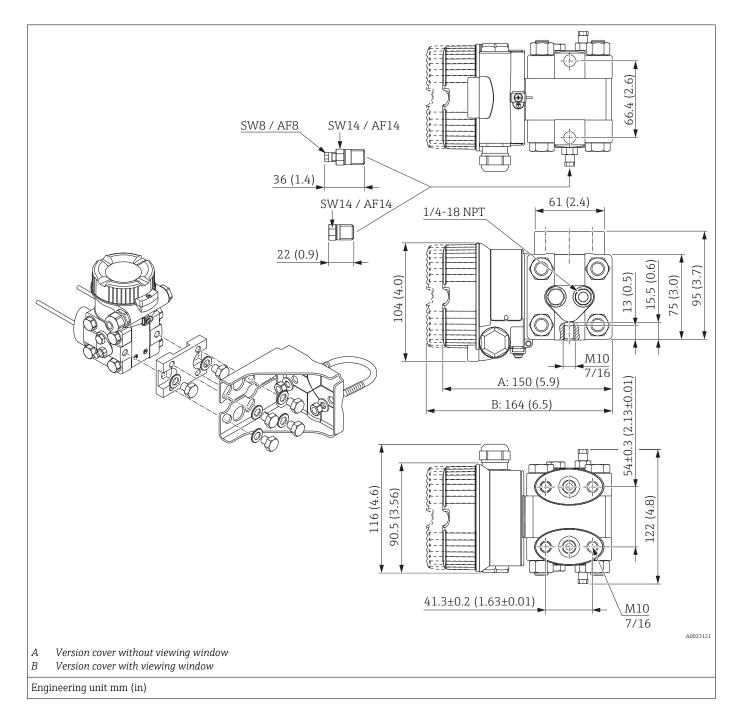


Designation	Material	Weight	Option <sup>1)</sup>
		kg (lbs)	
NPT 1/4-18 IEC61518 UNF 7/16-20	1.4408 / CF3M <sup>2)</sup> / AISI 316L	3 (6.62)	HNJ
NPT 1/4-18 IEC61518 UNF 7/16-20	C22.8		HN4
NPT 1/4-18 IEC61518 M10	1.4408 / CF3M <sup>2)</sup> / AISI 316L		HOJ
NPT 1/4-18 IEC61518 M10	C22.8		HO4

1) Product Configuration "Process Connection" ordering feature

2) Cast equivalent to AISI 316L

#### Valve manifold DA63M-(optional)

Endress+Hauser supplies milled valve manifolds via the transmitter's product structure in the following versions:

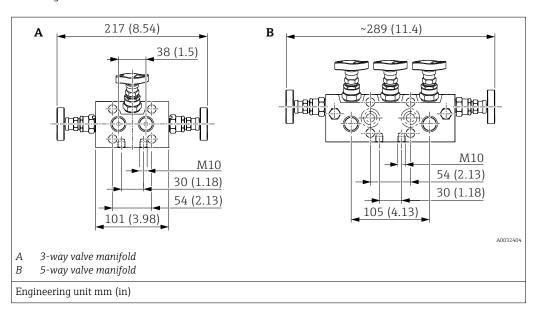

3-way or 5-way valve manifolds in 316L or AlloyC can be


- ordered as an **enclosed** accessory (screws and seals for mounting are enclosed)
- ordered as a **mounted** accessory (mounted valve manifolds are supplied with a documented leakage test).

Certificates ordered with the equipment (e.g. 3.1 material certificate and NACE) and tests (e.g. PMI and pressure test) apply to the transmitter and the valve manifold.

For other details (order option, dimension, weight, materials), see SD01553P/00/EN "Mechanical accessories for pressure measuring devices".

During the operating life of the valves, it may be necessary to re-tighten the packing.


#### Mounting on valve manifold

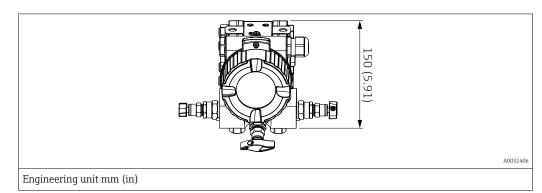

Ordering information:

Product Configurator, order code for "Accessories mounted".

# Materials not in contact with Housing process

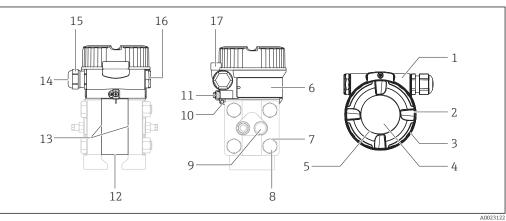


Item number	Component part	Material
1	F30 housing, RAL 5012 (blue)	Die-cast aluminum with protective powder-coating on polyester base
2	Cover, RAL 7035 (gray)	Die-cast aluminum with protective powder-coating on polyester base
3	Cover seal	EPDM
4	Sight glass	Mineral glass
5	Sight glass seal	Silicone (VMQ)
6	Nameplates	Plastic film
7	Washers	A4
8	Screws	AISI 316 L (1.4404)
9	Screw	AISI 316 L (1.4404)
10	External ground terminal	AISI 304 (1.4301)
11	Fastening for wired-on tag plate	AISI 304 (1.4301)/AISI 316 (1.4401)
12	Pressure compensation filter	Silicone
13	Sealing ring	EPDM
14	Seal of cable gland and blind plug	EPDM/NBR
15	Cable gland	Polyamide (PA) or CuZn nickel-plated
16	Blind plug	PBT-GF30 FR
		for dust ignition-proof, Ex d, FM XP and CSA XP: AISI 316L (1.4435)
17	Cover clamp	Clamp AISI 316L (1.4435), screw A4

### Filling oil

Oil	Option <sup>1)</sup>
Silicone oil	1
Inert oil	2

1) Product Configurator, order code for "Fill fluid"

#### **Connecting parts**

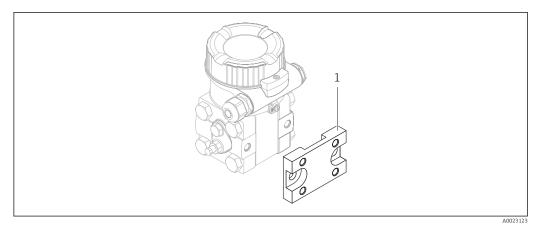

Item number	Component part	Material
1	Adapter plate for mounting bracket	AISI 316L

# Materials in contact with the process NOTICE process The device components in contact with the process are specified in the "Mechanical construction"

 $\rightarrow \cong$  33 and "Ordering information"  $\rightarrow \cong$  49 sections.

#### TSE Certificate of Suitability (Transmissible Spongiform Encephalopathy)

The following applies to all process wetted device components:

- They do not contain any materials derived from animals.
- No auxiliaries or operating materials derived from animals are used in production or processing.

#### Side flanges

Endress+Hauser supplies side flanges in stainless steel AISI 316L as per material numbers 1.4404 or 1.4408, or side flanges made from C22.8 (Zn 5-8 / 1.0460 + Zn 5-8) with zinc plating. The zincplated carbon steel flange is not recommended for water application due to hydrogen diffusion. Endress+Hauser therefore recommends the use of side flanges made of 316L.


#### Process isolating diaphragm

Material	Option <sup>1)</sup>
316L	А
Alloy C	C

1) Product Configurator, order code for "Material of process isolating diaphragm"

Oval flange adapters	AISI 316L (1.4404)	
Vent valves	AISI 316L (1.4404)	

Operability
Operator-oriented menu structure for user-specific tasks
<ul> <li>Commissioning</li> <li>Operation</li> <li>Diagnosis</li> <li>Expert level</li> </ul>
Quick and safe commissioning
Guided menus for applications
Reliable operation
<ul> <li>Local operation possible in several languages</li> <li>Standardized operation at the device and in the operating tools</li> <li>Parameters relating to measured values can be locked/unlocked using the device's write protection switch, using the device software or via remote control</li> </ul>
Efficient diagnostic behavior increases measurement availability
<ul><li>Remedial measures are integrated in plain text</li><li>Diverse simulation options</li></ul>
Local display (optional)
A 4-line liquid crystal display (LCD) is used for display and operation. The local display shows measured values, dialog texts as well as fault and notice messages in plain text, thereby supporting the user at every stage of operation. The liquid crystal display of the device can be turned in 90° stages. Depending on the orientation of the device, this makes it easy to operate the device and reac the measured values.
<ul> <li>Functions</li> <li>8-digit measured value display including sign and decimal point, bar graph for 4 to 20 mA HART as current display; or for PROFIBUS PA as graphic display of the standardized value of the AI Block; for FOUNDATION Fieldbus as graphic display of the transducer output in relation to the se pressure range.</li> <li>Simple and complete menu guidance as parameters are split into several levels and groups</li> <li>Each parameter is given a 3-digit ID number for easy navigation</li> <li>Possibility of configuring the display to suit individual requirements and preferences, such as language, alternating display, contrast setting, display of other measured values such as sensor temperature etc.</li> <li>Comprehensive diagnostic functions (fault and warning message, peak-hold indicators etc.)</li> </ul>

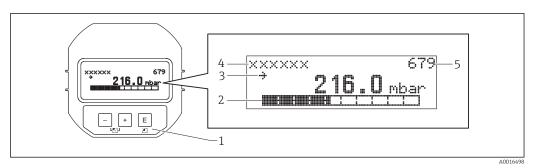

- Operating keys Bar graph Symbol Header line 1
- 2
- 3
- 4 5
- Parameter identification number

Function		Operation via display		
	HART	PROFIBUS PA	FOUNDATION Fieldbus	
Position adjustment (zero point correction)	V	V	V	
Setting lower range value and upper range value - reference pressure present at the device	r	V	V	
Device reset	V	V	V	
Locking and unlocking parameters relevant to the measured value	V	v	V	
Value acceptance indicated by the green LED	-	-	_	
Switching damping on and off	V	V	V	

Ordering information: Product Configurator, "Output, Operation" ordering feature


#### Operating keys and elements located inside on the electronic insert

Function	Operation	Operation with operating keys and elements on the electronic insert		
	HART	PROFIBUS PA	FOUNDATION Fieldbus	
Position adjustment (zero point correction)	V	V	V	
Setting lower range value and upper range value - reference pressure present at the device	V	-	-	
Device reset	V	V	V	
Locking and unlocking parameters relevant to the measured value	V	V	V	
Value acceptance indicated by the green LED	V	V	V	
Switching damping on and off	V	V	<i>v</i>	

#### Ordering information:


Product Configurator, "Output, Operation" ordering feature

#### HART

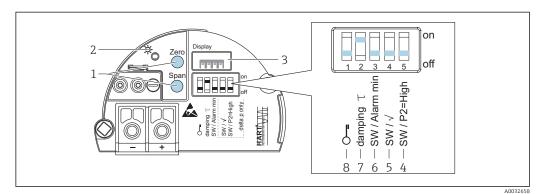


- 1 Operating keys for lower range value (zero) and upper range value (span)
- 2 Green LED to indicate successful operation
- 3 Slot for optional local display
- 4 "SW/P2-High"; used to determine the high-pressure side
- 5 "SW/Square root"; used to control the output characteristics
- 6 DIP switch for alarm current SW / Alarm Min (3.6 mA)
- 7 DIP switch for switching damping on/off
- 8 DIP switch for locking/unlocking parameters relevant to the measured value

#### PROFIBUS PA

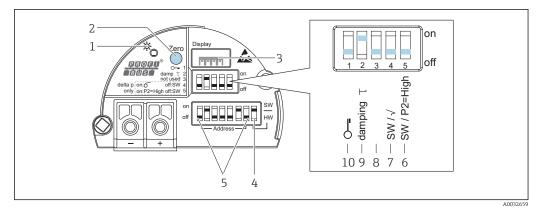

- 1 Green LED to indicate successful operation
- 2 Operating key for position zero adjustment (Zero) or reset
- 3 Slot for optional local display
- 4 DIP-switch for bus address SW / HW
- 5 DIP-switch for hardware address
- 6 DIP switch used to determine the high-pressure side
- 7 DIP switch used to control the output characteristics and measuring mode
- 8 Not used
- 9 DIP switch for switching damping on/off
- 10 DIP switch for locking/unlocking parameters relevant to the measured value

#### FOUNDATION Fieldbus

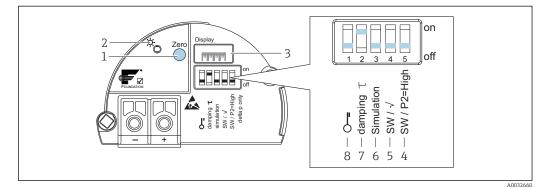

- 1 Operating key for position zero adjustment (Zero) or reset
- 2 Green LED to indicate successful operation
- 3 Slot for optional local display
- 4 DIP switch used to determine the high-pressure side
- 5 DIP switch used to control the output characteristics and measuring mode
- 6 DIP-switch for simulation mode
- 7 DIP switch for switching damping on/off
- 8 DIP switch for locking/unlocking parameters relevant to the measured value

#### **Operating languages**

You can also choose another language in addition to the standard language "English":

Designation	Option <sup>1)</sup>
English	AA
German	AB
French	AC
Spanish	AD
Italian	AE
Dutch	AF

Designation	Option <sup>1)</sup>
Chinese	AK
Japanese	AL

#### 1) Product Configurator "Additional Operation Language" ordering feature

#### **Remote operation**

All software parameters are accessible depending on the position of the write protection switch on the device.

Hardware and software for remote operation	HART	PROFIBUS PA	FOUNDATION Fieldbus
FieldCare $\rightarrow \square 43$	✓ <sup>1)</sup>	✓ <sup>2)</sup>	V
FieldXpert SFX100 → $\textcircled{B}$ 43	V	-	V
NI-FBUS Configurator $\rightarrow \square 44$	-	-	V

1) Commubox FXA195 required

2) Profiboard or Proficard required

#### FieldCare

FieldCare is an Endress+Hauser asset management tool based on FDT technology. With FieldCare, you can configure all Endress+Hauser devices as well as devices from other manufacturers that support the FDT standard.

FieldCare supports the following functions:

- Configuration of transmitters in offline and online mode
- Loading and saving device data (upload/download)
- Documentation of the measuring point

Connection options:

- HART via Commubox FXA195 and USB interface of a computer
- PROFIBUS PA via segment coupler and PROFIBUS interface card
- Service interface with Commubox FXA291 and ToF adapter FXA291 (USB).

#### Field Xpert SFX100

Field Xpert is an industrial PDA with integrated 3.5" touchscreen from Endress+Hauser based on Windows Mobile. It offers wireless communication via the optional VIATOR Bluetooth modem from Endress+Hauser. Field Xpert also works as a stand-alone device for asset management applications. For details refer to BA00060S/04/EN.

#### **Commubox FXA195**

For intrinsically safe HART communication with FieldCare via the USB interface. For details refer to TI00404F/00/EN.

#### Commubox FXA291

The Commubox FXA291 connects Endress+Hauser field devices with a CDI interface (= Endress+Hauser Common Data Interface) to the USB interface of a personal computer or laptop. For details refer to TI00405C/07/EN.

For the following Endress+Hauser devices you will need the "ToF Adapter FXA291" as an additional accessory:

- Cerabar M
- Deltabar M
- Deltapilot M

#### ToF Adapter FXA291

The ToF adapter FXA291 connects the Commubox FXA291 with devices of the ToF platform, pressure equipment and Gammapilot via the USB interface of a personal computer or a notebook. For details refer to KA00271F.

For further information, please contact your local Endress+Hauser Sales Center.

#### Profiboard

For connecting a PC to the PROFIBUS.

#### Proficard

For connecting a laptop to the PROFIBUS.

#### FF configuration program

FF configuration program, such as NI-FBUS Configurator, to

- connect devices with "FOUNDATION Fieldbus signal" into an FF-network
- set FF-specific parameters

#### Operation with NI-FBUS Configurator:

The NI-FBUS Configurator is an easy-to-use graphical environment for creating linkages, loops, and a schedule based on the fieldbus concepts.

You can use the NI-FBUS Configurator to configure a fieldbus network as follows:

- Set block and device tags
- Set device addresses
- Create and edit function block control strategies (function block applications)
- Configure vendor-defined function and transducer blocks
- Create and edit schedules
- Reading and writing of data from control and regulation systems
- Invoke methods specified in the manufacturer-specific DD (e.g. basic device settings)
- Display DD menus (e.g. tab for calibration data)
- Download a configuration
- Verify a configuration and compare it to a saved configuration
- Monitor a downloaded configuration
- Replace a virtual device by a real device
- Save and print a configuration

#### System integration

#### The device can be given a tag name (max. 8 alphanumeric characters)

Designation	Option <sup>1)</sup>
Tagging (TAG), see aditional spec.	Z1
Bus address, see aditional spec.	Z2

1) Product configurator "Marking" ordering feature

# Certificates and approvals

CE mark	The device meets the legal requirements of the relevant EC directives. Endress+Hauser confirms that the device has been successfully tested by applying the CE mark.
RoHS	The measuring system complies with the substance restrictions of the Restriction on Hazardous Substances Directive 2011/65/EU (RoHS 2).
RCM-Tick marking	The supplied product or measuring system meets the ACMA (Australian Communications and Media Authority) requirements for network integrity, interoperability, performance characteristics as well as health and safety regulations. Here, especially the regulatory arrangements for electromagnetic compatibility are met. The products are labelled with the RCM- Tick marking on the name plate.
	A0029561
Ex approvals	<ul> <li>ATEX</li> <li>IECEx</li> <li>FM</li> <li>CSA</li> <li>NEPSI</li> <li>Also combinations of different approvals</li> </ul>
	All explosion protection data are given in separate documentation which is available upon request. The Ex documentation is supplied as standard with all devices approved for use in explosion hazardous areas $\rightarrow \square 53$ .
EAC conformity	The measuring system meets the legal requirements of the applicable EAC guidelines. These are listed in the corresponding EAC Declaration of Conformity together with the standards applied. Endress+Hauser confirms successful testing of the device by affixing to it the EAC mark.
Suitable for hygiene applications	The device has been developed for use in hygienic processes. The materials in contact with the process meet FDA requirements as well as the 3-A Sanitary Standard No. 74-XX. Endress+Hauser confirms compliance with the requirements by affixing the 3- A mark to the device. The following serial number-specific declarations (with a copy of the certification) can be ordered with the device (optional): Product Configurator, order code for "Additional approval" option "LD" Product Configurator, order code for "Additional approval" option "LB"
	<ul> <li>NOTICE</li> <li>Risk of contamination if incorrect seals and parts are used!</li> <li>To avoid the risk of contamination, the device must be installed in accordance with EHEDG "Hygienic Equipment Design Criteria (HDC)", "Subgroup Design Principles" Doc. 8.</li> <li>Suitable assemblies and seals must be used to ensure hygiene-compliant design according to the specifications of 3-A SSI and EHEDG Position Paper (in their current version).</li> <li>The leak-proof connections can be cleaned with the cleaning methods typical of this industry (CIP and SIP). Attention must be paid to the pressure and temperature specifications of the sensor and process connections for CIP and SIP processes (clean in place/sterilization in place).</li> <li>For diaphragm seal devices with 3-A and EHEDG certificates, only select filling oils with FDA approval!</li> </ul>

CERTIFIED CENCINEERA CONTRACTOR CONTRAC	<b>3</b> <b>74</b> -
A0024005	

If cleaning in place (CIP) is required, adapters are available that comply with 3-A requirements.

Information on 3-A and EHEDG-tested adapters can be found in the "Weld-in adapters, process adapters and flanges" documentation, TI00426F.

Certificate of current Good	Product Configurator, order code for "Test, Certificate" option "JG"
Manufacturing Practices	<ul> <li>The certificate is only available in English</li> </ul>
(cGMP)	<ul> <li>Materials of construction of product wetted parts</li> </ul>
	<ul> <li>TSE compliance</li> </ul>
	<ul> <li>Polishing and surface finish</li> <li>Matazial (some sund some table (USD Class VI EDA conformity)</li> </ul>
	<ul> <li>Material/ compound compliance table (USP Class VI, FDA conformity)</li> </ul>
Functional safety SIL	The Deltabar M with 4 to 20 mA output signal has been developed to assessed and certified by TÜV NORD CERT as per IEC 61508 Edition 2.0 and IEC 61511. These devices can be used to monitor the process level and pressure up to SIL 2. For a detailed description of the safety functions with Deltaba M, settings and functional safety data, see the "Functional safety manual - Deltabar M" SD00347P.
	Ordering information:
	Product Configurator, "Additional approval" ordering feature, option "LA"
CRN approvals	Some device versions have CRN approval. A CRN-approved process connection with a CSA approval must be ordered for a CRN-approved device. These devices are fitted with a separate plate bearing the registration number 0F13907.5C
	Ordering information:
	Product Configurator, "Process connection" section and
	Product Configurator, "Approval" ordering feature
Other standards and guidelines	The applicable European guidelines and standards can be found in the relevant EU Declarations of Conformity. The following were also applied:
	IEC 62828-1 / DIN EN 60770 and IEC 62828-2 / DIN EN 60770:
	Transmitters for use in industrial-process control systems. Part 1: Methods for inspection and routine testing
	DIN 16086:
	Electrical pressure measuring instruments, pressure sensors, pressure transmitters, pressure measuring instruments, concepts, specifications in data sheets
	EN 61326-Series:
	EMC product family standard for electrical equipment for measurement, control and laboratory use.
	EN 60529:
	Degrees of protection by housing (IP code)
AD2000	The pressure retaining material 316L (1.4435/1.4404) corresponds to AD2000 - W2/W10.
Pressure Equipment	Pressure equipment with allowable pressure $\leq 200$ bar (2900 psi)
Directive 2014/68/EU (PED)	Pressure equipment (having a maximum allowable pressure PS ≤ 200 bar (2 900 psi)) can be classified as pressurized equipment in accordance with Pressure Equipment Directive 2014/68/EU. I

	the maximum allowable pressure is $\leq 200$ bar (2 900 psi) and the pressurized volume of equipment is $\leq 0.1$ l, the pressure equipment is subject to the Pressure Equipment Directive 2014/68/EU, Article 4, point 3). The Pressure Equipment only requires that the pressure equipment shall be designed and manufactured in according to the "sound engineering practice of a Member State".	ctive (cf. It Directive
	Reasons:	
	<ul> <li>Pressure Equipment Directive (PED) 2014/68/EU Article 4, point 3</li> <li>Pressure equipment directive 2014/68/EU, Commission's Working Group "Pressure", A-05 + A-06</li> </ul>	Guideline
	Note:	
	A partial examination shall be performed for pressure instruments that are part of safe for the protection of a pipe or vessel from exceeding allowable limits (equipment with function in accordance with Pressure Equipment Directive 2014/68/EU, Article 2, poir	afety
Manufacturer declaration	<ul> <li>Depending on the desired configuration, the following documents can be ordered addit the device:</li> <li>TSE-free, materials free from animal origin</li> <li>Regulation (EC) No. 2023/2006 (GMP)</li> <li>Regulation (EC) No. 1935/2004 on materials and articles intended to come into con</li> </ul>	2
	Downloading the Declaration of Conformity	
	www.endress.com → Download	
Drinking water approval	NSF 61	
	Ordering information.	
	Ordering information: Product Configurator, "Additional approval" ordering feature, option "LR"	
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01	Product Configurator, "Additional approval" ordering feature, option "LR" Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as sidual seal devices with annunciation, allowing the user to waive the use and save the context external secondary process seals in the conduit as required by the process sealing section NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-American installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids.	st of installing ons of ANSI/ can
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01	Product Configurator, "Additional approval" ordering feature, option "LR" Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as si dual seal devices with annunciation, allowing the user to waive the use and save the co external secondary process seals in the conduit as required by the process sealing section NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-Americ installation practice and provide a very safe and cost-saving installation for pressurized	st of installing ons of ANSI/ can applications
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01	Product Configurator, "Additional approval" ordering feature, option "LR" Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as sidual seal devices with annunciation, allowing the user to waive the use and save the context external secondary process seals in the conduit as required by the process sealing section NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-American installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids.	st of installing ons of ANSI/ can applications <b>Option</b> <sup>1)</sup>
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01	Product Configurator, "Additional approval" ordering feature, option "LR" Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as sidual seal devices with annunciation, allowing the user to waive the use and save the context external secondary process seals in the conduit as required by the process sealing section NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-America installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids. Further information can be found in the control drawings of the relevant devices.	st of installing ons of ANSI/ can applications <b>Option</b> <sup>1)</sup> JA <sup>2)</sup>
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01	Product Configurator, "Additional approval" ordering feature, option "LR" Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as sidual seal devices with annunciation, allowing the user to waive the use and save the construction secondary process seals in the conduit as required by the process sealing section NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-Ameri installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids. Further information can be found in the control drawings of the relevant devices.	st of installing ons of ANSI/ can applications JA <sup>2)</sup> JB <sup>2)</sup>
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01	Product Configurator, "Additional approval" ordering feature, option "LR" Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as sidual seal devices with annunciation, allowing the user to waive the use and save the construction and secondary process seals in the conduit as required by the process sealing section NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-America installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids. Further information can be found in the control drawings of the relevant devices. <b>Designation</b> EN10204-3.1 material wetted parts, inspection certificate	st of installing ons of ANSI/ can applications <b>Option</b> <sup>1)</sup> JA <sup>2)</sup> JB <sup>2)</sup>
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01	Product Configurator, "Additional approval" ordering feature, option "LR"         Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as sidual seal devices with annunciation, allowing the user to waive the use and save the context external secondary process seals in the conduit as required by the process sealing section NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-Americal installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids.         Further information can be found in the control drawings of the relevant devices.         Designation         EN10204-3.1 material wetted parts, inspection certificate         NACE MR0175 wetted parts	st of installing ons of ANSI/ can applications <b>Option</b> <sup>1)</sup> JA <sup>2)</sup> JB <sup>2)</sup>
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA	Product Configurator, "Additional approval" ordering feature, option "LR"         Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as sidual seal devices with annunciation, allowing the user to waive the use and save the construction and secondary process seals in the conduit as required by the process sealing section NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-America installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids.         Further information can be found in the control drawings of the relevant devices.         Designation         EN10204-3.1 material wetted parts, inspection certificate         NACE MR0175 wetted parts         EN10204-3.1 AD2000 material wetted parts, expecting process membrane, inspection certificate	st of installing ons of ANSI/ can applications JA <sup>2)</sup> JB <sup>2)</sup> e JF
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01	Product Configurator, "Additional approval" ordering feature, option "LR" Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as sidual seal devices with annunciation, allowing the user to waive the use and save the contexternal secondary process seals in the conduit as required by the process sealing section NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-Americal installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids. Further information can be found in the control drawings of the relevant devices. <b>Designation</b> EN10204-3.1 material wetted parts, inspection certificate NACE MR0175 wetted parts EN10204-3.1 AD2000 material wetted parts, expecting process membrane, inspection certificate EN10204-3.1 Helium leak test, inspection certificate	st of installing ons of ANSI/ can applications JA <sup>2)</sup> g JF KD KE
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01 Inspection certificate	Product Configurator, "Additional approval" ordering feature, option "LR" Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as si dual seal devices with annunciation, allowing the user to waive the use and save the cc external secondary process seals in the conduit as required by the process sealing sectio NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-Ameri installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids. Further information can be found in the control drawings of the relevant devices.  Designation EN10204-3.1 material wetted parts, inspection certificate NACE MR0175 wetted parts EN10204-3.1 AD2000 material wetted parts, expecting process membrane, inspection certificat EN10204-3.1 pressure test, inspection certificate 1) Product Configurator "Test, Certificate" ordering feature 2) The selection of this feature for coated process isolating diaphragm / process connections a metallic base material.	st of installing ons of ANSI/ can applications JA <sup>2)</sup> g JF KD KE
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01 Inspection certificate	Product Configurator, "Additional approval" ordering feature, option "LR" Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as si dual seal devices with annunciation, allowing the user to waive the use and save the oc external secondary process seals in the conduit as required by the process sealing sectio NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-Ameri installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids. Further information can be found in the control drawings of the relevant devices.  Designation EN10204-3.1 material wetted parts, inspection certificate NACE MR0175 wetted parts EN10204-3.1 AD2000 material wetted parts, expecting process membrane, inspection certificat EN10204-3.1 Helium leak test, inspection certificate 1) Product Configurator "Test, Certificate" ordering feature 2) The selection of this feature for coated process isolating diaphragm / process connections r metallic base material.	st of installing ons of ANSI/ can applications JA <sup>2)</sup> JB <sup>2)</sup> e JF KD KE efers to the
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01 Inspection certificate	Product Configurator, "Additional approval" ordering feature, option "LR"         Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as sidual seal devices with annunciation, allowing the user to waive the use and save the construction and secondary process seals in the conduit as required by the process sealing section NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-Americ installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids.         Further information can be found in the control drawings of the relevant devices.         Designation         EN10204-3.1 material wetted parts, inspection certificate         NACE MR0175 wetted parts         EN10204-3.1 AD2000 material wetted parts, expecting process membrane, inspection certificate         EN10204-3.1 pressure test, inspection certificate         1)       Product Configurator "Test, Certificate" ordering feature         2)       The selection of this feature for coated process isolating diaphragm / process connections a metallic base material.	st of installing ons of ANSI/ can applications JA <sup>2)</sup> JB <sup>2)</sup> e JF KD KE efers to the
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01 Inspection certificate	Product Configurator, "Additional approval" ordering feature, option "LR"         Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as sidual seal devices with annunciation, allowing the user to waive the use and save the construction of the secondary process seals in the conduit as required by the process sealing section NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-Americ installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids.         Further information can be found in the control drawings of the relevant devices.         Designation         EN10204-3.1 material wetted parts, inspection certificate         NACE MR0175 wetted parts         EN10204-3.1 AD2000 material wetted parts, expecting process membrane, inspection certificate         EN10204-3.1 pressure test, inspection certificate         1)       Product Configurator "Test, Certificate" ordering feature         2)       The selection of this feature for coated process isolating diaphragm / process connections a metallic base material.         Designation       Op         Nominal value; mbar/bar       B	st of installing ons of ANSI/ can applications JA <sup>2)</sup> JB <sup>2)</sup> e JF KD KE efers to the
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01 Inspection certificate	Product Configurator, "Additional approval" ordering feature, option "LR"         Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as sidual seal devices with annunciation, allowing the user to waive the use and save the construction of the secondary process seals in the conduit as required by the process sealing section NFPA 70 (NEC) and CSA 22.1 (CEC). These instruments comply with the North-Americ installation practice and provide a very safe and cost-saving installation for pressurized with hazardous fluids.         Further information can be found in the control drawings of the relevant devices.         Designation         EN10204-3.1 material wetted parts, inspection certificate         NACE MR0175 wetted parts         EN10204-3.1 AD2000 material wetted parts, expecting process membrane, inspection certificate         EN10204-3.1 pressure test, inspection certificate         1)       Product Configurator "Test, Certificate" ordering feature         2)       The selection of this feature for coated process isolating diaphragm / process connections metallic base material.         Designation       Op         Nominal value; mbar/bar       B	st of installing ons of ANSI/ can applications JA <sup>2)</sup> JB <sup>2)</sup> e JF KD KE efers to the
Classification of process sealing between electrical systems and (flammable or combustible) process fluids in accordance with ANSI/ ISA 12.27.01	Product Configurator, "Additional approval" ordering feature, option "LR"         Endress+Hauser instruments are designed according to ANSI/ISA 12.27.01 either as sidual seal devices with annunciation, allowing the user to waive the use and save the construction of the context of the seand save that the context of the seand save the context of the seand save that the context of the seand save that the context of the seand save the context of the seand save that the context of the seand save the context of the seand cost-saving installation for pressure test inspection certificate         1)       Product Configurator "Test, Certificate" ordering feature         2)       The selection of this feature for coated process isolating diaphragm / process connections to metallic base material.         Designation       Op         Nominal value; mbar/bar       B         Nomi	st of installing ons of ANSI/ can applications JA <sup>2)</sup> JB <sup>2)</sup> e JF KD KE efers to the

Designation	Option <sup>1)</sup>
Customized level; see additional spec.	К
Customized flow; see additional spec.	L

#### 1) Product Configurator, "Calibration; unit" ordering feature

#### Calibration

Designation	Option <sup>1)</sup>
Factory calib. certificate 5-point	F1
DKD/DAkkS calib. certificate 10-point <sup>2)</sup>	F2

1) 2) Product Configurator "Calibration" ordering feature

Service

Designation	Option <sup>1)</sup>
Cleaned from oil+grease <sup>2)</sup>	HA
Cleaned for oxygen service <sup>2)</sup>	НВ
Cleaned from PWIS (PWIS = paint wetting impairment substances) $^{2)}$	НС
Adjusted min alarm current	IA
Adjusted HART Burst Mode PV	IB

Product Configurator "Service" ordering feature Only device, not accessory or enclosed accessory 1)

2)

### **Ordering information**

Detailed ordering information is available as follows:

- In the Product Configurator on the Endress+Hauser website:www.endress.com → Click "Corporate" → Select your country → Click "Products" → Select the product using the filters and search field → Open product page → The "Configure" button to the right of the product image opens the Product Configurator.
- From your Endress+Hauser Sales Center:www.addresses.endress.com
  - Product Configurator the tool for individual product configuration
- Up-to-the-minute configuration data
  - Depending on the device: direct input of information specific to the measuring point, such as measuring range or operating language
  - Automatic verification of exclusion criteria
  - Automatic generation of the order code with its breakdown in PDF or Excel output format
  - Ability to order directly in the Endress+Hauser Online Shop

**Special device versions** Endress+Hauser offers special device versions as **T**echnical **S**pecial **P**roducts (TSP).

For further information please contact your local Endress+Hauser Sales Center.

Scope of delivery	<ul> <li>Device</li> </ul>
	<ul> <li>Optional accessories</li> </ul>
	<ul> <li>Brief Operating Instruct</li> </ul>

- Brief Operating InstructionCalibration certificates
- Optional certificates

Measuring point (TAG)	Order code for	895: Marking
	Option	Z1: Tagging (TAG), see additional spec.
	Location of measuring point identification	To be selected in the additional specification: Tie-on label, stainless steel Adhesive paper label Label provided RFID TAG RFID TAG + tie-on label, stainless steel RFID TAG + adhesive paper label RFID TAG + label provided
	Definition of measuring point identification	To be specified in additional specification: 3 lines each with a maximum of 18 characters The measuring point designation appears on the selected label and/or the RFID TAG.
	Identification on electronic nameplate (ENP)	32 characters
	Identification on display module	10 characters

#### Configuration data sheet

Pressure

If the option "J" was selected for the order code for "Calibration; Unit" in the Product Configurator, the following configuration data sheet must be completed and included with the order.

Pressure unit				
<ul><li>mbar</li><li>bar</li><li>psi</li></ul>	$ \begin{array}{c} mmH_2O\\ mH_2O\\ ftH_2O\\ nH_2O\\ nH_2O\\ \end{array} $	<ul> <li>mmHg</li> <li>kgf/cm<sup>2</sup></li> </ul>	<ul><li>Pa</li><li>kPa</li><li>MPa</li></ul>	

Calibration Range / Output		
Low range value (LRV): Upper range value (URV):	 [Pressure engineering unit] [Pressure engineering unit]	

Display	
1st Value Display <sup>1)</sup>	2nd Value Display <sup>1)</sup>
Main Value	<ul> <li>None (Default)</li> <li>Main Value [%]</li> <li>Pressure</li> <li>Current [mA] (HART only)</li> <li>Temperature</li> </ul>


1) Depending on sensor and communication version

Damping		
Damping:	 sec (Default 2 sec)	

Lowest calibratable span (preset at factory)  $\rightarrow \implies 11$ 

#### Level

If the option "K" was selected for the order code for "Calibration; Unit" in the Product Configurator, the following configuration data sheet must be completed and included with the order.

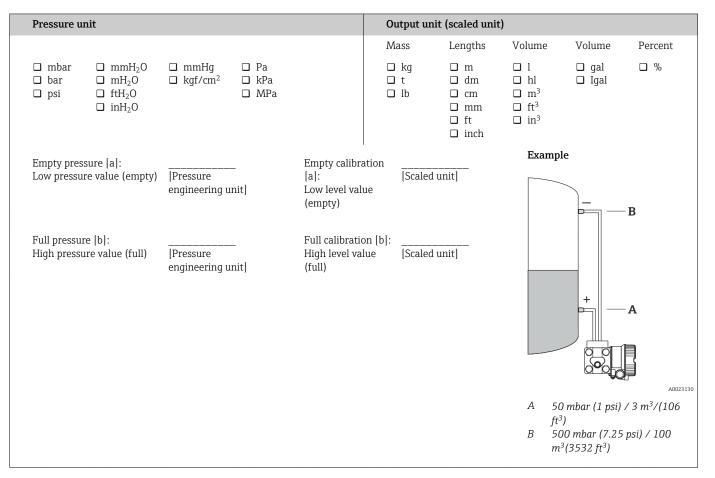

Display	
1st Value Display <sup>1)</sup>	2nd Value Display
	None (Default) Main Value [%] Pressure Current [mA] (HART only) Temperature

1) Depending on sensor and communication version

Damping		
Damping:	 sec (Default 2 sec)	

#### Flow

If the option "G" or the option "J" was selected in the "Calibration; Unit" ordering feature of the Product Configurator, the following configuration data sheet must be completed and included with the order.

Pressure Engineering Unit	Flow Unit / Measured Value (PV)											
			Ma	ISS	Vo	lume	Vol	ume	Vo	lume		Perc ent
						eration ndition	Noi Cor	rm ndition	Sta diti	indard Con ion		
<ul> <li>mbar</li> <li>mmH<sub>2</sub>O</li> <li>bar</li> <li>mH<sub>2</sub>O</li> <li>psi</li> <li>ftH<sub>2</sub>O</li> <li>inH<sub>2</sub>O</li> </ul>	kgf/cm <sup>2</sup> □	Pa kPa MPa		kg/s kg/min kg/h t/s t/min t/h oz/s oz/min lb/s lb/min lb/h		m <sup>3</sup> /s m <sup>3</sup> /min m <sup>3</sup> /h l/s l/min l/h US Gal/s US Gal/n US Gal/h ACFS ACFM ACFH		Nm <sup>3</sup> /s Nm <sup>3</sup> /m in Nm <sup>3</sup> /h Nm <sup>3</sup> /d		Sm <sup>3</sup> /s Sm <sup>3</sup> /min Sm <sup>3</sup> /h SCFS SCFM SCF3 SCFD		%

Ou	tput Characteristic					
	linear (HART only) <b>Operation Point</b>			square root (HART only) <b>Operation Point</b>		
	Max Pressure		[Pressure engineering unit]	Max Pressure		[Pressure engineering unit]
	Max Flow		[flow unit]	Max Flow		[flow unit]
	LRV		[Pressure engineering unit]	LRV		[flow unit]
	(Lower Range Value	(HART only))		(Lower Range Value (HAF	RT only))	

Low flow cut off

Value:

[%] (default = 5%)

Display Information	
1st Value Display <sup>1)</sup>	2nd Value Display none (Default)
	Main Value [%]
	Pressure
	Current [mA] (HART only)
	Temperature
	Totalizer 1
	Totalizer 2

1) Depending on sensor and comunication variant

Damping	
Damping:	 sec (Default 2 sec)

### Additional documentation

Field of Activities	Pressure measurement, powerful instruments for process pressure, differential pressure, level and flow:				
	FA00004P/00/EN				
Technical Information	<ul> <li>Deltapilot M: TI00437P/00/EN</li> <li>Cerabar M: TI00436P/00/EN</li> <li>EMC test procedures: TI00241F/00/EN</li> <li>Weld-in adapter, adapter and flanges: TI00426F/00/EN</li> </ul>				
Operating Instructions	<ul> <li>420 mA HART: BA00382P/00/EN</li> <li>PROFIBUS PA: BA00383P/00/EN</li> <li>FOUNDATION Fieldbus: BA00384P/00/EN</li> </ul>				
Brief operating instruction	<ul> <li>420 mA HART: KA01027P/00/EN</li> <li>PROFIBUS PA: KA01028P/00/EN</li> <li>FOUNDATION Fieldbus: KA01029P/00/EN</li> </ul>				
Functional safety manual (SIL)	Deltabar M (420 mA): SD00347P/00/EN				

#### Safety instructions

Directive	Approval	Category	Electronics	Documentation	Option <sup>1)</sup>
ATEX	Ex ia IIC	II 1/2 G	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00457P/00	BA
	Ex t IIIC	II 1/2 D	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00458P/00	BB
	Ex d IIC	II 2G	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00459P/00	BC
	Ex nA IIC	II 3 G	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00461P/00	BD
	Ex ic IIC	II 3 G	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA01301P/00	BG
	Ex ia IIC Ex ia D	II 1/2 G II 1/2 D	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00460P/00	B1
	Ex ia IIC Ex d IIC	II 1/2 G II 2 G	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00505P/00	8A

1) Product Configurator, order code for "Approval"

Directive	Approval	Electronics	Documentation	Option <sup>1)</sup>	
NEPSI	Ex ia IIC T6	4 to 20 mA HART	XA00534P/00	NA	
	Ex d IIC T6 Gb	4 to 20 mA HART	XA00514P/00	NB	

1) Product Configurator, order code for "Approval"

Directive	Approval	EPL	Electronics	Documentation	Option 1)
IECEx	Ex ia IIC	Ga/Gb	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00462P/00	IA
	Ex d IIIC	Gb	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00463P/00	IB
	Ex t IIIC	Da/Db	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00490P/00	ID

Directive	Approval	EPL	Electronics	Documentation	Option 1)
	Ex ic IIC	Gc	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00492P/00	IE
	Ex ia IIC Ex ia IIIC		4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA00491P/00	I1

1) Product Configurator, order code for "Approval"

Directive	Approval	Electronics	Documentation	Option 1)
INMETRO	Ex ia IIC T6T4 Ga/Gb	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA01303P/00	MA
	Ex d IIC T6/T4 Gb	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA01285P/00	MR

1) Product Configurator, order code for "Approval"

#### Installation/Control Drawings

Directive	Approval	Electronics	Documentation	Option <sup>1)</sup>
FM	IS Cl.I,II,III Div.1 Gr. A-G, AEx ia NI Cl. I Div.2 Gr.A-D	<ul> <li>4 to 20 mA HART</li> <li>PROFIBUS PA, FOUNDATION Fieldbus</li> </ul>	<ul><li>XA01158P/00</li><li>XA00565P/00</li></ul>	FA
	FM XP Cl.I,II Div.1 Gr.A-G Zone 1 IIC T6 (Conduit seal not required), Zone 1,2	4 to 20 mA HART, PROFIBUS PA, FOUNDATION Fieldbus	XA01164P/00	FB
	FM DIP Cl.II,III Div.1 Gr.E-G, Zone 21,22	-	-	FC
	FM NI Cl.I Div.2 Gr.A-D, Zone 2	-	-	FD
	FM IS/XP Cl.I,II Div.1 Gr.A-G, Zone 1,2	PROFIBUS PA, FOUNDATION Fieldbus	XA00568P/00	F1
CSA	C/US IS CI.I,II,III Div.1 Gr A-G C/US IS CI.I Div.2 Gr A-D, Ex ia	<ul> <li>4 to 20 mA HART</li> <li>PROFIBUS PA, FOUNDATION Fieldbus</li> </ul>	<ul><li>XA00557P/00</li><li>XA00559P/00</li></ul>	CA
	CSA C/US XP Cl.I,II Div.1 Gr.B-G, Ex d, (Conduit seal not required), Zone 1,2	-	-	СВ
	CSA C/US Cl.II,III Div.1 Gr.E-G, US: Zone 21,22	-	-	CC
	CSA C/US IS/XP CI.I,II Div.1Gr.A-G/B-G, Zone 1,2	<ul> <li>4 to 20 mA HART</li> <li>PROFIBUS PA, FOUNDATION Fieldbus</li> </ul>	<ul><li>XA00576P/00</li><li>XA00562P/00</li></ul>	C1

1) Product Configurator, order code for "Approval"

#### **Combination certificate**

Directive	Approval	Electronics	Documentation	Option 1)
FM/CSA	FM/CSA IS + XP Cl.I,II Div.1 Gr.A-D/B-G FM IS/FM XP Cl.I,II Div.1 Gr.A-G + CSA IS/XP Cl.I,II Div.1 Gr.A-G, FM/CSA: Zone 1,2	4 to 20 mA HART	<ul><li>XA01159P/00</li><li>XA00576P/00</li><li>ZD00250P/00</li></ul>	8B
		PROFIBUS PA, FOUNDATION Fieldbus	<ul><li>XA00568P/00</li><li>XA00562P/00</li></ul>	

1) Product Configurator, order code for "Approval"

Directive	Approval	Electronics	Documentation	Option <sup>1)</sup>
KEMA/ FM / CSA	KEMA/ FM / CSA ATEX II Ex ia + FM/CSA IS ATEX II 1/2G Ex ia IIC T6 + FM/CSA IS CL.I Div.1 Gr.A-D, FM/CSA: Zone 0,1,2	4 to 20 mA HART	<ul><li>ZD00236P/00</li><li>ZD00239P/00</li></ul>	8C
		PROFIBUS PA, FOUNDATION Fieldbus	XA00474P/00	

1) Product Configurator, order code for "Approval"

Manifolds	→ 🗎 37		
	For details see SD015	53P/00/EN "Mechanical accessories for pressure measuring devices".	
Additional mechanical accessoriesOval flange adapters, pressure gauge valves, shutoff valves, siphons, conde shortening kits, adapter test, flushing rings, block&bleed valves, protective			
	For details see SD015	53P/00/EN "Mechanical accessories for pressure measuring devices".	
Mounting bracket for wall and pipe mounting	→ 🗎 28		
M12 connector	→ 🗎 18		
Service-specific accessories	Accessories	Description	
	DeviceCare SFE100	Configuration tool for HART, PROFIBUS and FOUNDATION Fieldbus field devices	
		Technical Information TI01134S	
		DeviceCare is available for download at www.software-products.endress.com. You need to register in the Endress+Hauser software portal to download the application.	
	FieldCare SFE500	FDT-based plant asset management tool FieldCare can configure all smart field units in your plant and helps you manage them. By using the status information, FieldCare is also a simple but effective way of checking the status and condition of the field devices.	
		Technical Information TI00028S	

### Accessories

## **Registered trademarks**

HART <sup>®</sup> Registered trademark of the FieldComm Group, Austin, USA	
PROFIBUS®	Registered trademark of the PROFIBUS User Organization, Karlsruhe, Germany
FOUNDATION <sup>TM</sup> Fieldbus	Registered trademark of the FieldComm Group, Austin, USA



www.addresses.endress.com

