

# Technical Information

## iTEMP TMT72

Temperature transmitter



With HART<sup>®</sup> protocol and a selection of housing designs for different applications

### Application

- Universal temperature transmitter with HART<sup>®</sup> communication for the conversion of various input signals into a scalable, analog 4 to 20 mA output signal
- The iTEMP TMT72 is characterized by its reliability, long-term stability, high precision and advanced diagnostic function (important in critical processes).
- For the highest level of safety, reliability and risk reduction
- Universal input for resistance thermometers (RTD), thermocouples (TC), resistance transmitters ( $\Omega$ ), voltage transmitters (mV)
- Installation in terminal head, form B (flat face)
- Optional: installation in field housing for Ex d applications
- Optional: device design for DIN rail mounting

### Your benefits

- Safe operation in hazardous areas thanks to international approvals
- Reliable operation thanks to sensor and device monitoring
- Diagnostics information according to NAMUR NE107
- Attachable measured value display TID10, optional
- Integrated Bluetooth<sup>®</sup> interface for the wireless display of measured values and configuration via E+H SmartBlue (app), optional
- Fast and tool-free wiring thanks to optional spring terminals

## Table of contents


<b>Function and system design</b> . . . . .	<b>3</b>	<b>Operability</b> . . . . .	<b>20</b>
Measuring principle . . . . .	3	Local operation . . . . .	20
Measuring system . . . . .	3	For connecting a configuration tool . . . . .	20
<b>Input</b> . . . . .	<b>4</b>	Bluetooth® wireless technology . . . . .	20
Measured variable . . . . .	4	<b>Certificates and approvals</b> . . . . .	<b>21</b>
Measuring range . . . . .	4	CE mark . . . . .	21
<b>Output</b> . . . . .	<b>5</b>	EAC mark . . . . .	21
Output signal . . . . .	5	Ex approval . . . . .	21
Failure information . . . . .	5	CSA C/US . . . . .	21
Load . . . . .	6	HART® certification . . . . .	21
Linearization/transmission behavior . . . . .	6	Marine approvals . . . . .	21
Mains filter . . . . .	6	Radio approval . . . . .	21
Filter . . . . .	6	MTTF . . . . .	22
Protocol-specific data . . . . .	6	Other standards and guidelines . . . . .	22
Write protection for device parameters . . . . .	6	<b>Ordering information</b> . . . . .	<b>22</b>
Switch-on delay . . . . .	6	<b>Accessories</b> . . . . .	<b>23</b>
<b>Power supply</b> . . . . .	<b>7</b>	Device-specific accessories . . . . .	23
Supply voltage . . . . .	7	Communication-specific accessories . . . . .	23
Current consumption . . . . .	7	Service-specific accessories . . . . .	24
Electrical connection . . . . .	7	System components . . . . .	25
Terminals . . . . .	8	<b>Supplementary documentation</b> . . . . .	<b>25</b>
<b>Performance characteristics</b> . . . . .	<b>8</b>		
Response time . . . . .	8		
Refresh time . . . . .	8		
Reference operating conditions . . . . .	8		
Maximum measured error . . . . .	8		
Sensor adjustment . . . . .	11		
Current output adjustment . . . . .	11		
Operating influences . . . . .	11		
Influence of the reference junction . . . . .	15		
<b>Installation</b> . . . . .	<b>15</b>		
Installation instructions . . . . .	15		
<b>Environment</b> . . . . .	<b>16</b>		
Ambient temperature range . . . . .	16		
Storage temperature . . . . .	16		
Altitude . . . . .	16		
Humidity . . . . .	16		
Climate class . . . . .	16		
Degree of protection . . . . .	16		
Shock and vibration resistance . . . . .	16		
Electromagnetic compatibility (EMC) . . . . .	16		
Measuring category . . . . .	16		
Degree of contamination . . . . .	16		
<b>Mechanical construction</b> . . . . .	<b>17</b>		
Design, dimensions . . . . .	17		
Weight . . . . .	19		
Materials . . . . .	19		

## Function and system design

**Measuring principle**

Electronic recording and conversion of various input signals in industrial temperature measurement.

**Measuring system**

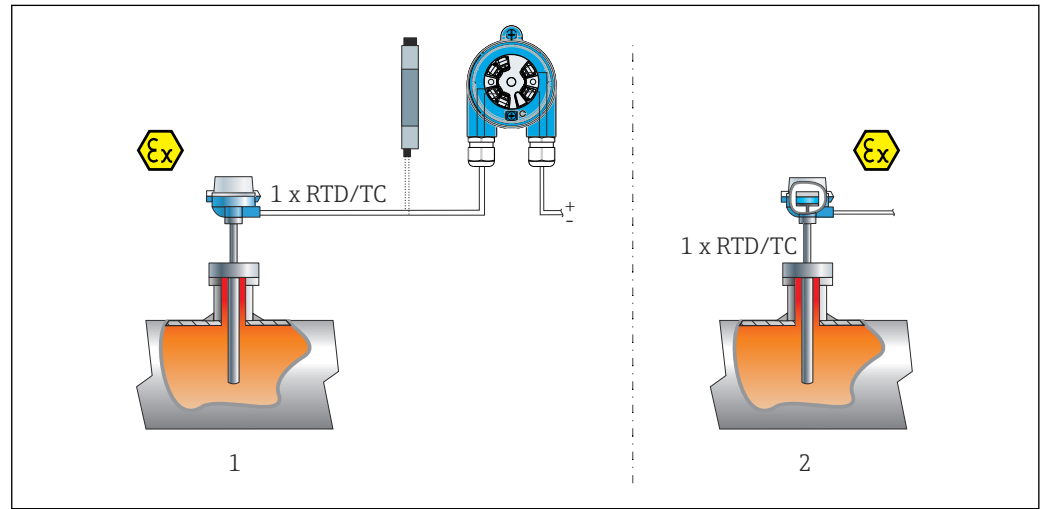

1 Application examples


- 1 An RTD or thermocouple sensor with transmitter in remote installation, e.g. head transmitter in field housing or DIN rail transmitter
- 2 Installed head transmitter - 1 x RTD/TC wired directly

Endress+Hauser offers a comprehensive range of industrial thermometers with resistance sensors or thermocouples.

When combined with the temperature transmitter, these components form a complete measuring point for a wide range of applications in the industrial sector.

The temperature transmitter is a 2-wire device with one measuring input and one analog output. The device not only transmits converted signals from resistance thermometers and thermocouples, it also transmits resistance and voltage signals using HART® communication and as a 4 to 20 mA current signal. It can be installed as an intrinsically safe apparatus in hazardous areas and is used for instrumentation purposes in the flat-face terminal head as per DIN EN 50446 or as a DIN rail device for installation in the cabinet on a TH35 mounting rail as per EN 60715.

Intuitive commissioning and operation - wireless access to all device data via Bluetooth using the SmartBlue app.

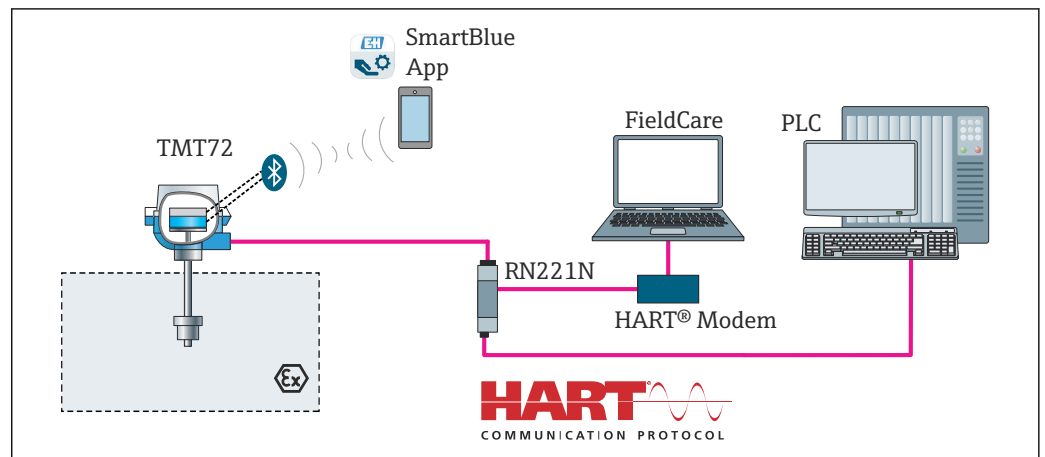

2 Device architecture for HART® communication

**Standard diagnostic functions**

- Cable open-circuit, short-circuit of sensor wires
- Incorrect wiring
- Internal device errors
- Overrange/underrange detection
- Device temperature overrange/underrange detection

**Corrosion detection as per NAMUR NE89**

Corrosion of the sensor connection cables can cause incorrect measured value readings. The transmitter makes it possible to detect corrosion of the thermocouples and mV transmitters, as well as resistance thermometers and ohmmeters with 4-wire connection, before a measured value is corrupted. The transmitter prevents incorrect measured values from being read out and can issue a warning via the HART® protocol if conductor resistance values exceed plausible limits.

**Low voltage detection**

The low voltage detection function prevents the device from continuously transmitting an incorrect analog output value (caused by an incorrect or damaged power supply system or a damaged signal cable). If the supply voltage drops below the required value, the analog output value drops to < 3.6 mA for approx. 5 s. The device then tries to output the normal analog output value again. If the supply voltage is still too low, this process is repeated cyclically.

**Diagnostics simulation**

Device diagnostics can be simulated. The following items are set during such simulations:

- Measured value status
- Current diagnostics information
- Status bit of HART command 48
- Current output value as per simulated diagnostics

This simulation makes it possible to check that all higher-level systems respond as expected.

## Input

**Measured variable**                      Temperature (temperature-linear transmission behavior), resistance and voltage.

Resistance thermometer (RTD) as per standard	Designation	$\alpha$	Measuring range limits	Min. span
IEC 60751:2008	Pt100 (1) Pt200 (2) Pt500 (3) Pt1000 (4)	0.003851	-200 to +850 °C (-328 to +1562 °F) -200 to +850 °C (-328 to +1562 °F) -200 to +500 °C (-328 to +932 °F) -200 to +500 °C (-328 to +932 °F)	10 K (18 °F)
JIS C1604:1984	Pt100 (5)	0.003916	-200 to +510 °C (-328 to +950 °F)	10 K (18 °F)
DIN 43760 IPTS-68	Ni100 (6) Ni120 (7)	0.006180	-60 to +250 °C (-76 to +482 °F) -60 to +250 °C (-76 to +482 °F)	10 K (18 °F)
GOST 6651-94	Pt50 (8) Pt100 (9)	0.003910	-185 to +1100 °C (-301 to +2012 °F) -200 to +850 °C (-328 to +1562 °F)	10 K (18 °F)
OIML R84: 2003, GOST 6651-2009	Cu50 (10) Cu100 (11)	0.004280	-180 to +200 °C (-292 to +392 °F) -180 to +200 °C (-292 to +392 °F)	10 K (18 °F)
	Ni100 (12) Ni120 (13)	0.006170	-60 to +180 °C (-76 to +356 °F) -60 to +180 °C (-76 to +356 °F)	10 K (18 °F)
OIML R84: 2003, GOST 6651-94	Cu50 (14)	0.004260	-50 to +200 °C (-58 to +392 °F)	10 K (18 °F)
-	Pt100 (Callendar van Dusen) Nickel polynomial Copper polynomial	-	The measuring range limits are specified by entering the limit values that depend on the coefficients A to C and R0.	10 K (18 °F)

Resistance thermometer (RTD) as per standard	Designation	$\alpha$	Measuring range limits	Min. span
	<ul style="list-style-type: none"> <li>Type of connection: 2-wire, 3-wire or 4-wire connection, sensor current: <math>\leq 0.3</math> mA</li> <li>With 2-wire circuit, compensation of wire resistance possible (0 to 30 <math>\Omega</math>)</li> <li>With 3-wire and 4-wire connection, sensor wire resistance up to max. 50 <math>\Omega</math> per wire</li> </ul>			
Resistance transmitter	Resistance $\Omega$		10 to 400 $\Omega$ 10 to 2 000 $\Omega$	10 $\Omega$ 10 $\Omega$

Thermocouples as per standard	Designation	Measuring range limits		Min. span
IEC 60584, Part 1 ASTM E230-3	Type A (W5Re-W20Re) (30)	0 to +2 500 °C (+32 to +4 532 °F)	Recommended temperature range: 0 to +2 500 °C (+32 to +4 532 °F)	50 K (90 °F)
	Type B (PtRh30-PtRh6) (31)	+40 to +1 820 °C (+104 to +3 308 °F)	+500 to +1 820 °C (+932 to +3 308 °F)	50 K (90 °F)
	Type E (NiCr-CuNi) (34)	-250 to +1 000 °C (-482 to +1 832 °F)	-150 to +1 000 °C (-238 to +1 832 °F)	50 K (90 °F)
	Type J (Fe-CuNi) (35)	-210 to +1 200 °C (-346 to +2 192 °F)	-150 to +1 200 °C (-238 to +2 192 °F)	50 K (90 °F)
	Type K (NiCr-Ni) (36)	-270 to +1 372 °C (-454 to +2 501 °F)	-150 to +1 200 °C (-238 to +2 192 °F)	50 K (90 °F)
	Type N (NiCrSi-NiSi) (37)	-270 to +1 300 °C (-454 to +2 372 °F)	-150 to +1 300 °C (-238 to +2 372 °F)	50 K (90 °F)
	Type R (PtRh13-Pt) (38)	-50 to +1 768 °C (-58 to +3 214 °F)	+50 to +1 768 °C (+122 to +3 214 °F)	50 K (90 °F)
	Type S (PtRh10-Pt) (39)	-50 to +1 768 °C (-58 to +3 214 °F)	+50 to +1 768 °C (+122 to +3 214 °F)	50 K (90 °F)
	Type T (Cu-CuNi) (40)	-200 to +400 °C (-328 to +752 °F)	-150 to +400 °C (-238 to +752 °F)	50 K (90 °F)
IEC 60584, Part 1 ASTM E230-3 ASTM E988-96	Type C (W5Re-W26Re) (32)	0 to +2 315 °C (+32 to +4 199 °F)	0 to +2 000 °C (+32 to +3 632 °F)	50 K (90 °F)
ASTM E988-96	Type D (W3Re-W25Re) (33)	0 to +2 315 °C (+32 to +4 199 °F)	0 to +2 000 °C (+32 to +3 632 °F)	50 K (90 °F)
DIN 43710	Type L (Fe-CuNi) (41)	-200 to +900 °C (-328 to +1 652 °F)	-150 to +900 °C (-238 to +1 652 °F)	50 K (90 °F)
	Type U (Cu-CuNi) (42)	-200 to +600 °C (-328 to +1 112 °F)	-150 to +600 °C (-238 to +1 112 °F)	
GOST R8.585-2001	Type L (NiCr-CuNi) (43)	-200 to +800 °C (-328 to +1 472 °F)	-200 to +800 °C (+328 to +1 472 °F)	50 K (90 °F)
	<ul style="list-style-type: none"> <li>Internal reference junction (Pt100)</li> <li>External preset value: configurable value -40 to +85 °C (-40 to +185 °F)</li> <li>Maximum sensor wire resistance 10 k<math>\Omega</math> (If the sensor wire resistance is greater than 10 k<math>\Omega</math>, an error message is output in accordance with NAMUR NE89.)</li> </ul>			
Voltage transmitter (mV)	Millivolt transmitter (mV)	-20 to 100 mV		5 mV

## Output

Output signal		
Analog output		4 to 20 mA, 20 to 4 mA (can be inverted)
Signal encoding		FSK $\pm 0.5$ mA via current signal
Data transmission rate		1200 baud
Galvanic isolation		U = 2 kV AC for 1 minute (input/output)

### Failure information


#### Failure information as per NAMUR NE43:

Failure information is created if the measuring information is missing or not valid. A complete list of all the errors occurring in the measuring system is created.

Underranging	Linear decrease from 4.0 to 3.8 mA
Overranging	Linear increase from 20.0 to 20.5 mA
Failure e.g. sensor failure; sensor short-circuit	$\leq 3.6$ mA ("low") or $\geq 21$ mA ("high"), can be selected The "high" alarm setting can be set between 21.5 mA and 23 mA, thus providing the flexibility needed to meet the requirements of various control systems.

**Load**

$R_{b \max} = (U_{b \max} - 10 \text{ V}) / 0.023 \text{ A}$  (current output). Valid for head transmitter

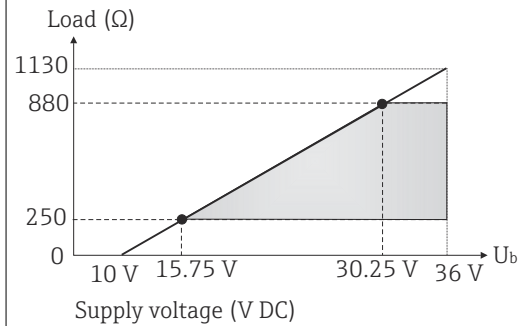

A0036051-EN

**Linearization/transmission behavior**

Temperature-linear, resistance-linear, voltage-linear

**Mains filter**

50/60 Hz

**Filter**

1st order digital filter: 0 to 120 s

**Protocol-specific data**

Manufacturer ID	17 (0x11)
Device type ID	0x11D0
HART® specification	7
Device address in multi-drop mode	Software setting addresses 0 to 63
Device description files (DTM, DD)	Information and files under: <a href="http://www.endress.com">www.endress.com</a> <a href="http://www.fieldcommgroup.org">www.fieldcommgroup.org</a>
HART load	min. 250 Ω
HART device variables	<p><b>Measured value for primary value (PV)</b> Sensor (measured value)</p> <p><b>Measured values for SV, TV, QV (secondary, tertiary and quaternary variable)</b></p> <ul style="list-style-type: none"> <li>▪ SV: device temperature</li> <li>▪ TV: sensor (measured value)</li> <li>▪ QV: sensor (measured value)</li> </ul>
Supported functions	<ul style="list-style-type: none"> <li>▪ Squawk</li> <li>▪ Condensed status</li> </ul>

*Wireless HART data*

Minimum starting voltage	10 V <sub>DC</sub>
Start-up current	3.58 mA
Starting time	7 s
Minimum operating voltage	10 V <sub>DC</sub>
Multidrop current	4.0 mA
Time for connection setup	9 s

**Write protection for device parameters**

- Hardware: Write protection for head transmitter on optional display using DIP switch
- Software: user role concept (password assignment)

**Switch-on delay**

≤ 7 s until the first valid measured value signal is present at the current output and until the start of HART® communication. While switch-on delay =  $I_a \leq 3.8 \text{ mA}$

## Power supply

### Supply voltage

Values for non-hazardous areas, protected against polarity reversal:

- Head transmitter:  $10\text{ V} \leq V_{CC} \leq 36\text{ V}$
- DIN rail device:  $11\text{ V} \leq V_{CC} \leq 36\text{ V}$


Values for hazardous areas, see Ex documentation .

### Current consumption

- 3.6 to 23 mA
- Minimum current consumption 3.5 mA
- Current limit  $\leq 23\text{ mA}$


### Electrical connection

#### Head transmitter

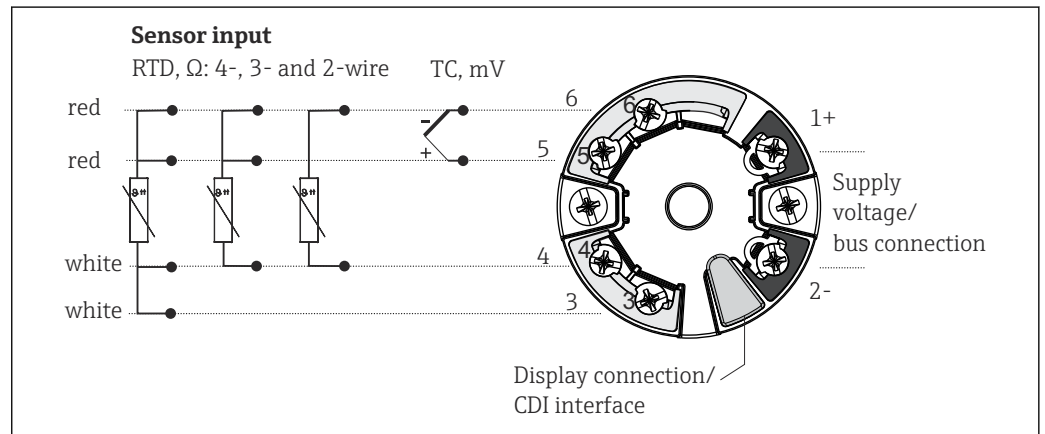

3 Assignment of terminal connections for head transmitter

#### DIN rail device

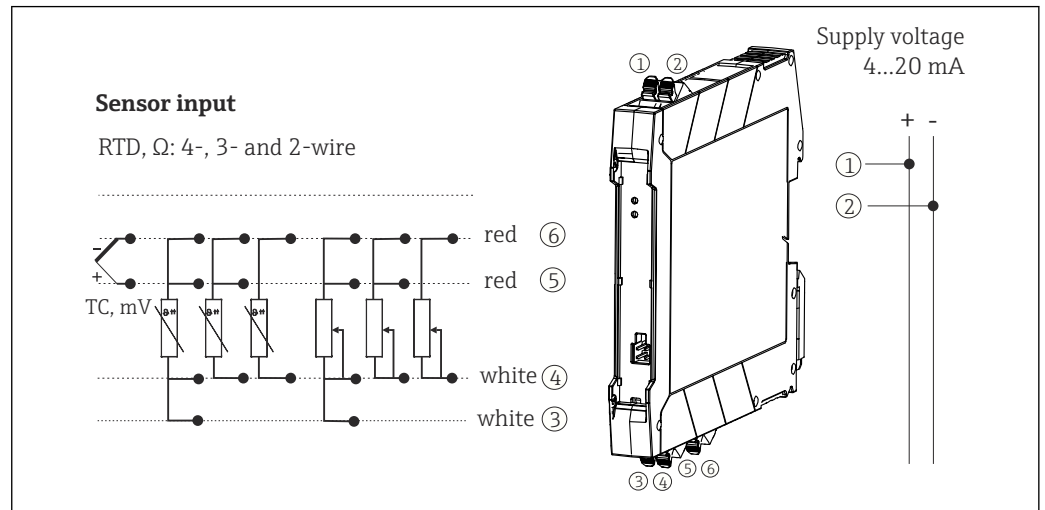

4 Assignment of terminal connections for DIN rail transmitter

In the case of the DIN rail version, a shielded cable must be used if the sensor cable length exceeds 30 m (98.4 ft). The use of shielded sensor cables is generally recommended.

To operate the device via the HART® protocol (terminals 1 and 2) a minimum load of 250  $\Omega$  is required in the signal circuit.

In the event of a thermocouple (TC) measurement, a 2-wire RTD can be connected to measure the cold junction temperature. This wire is connected to terminals 4 and 6.


**Terminals**

Choice of screw or push-in terminals for sensor and supply cables:

Terminal version	Cable version	Cable cross-section
<b>Screw terminals</b>	Rigid or flexible	$\leq 2.5 \text{ mm}^2$ (14 AWG)
<b>Push-in terminals</b> (cable version, stripping length = min. 10 mm (0.39 in))	Rigid or flexible	0.2 to 1.5 mm <sup>2</sup> (24 to 16 AWG)
	Flexible with wire end ferrules with/without plastic ferrule	0.25 to 1.5 mm <sup>2</sup> (24 to 16 AWG)

**Performance characteristics****Response time**

Resistance thermometer (RTD) and resistance transmitter ( $\Omega$ measurement)	$\leq 1 \text{ s}$
Thermocouples (TC) and voltage transmitters (mV)	$\leq 1 \text{ s}$
Reference temperature	$\leq 1 \text{ s}$

 When recording step responses, it must be taken into account that the times the internal reference measuring point are added to the specified times where applicable.

**Refresh time**

Approx. 100 ms

**Reference operating conditions**

- Calibration temperature:  $+25 \text{ °C} \pm 3 \text{ K}$  ( $77 \text{ °F} \pm 5.4 \text{ °F}$ )
- Supply voltage: 24 V DC
- 4-wire circuit for resistance adjustment

**Maximum measured error**

In accordance with DIN EN 60770 and the reference conditions specified above. The measured error data correspond to  $\pm 2 \sigma$  (Gaussian distribution). The data include non-linearities and repeatability.

MV = Measured value

LRV = Lower range value of relevant sensor

*Typical*

Standard	Designation	Measuring range	Typical measured error ( $\pm$ )	
<b>Resistance thermometer (RTD) as per standard</b>			Digital value <sup>1)</sup>	Value at current output
IEC 60751:2008	Pt100 (1)	0 to +200 °C (32 to +392 °F)	0.07 °C (0.13 °F)	0.10 °C (0.18 °F)
IEC 60751:2008	Pt1000 (4)		0.05 °C (0.09 °F)	0.08 °C (0.14 °F)
GOST 6651-94	Pt100 (9)		0.06 °C (0.11 °F)	0.09 °C (0.16 °F)
<b>Thermocouples (TC) as per standard</b>			Digital value <sup>1)</sup>	Value at current output
IEC 60584, Part 1	Type K (NiCr-Ni) (36)	0 to +800 °C (32 to +1472 °F)	0.60 °C (1.08 °F)	0.64 °C (1.15 °F)
IEC 60584, Part 1	Type S (PtRh10-Pt) (39)		1.83 °C (3.29 °F)	1.84 °C (3.31 °F)
GOST R8.585-2001	Type L (NiCr-CuNi) (43)		2.45 °C (4.41 °F)	2.46 °C (4.43 °F)

1) Measured value transmitted via HART®.



## Measured error for resistance thermometers (RTD) and resistance transmitters

Standard	Designation	Measuring range	Measured error ( $\pm$ )		D/A <sup>2)</sup>
			Digital <sup>1)</sup>		
			Maximum <sup>3)</sup>	Based on measured value <sup>4)</sup>	
IEC 60751:2008	Pt100 (1)	-200 to +850 °C (-328 to +1562 °F)	$\leq 0.1$ °C (0.19 °F)	ME = $\pm$ (0.05 °C (0.09 °F) + 0.006% * (MV - LRV))	0.03 % ( $\cong$ 4.8 $\mu$ A)
	Pt200 (2)		$\leq 0.20$ °C (0.36 °F)	ME = $\pm$ (0.08 °C (0.14 °F) + 0.011% * (MV - LRV))	
	Pt500 (3)	-200 to +510 °C (-328 to +950 °F)	$\leq 0.1$ °C (0.19 °F)	ME = $\pm$ (0.035 °C (0.063 °F) + 0.008% * (MV - LRV))	
	Pt1000 (4)	-200 to +250 °C (-328 to +482 °F)	$\leq 0.06$ °C (0.11 °F)	ME = $\pm$ (0.02 °C (0.04 °F) + 0.007% * (MV - LRV))	
JIS C1604:1984	Pt100 (5)	-200 to +510 °C (-328 to +950 °F)	$\leq 0.09$ °C (0.16 °F)	ME = $\pm$ (0.05 °C (0.09 °F) + 0.006% * (MV - LRV))	
GOST 6651-94	Pt50 (8)	-185 to +1100 °C (-301 to +2012 °F)	$\leq 0.18$ °C (0.32 °F)	ME = $\pm$ (0.07 °C (0.13 °F) + 0.008% * (MV - LRV))	
	Pt100 (9)	-200 to +850 °C (-328 to +1562 °F)	$\leq 0.11$ °C (0.2 °F)	ME = $\pm$ (0.05 °C (0.09 °F) + 0.006% * (MV - LRV))	
DIN 43760 IPTS-68	Ni100 (6)	-60 to +250 °C (-76 to +482 °F)	$\leq 0.04$ °C (0.07 °F)	ME = $\pm$ (0.04 °C (0.07 °F) - 0.004% * (MV - LRV))	
	Ni120 (7)				
OIML R84: 2003 / GOST 6651-2009	Cu50 (10)	-180 to +200 °C (-292 to +392 °F)	$\leq 0.10$ °C (0.19 °F)	ME = $\pm$ (0.08 °C (0.14 °F) + 0.006% * (MV - LRV))	0.03 % ( $\cong$ 4.8 $\mu$ A)
	Cu100 (11)	-180 to +200 °C (-292 to +392 °F)	$\leq 0.06$ °C (0.11 °F)	ME = $\pm$ (0.04 °C (0.07 °F) + 0.003% * (MV - LRV))	
	Ni100 (12)	-60 to +180 °C (-76 to +356 °F)	$\leq 0.04$ °C (0.07 °F)	ME = $\pm$ (0.04 °C (0.07 °F) - 0.004% * (MV - LRV))	
	Ni120 (13)				
OIML R84: 2003, GOST 6651-94	Cu50 (14)	-50 to +200 °C (-58 to +392 °F)	$\leq 0.10$ °C (0.18 °F)	ME = $\pm$ (0.09 °C (0.16 °F) + 0.004% * (MV - LRV))	
<b>Resistance transmitter</b>	Resistance $\Omega$	10 to 400 $\Omega$	29.5m $\Omega$	ME = $\pm$ 17 m $\Omega$ + 0.0034% * MV	0.03 % ( $\cong$ 4.8 $\mu$ A)
		10 to 2000 $\Omega$	179.4m $\Omega$	ME = $\pm$ 60 m $\Omega$ + 0.006% * MV	

- 1) Measured value transmitted via HART<sup>®</sup>.
- 2) Percentages based on the configured span of the analog output signal.
- 3) Maximum measured error for the specified measuring range.
- 4) Deviations from maximum measured error possible due to rounding.

## Measured error for thermocouples (TC) and voltage transmitters

Standard	Designation	Measuring range	Measured error ( $\pm$ )		D/A <sup>2)</sup>
			Digital <sup>1)</sup>		
			Maximum <sup>3)</sup>	Based on measured value <sup>4)</sup>	
IEC 60584-1 ASTM E230-3	Type A (30)	0 to +2500 °C (+32 to +4532 °F)	$\leq 1.65$ °C (2.97 °F)	ME = $\pm$ (1.0 °C (1.8 °F) + 0.018% * (MV - LRV))	0.03 % ( $\cong$ 4.8 $\mu$ A)
	Type B (31)	+500 to +1820 °C (+932 to +3308 °F)	$\leq 2.1$ °C (3.8 °F)	ME = $\pm$ (2.1 °C (3.8 °F) - 0.055% * (MV - LRV))	
IEC 60584-1 ASTM E230-3 ASTM E988-96	Type C (32)	0 to +2000 °C (+32 to +3632 °F)	$\leq 0.86$ °C (1.55 °F)	ME = $\pm$ (0.75 °C (1.35 °F) + 0.0055% * (MV - LRV))	
ASTM E988-96	Type D (33)		$\leq 1.1$ °C (1.98 °F)	ME = $\pm$ (1.1 °C (1.98 °F) - 0.008% * (MV - LRV))	

Standard	Designation	Measuring range	Measured error ( $\pm$ )		D/A <sup>2)</sup>
			Digital <sup>1)</sup>		
IEC 60584-1	Type E (34)	-150 to +1000 °C (-238 to +1832 °F)	$\leq 0.3$ °C (0.54 °F)	ME = $\pm$ (0.3 °C (0.54 °F) - 0.006% * (MV- LRV))	0.03 % ( $\cong$ 4.8 $\mu$ A)
	Type J (35)	-150 to +1200 °C (-238 to +2192 °F)	$\leq 0.36$ °C (0.65 °F)	ME = $\pm$ (0.36 °C (0.65 °F) - 0.005% * (MV- LRV))	
	Type K (36)		$\leq 0.5$ °C (0.9 °F)	ME = $\pm$ (0.5 °C (0.9 °F) - 0.005% * (MV- LRV))	
	Type N (37)	-150 to +1300 °C (-238 to +2372 °F)	$\leq 0.7$ °C (1.26 °F)	ME = $\pm$ (0.7 °C (1.26 °F) - 0.014% * (MV- LRV))	
	Type R (38)	+50 to +1768 °C (+122 to +3214 °F)	$\leq 1.6$ °C (2.88 °F)	ME = $\pm$ (1.6 °C (2.88 °F) - 0.026% * (MV- LRV))	
	Type S (39)		$\leq 1.6$ °C (2.88 °F)	ME = $\pm$ (1.6 °C (2.88 °F) - 0.022% * (MV- LRV))	
	Type T (40)	-150 to +400 °C (-238 to +752 °F)	$\leq 0.5$ °C (0.9 °F)	ME = $\pm$ (0.5 °C (0.9 °F) - 0.04% * (MV- LRV))	
DIN 43710	Type L (41)	-150 to +900 °C (-238 to +1652 °F)	$\leq 0.39$ °C (0.7 °F)	ME = $\pm$ (0.39 °C (0.7 °F) - 0.008% * (MV- LRV))	
	Type U (42)	-150 to +600 °C (-238 to +1112 °F)	$\leq 0.45$ °C (0.81 °F)	ME = $\pm$ (0.45 °C (0.81 °F) - 0.025% * (MV- LRV))	
GOST R8.585-2001	Type L (43)	-200 to +800 °C (-328 to +1472 °F)	$\leq 2.30$ °C (4.14 °F)	ME = $\pm$ (2.3 °C (4.14 °F) - 0.015% * (MV- LRV))	
<b>Voltage transmitter (mV)</b>		-20 to +100 mV	10.0 $\mu$ V	ME = $\pm$ 10.0 $\mu$ V	4.8 $\mu$ A

- 1) Measured value transmitted via HART®.
- 2) Percentages based on the configured span of the analog output signal.
- 3) Maximum measured error for the specified measuring range.
- 4) Deviations from maximum measured error possible due to rounding.

Total measured error of transmitter at current output =  $\sqrt{(\text{Measured error digital}^2 + \text{Measured error D/A}^2)}$

Sample calculation with Pt100, measuring range 0 to +200 °C (+32 to +392 °F), ambient temperature +25 °C (+77 °F), supply voltage 24 V:

Measured error digital = $0.05$ °C + $0.006\%$ x (200 °C - (-200 °C)):	0.07 °C (0.126 °F)
Measured error D/A = $0.03\%$ x 200 °C (360 °F)	0.06 °C (0.108 °F)
<b>Measured error digital value (HART):</b>	0.07 °C (0.126 °F)
<b>Measured error analog value (current output):</b> $\sqrt{(\text{Measured error digital}^2 + \text{Measured error D/A}^2)}$	0.10 °C (0.18 °F)

Sample calculation with Pt100, measuring range 0 to +200 °C (+32 to +392 °F), ambient temperature +35 °C (+95 °F), supply voltage 30 V:

Measured error digital = $0.04$ °C + $0.006\%$ x (200 °C - (-200 °C)):	0.07 °C (0.126 °F)
Measured error D/A = $0.03\%$ x 200 °C (360 °F)	0.06 °C (0.108 °F)
Influence of ambient temperature (digital) = $(35 - 25)$ x $(0.0013\%$ x 200 °C - (-200 °C)), min. 0.003 °C	0.05 °C (0.09 °F)
Influence of ambient temperature (D/A) = $(35 - 25)$ x $(0.003\%$ x 200 °C)	0.06 °C (0.108 °F)
Influence of supply voltage (digital) = $(30 - 24)$ x $(0.0007\%$ x 200 °C - (-200 °C)), min. 0.005 °C	0.02 °C (0.036 °F)

Influence of supply voltage (D/A) = (30 - 24) x (0.003% x 200 °C)	0.04 °C (0.72 °F)
<b>Measured error digital value (HART):</b> $\sqrt{(\text{Measured error digital})^2 + \text{Influence of ambient temperature (digital)}^2 + \text{Influence of supply voltage (digital)}^2}$	<b>0.10 °C (0.18 °F)</b>
<b>Measured error analog value (current output):</b> $\sqrt{(\text{Measured error digital})^2 + \text{Measured error D/A}^2 + \text{Influence of ambient temperature (digital)}^2 + \text{Influence of ambient temperature (D/A)}^2 + \text{Influence of supply voltage (digital)}^2 + \text{Influence of supply voltage (D/A)}^2}$	<b>0.13 °C (0.23 °F)</b>

The measured error data correspond to 2  $\sigma$  (Gaussian distribution).

Physical input measuring range of sensors	
10 to 400 $\Omega$	Cu50, Cu100, polynomial RTD, Pt50, Pt100, Ni100, Ni120
10 to 2 000 $\Omega$	Pt200, Pt500, Pt1000
-20 to 100 mV	Thermocouples type: A, B, C, D, E, J, K, L, N, R, S, T, U

## Sensor adjustment

### Sensor-transmitter-matching

RTD sensors are one of the most linear temperature measuring elements. Nevertheless, the output must be linearized. To significantly improve temperature measurement accuracy, the device allows the use of two methods:

- Callendar-Van Dusen coefficients (Pt100 resistance thermometer)

The Callendar-Van Dusen equation is described as:

$$R_T = R_0[1 + AT + BT^2 + C(T - 100)T^3]$$

The coefficients A, B and C are used to match the sensor (platinum) and transmitter in order to improve the accuracy of the measuring system. The coefficients for a standard sensor are specified in IEC 751. If no standard sensor is available or if greater accuracy is required, the coefficients for each sensor can be determined specifically with the aid of sensor calibration.

- Linearization for copper/nickel resistance thermometers (RTD)

The polynomial equation for copper/nickel is as follows:

$$R_T = R_0(1 + AT + BT^2)$$

The coefficients A and B are used for the linearization of nickel or copper resistance thermometers (RTD). The exact values of the coefficients derive from the calibration data and are specific to each sensor. The sensor-specific coefficients are then sent to the transmitter.

Sensor-transmitter-matching using one of the methods explained above significantly improves the temperature measurement accuracy of the entire system. This is because the transmitter uses the specific data pertaining to the connected sensor to calculate the measured temperature, instead of using the standardized sensor curve data.

### 1-point adjustment (offset)

Shifts the sensor value

## Current output adjustment

Correction of the 4 or 20 mA current output value.

## Operating influences

The measured error data correspond to 2  $\sigma$  (Gaussian distribution).

*Influence of ambient temperature and supply voltage on operation for resistance thermometers (RTD) and resistance transmitters*

Designation	Standard	Ambient temperature: Influence ( $\pm$ ) per 1 °C (1.8 °F) change			Supply voltage: Influence ( $\pm$ ) per V change		
		Digital <sup>1)</sup>		D/A <sup>2)</sup>	Digital <sup>1)</sup>		D/A <sup>2)</sup>
		Maximum	Based on measured value		Maximum	Based on measured value	
Pt100 (1)	IEC 60751:2008	$\leq 0.013$ °C (0.023 °F)	0.0013% * (MV - LRV), at least 0.003 °C (0.005 °F)	0.003 %	$\leq 0.007$ °C (0.013 °F)	0.0007% * (MV - LRV), at least 0.003 °C (0.005 °F)	0.003 %

Designation	Standard	Ambient temperature: Influence ( $\pm$ ) per 1 °C (1.8 °F) change		Supply voltage: Influence ( $\pm$ ) per V change			
		Digital <sup>1)</sup>		D/A <sup>2)</sup>	Digital <sup>1)</sup>		D/A <sup>2)</sup>
Pt200 (2)		$\leq 0.017$ °C (0.031 °F)	-		$\leq 0.009$ °C (0.016 °F)	-	
Pt500 (3)		$\leq 0.008$ °C (0.014 °F)	0.0013% * (MV - LRV), at least 0.006 °C (0.011 °F)		$\leq 0.004$ °C (0.007 °F)	0.0007% * (MV - LRV), at least 0.006 °C (0.011 °F)	
Pt1000 (4)		$\leq 0.005$ °C (0.009 °F)	-		$\leq 0.003$ °C (0.005 °F)	-	
Pt100 (5)	JIS C1604:1984	$\leq 0.009$ °C (0.016 °F)	0.0013% * (MV - LRV), at least 0.003 °C (0.005 °F)	0.003 %	$\leq 0.004$ °C (0.007 °F)	0.0007% * (MV - LRV), at least 0.003 °C (0.005 °F)	0.003 %
Pt50 (8)	GOST 6651-94	$\leq 0.017$ °C (0.031 °F)	0.0015% * (MV - LRV), at least 0.01 °C (0.018 °F)		$\leq 0.009$ °C (0.016 °F)	0.0007% * (MV - LRV), at least 0.01 °C (0.018 °F)	
Pt100 (9)		$\leq 0.013$ °C (0.023 °F)	0.0013% * (MV - LRV), at least 0.003 °C (0.005 °F)		$\leq 0.007$ °C (0.013 °F)	0.0007% * (MV - LRV), at least 0.003 °C (0.005 °F)	
Ni100 (6)	DIN 43760 IPTS-68	$\leq 0.003$ °C (0.005 °F)	-	0.003 %	$\leq 0.001$ °C (0.002 °F)	-	0.003 %
Ni120 (7)		$\leq 0.003$ °C (0.005 °F)	-		$\leq 0.001$ °C (0.002 °F)	-	
Cu50 (10)	OIML R84: 2003 / GOST 6651-2009	$\leq 0.005$ °C (0.009 °F)	-	0.003 %	$\leq 0.005$ °C (0.009 °F)	-	0.003 %
Cu100 (11)		$\leq 0.004$ °C (0.007 °F)	-		$\leq 0.004$ °C (0.007 °F)	-	
Ni100 (12)		$\leq 0.003$ °C (0.005 °F)	-		$\leq 0.003$ °C (0.005 °F)	-	
Ni120 (13)		$\leq 0.003$ °C (0.005 °F)	-		$\leq 0.003$ °C (0.005 °F)	-	
Cu50 (14)	OIML R84: 2003 / GOST 6651-94	$\leq 0.005$ °C (0.009 °F)	-		$\leq 0.005$ °C (0.009 °F)	-	
<b>Resistance transmitter (<math>\Omega</math>)</b>							
10 to 400 $\Omega$		$\leq 4$ m $\Omega$	0.001% * MV, at least 1 m $\Omega$	0.003 %	$\leq 2$ m $\Omega$	0.0005% * MV, at least 1 m $\Omega$	0.003 %
10 to 2 000 $\Omega$		$\leq 20$ m $\Omega$	0.001% * MV, at least 10 m $\Omega$		$\leq 10$ m $\Omega$	0.0005% * MV, at least 5 m $\Omega$	

1) Measured value transmitted via HART®.

2) Percentages based on the configured span of the analog output signal

#### *Influence of ambient temperature and supply voltage on operation for thermocouples (TC) and voltage transmitters*

Designation	Standard	Ambient temperature: Influence ( $\pm$ ) per 1 °C (1.8 °F) change		Supply voltage: Influence ( $\pm$ ) per V change			
		Digital <sup>1)</sup>		D/A <sup>2)</sup>	Digital		D/A <sup>2)</sup>
		Maximum	Based on measured value		Maximum	Based on measured value	
Type A (30)	IEC 60584-1 ASTM E230-3	$\leq 0.07$ °C (0.126 °F)	0.003% * (MV - LRV), at least 0.01 °C (0.018 °F)	0.003 %	$\leq 0.03$ °C (0.054 °F)	0.0012% * (MV - LRV), at least 0.013 °C (0.023 °F)	0.003 %
Type B (31)		$\leq 0.04$ °C (0.072 °F)	-		$\leq 0.02$ °C (0.036 °F)	-	
Type C (32)	IEC 60584-1 ASTM E230-3 ASTM E988-96	$\leq 0.04$ °C (0.072 °F)	0.0021% * (MV - LRV), at least 0.01 °C (0.018 °F)		$\leq 0.02$ °C (0.036 °F)	0.0012% * (MV - LRV), at least 0.013 °C (0.023 °F)	
Type D (33)	ASTM E988-96	$\leq 0.04$ °C (0.072 °F)	0.0019% * (MV - LRV), at least 0.01 °C (0.018 °F)		$\leq 0.02$ °C (0.036 °F)	0.0011% * (MV - LRV), at least 0.0 °C (0.0 °F)	
Type E (34)	IEC 60584-1	$\leq 0.02$ °C (0.036 °F)	0.0014% * (MV - LRV), at least 0.0 °C (0.0 °F)		$\leq 0.01$ °C (0.018 °F)	0.0008% * (MV - LRV), at least 0.0 °C (0.0 °F)	

Designation	Standard	Ambient temperature: Influence (±) per 1 °C (1.8 °F) change		Supply voltage: Influence (±) per V change			
		Digital <sup>1)</sup>	D/A <sup>2)</sup>	Digital	D/A <sup>2)</sup>		
Type J (35)	DIN 43710	≤ 0.02 °C (0.036 °F)	0.0014% * (MV - LRV), at least 0.0 °C (0.0 °F)	0.0008% * MV, at least 0.0 °C (0.0 °F)	0.003 %		
Type K (36)			0.0015% * (MV - LRV), at least 0.0 °C (0.0 °F)			≤ 0.01 °C (0.018 °F)	0.0009% * (MV - LRV), at least 0.0 °C (0.0 °F)
Type N (37)		0.0014% * (MV - LRV), at least 0.010 °C (0.018 °F)	0.0008% * MV, at least 0.0 °C (0.0 °F)				
Type R (38)		-	≤ 0.02 °C (0.036 °F)	-			
Type S (39)		-	-	-			
Type T (40)		-	0.0 °C (0.0 °F)	-			
Type L (41)		≤ 0.01 °C (0.018 °F)	-	≤ 0.01 °C (0.018 °F)		-	
Type U (42)		-	0.0 °C (0.0 °F)	-			
Type L (43)	GOST R8.585-2001	-	≤ 0.01 °C (0.018 °F)	-			
<b>Voltage transmitter (mV)</b>				0.003 %	≤ 0.8 μV	0.0008% * MV	0.003 %
-20 to 100 mV	-	≤ 1.5 μV	0.0015% * MV				

- 1) Measured value transmitted via HART®.  
2) Percentages based on the configured span of the analog output signal

MV = Measured value

LRV = Lower range value of relevant sensor

Total measured error of transmitter at current output =  $\sqrt{(\text{Measured error digital}^2 + \text{Measured error D/A}^2)}$

#### Long-term drift, resistance thermometers (RTD) and resistance transmitters

Designation	Standard	Long-term drift (±) <sup>1)</sup>				
		after 1 month	after 6 months	after 1 year	after 3 years	after 5 years
		Based on measured value				
Pt100 (1)	IEC 60751:2008	≤ 0.039% * (MV - LRV) or 0.01 °C (0.02 °F)	≤ 0.061% * (MV - LRV) or 0.02 °C (0.04 °F)	≤ 0.007% * (MV - LRV) or 0.02 °C (0.04 °F)	≤ 0.0093% * (MV - LRV) or 0.03 °C (0.05 °F)	≤ 0.0102% * (MV - LRV) or 0.03 °C (0.05 °F)
Pt200 (2)		0.05 °C (0.09 °F)	0.05 °C (0.09 °F)	0.09 °C (0.17 °F)	0.12 °C (0.27 °F)	0.13 °C (0.24 °F)
Pt500 (3)		≤ 0.048% * (MV - LRV) or 0.01 °C (0.02 °F)	≤ 0.0075% * (MV - LRV) or 0.02 °C (0.04 °F)	≤ 0.068% * (MV - LRV) or 0.03 °C (0.06 °F)	≤ 0.011% * (MV - LRV) or 0.03 °C (0.05 °F)	≤ 0.0124% * (MV - LRV) or 0.04 °C (0.07 °F)
Pt1000 (4)		≤ 0.0077% * (MV - LRV) or 0.02 °C (0.04 °F)	≤ 0.0088% * (MV - LRV) or 0.02 °C (0.04 °F)	≤ 0.0114% * (MV - LRV) or 0.03 °C (0.05 °F)	≤ 0.013% * (MV - LRV) or 0.03 °C (0.05 °F)	
Pt100 (5)	JIS C1604:1984	≤ 0.039% * (MV - LRV) or 0.01 °C (0.02 °F)	≤ 0.0061% * (MV - LRV) or 0.02 °C (0.04 °F)	≤ 0.007% * (MV - LRV) or 0.02 °C (0.04 °F)	≤ 0.0093% * (MV - LRV) or 0.03 °C (0.05 °F)	≤ 0.0102% * (MV - LRV) or 0.03 °C (0.05 °F)
Pt50 (8)	GOST 6651-94	≤ 0.042% * (MV - LRV) or 0.02 °C (0.04 °F)	≤ 0.0068% * (MV - LRV) or 0.04 °C (0.07 °F)	≤ 0.0076% * (MV - LRV) or 0.04 °C (0.08 °F)	≤ 0.01% * (MV - LRV) or 0.06 °C (0.11 °F)	≤ 0.011% * (MV - LRV) or 0.07 °C (0.12 °F)
Pt100 (9)		≤ 0.016% * (MV - LRV) or 0.04 °C (0.07 °F)	≤ 0.0061% * (MV - LRV) or 0.02 °C (0.04 °F)	≤ 0.007% * (MV - LRV) or 0.02 °C (0.04 °F)	≤ 0.0093% * (MV - LRV) or 0.03 °C (0.05 °F)	≤ 0.0102% * (MV - LRV) or 0.03 °C (0.05 °F)

Designation	Standard	Long-term drift ( $\pm$ ) <sup>1)</sup>					
Ni100 (6)	DIN 43760 IPTS-68	0.01 °C (0.02 °F)	0.01 °C (0.02 °F)	0.02 °C (0.04 °F)	0.02 °C (0.04 °F)	0.02 °C (0.04 °F)	
Ni120 (7)							
Cu50 (10)	OIML R84: 2003 / GOST 6651-2009	0.01 °C (0.02 °F)	0.02 °C (0.04 °F)	0.03 °C (0.05 °F)	0.04 °C (0.07 °F)	0.05 °C (0.09 °F)	0.05 °C (0.09 °F)
Cu100 (11)			0.02 °C (0.04 °F)	0.02 °C (0.04 °F)	0.03 °C (0.05 °F)	0.04 °C (0.07 °F)	
Ni100 (12)			0.01 °C (0.02 °F)	0.02 °C (0.04 °F)	0.02 °C (0.04 °F)	0.02 °C (0.04 °F)	0.02 °C (0.04 °F)
Ni120 (13)			0.01 °C (0.02 °F)	0.02 °C (0.04 °F)	0.02 °C (0.04 °F)	0.02 °C (0.04 °F)	0.02 °C (0.04 °F)
Cu50 (14)	OIML R84: 2003 / GOST 6651-94	0.02 °C (0.04 °F)	0.03 °C (0.05 °F)	0.04 °C (0.07 °F)	0.05 °C (0.09 °F)	0.05 °C (0.09 °F)	

**Resistance transmitter**

10 to 400 $\Omega$		$\leq 0.003\% * MV$ or 4 m $\Omega$	$\leq 0.0048\% * MV$ or 6 m $\Omega$	$\leq 0.0055\% * MV$ or 7 m $\Omega$	$\leq 0.0073\% * MV$ or 10 m $\Omega$	$\leq 0.008\% * (MV - LRV)$ or 11 m $\Omega$
10 to 2 000 $\Omega$		$\leq 0.0038\% * MV$ or 25 m $\Omega$	$\leq 0.006\% * MV$ or 40 m $\Omega$	$\leq 0.007\% * (MV - LRV)$ or 47 m $\Omega$	$\leq 0.009\% * (MV - LRV)$ or 60 m $\Omega$	$\leq 0.0067\% * (MV - LRV)$ or 67 m $\Omega$

1) Whichever is greater

*Long-term drift, thermocouples (TC) and voltage transmitters*

Designation	Standard	Long-term drift ( $\pm$ ) <sup>1)</sup>				
		after 1 month	after 6 months	after 1 year	after 3 years	after 5 years
		Based on measured value				
Type A (30)	IEC 60584-1 ASTM E230-3	$\leq 0.021\% * (MV - LRV)$ or 0.34 °C (0.61 °F)	$\leq 0.037\% * (MV - LRV)$ or 0.59 °C (1.06 °F)	$\leq 0.044\% * (MV - LRV)$ or 0.70 °C (1.26 °F)	$\leq 0.058\% * (MV - LRV)$ or 0.93 °C (1.67 °F)	$\leq 0.063\% * (MV - LRV)$ or 1.01 °C (1.82 °F)
Type B (31)		0.80 °C (1.44 °F)	1.40 °C (2.52 °F)	1.66 °C (2.99 °F)	2.19 °C (3.94 °F)	2.39 °C (4.30 °F)
Type C (32)	IEC 60584-1 ASTM E230-3 ASTM E988-96	0.34 °C (0.61 °F)	0.58 °C (1.04 °F)	0.70 °C (1.26 °F)	0.92 °C (1.66 °F)	1.00 °C (1.80 °F)
Type D (33)	ASTM E988-96	0.42 °C (0.76 °F)	0.73 °C (1.31 °F)	0.87 °C (1.57 °F)	1.15 °C (2.07 °F)	1.26 °C (2.27 °F)
Type E (34)	IEC 60584-1	0.13 °C (0.23 °F)	0.22 °C (0.40 °F)	0.26 °C (0.47 °F)	0.34 °C (0.61 °F)	0.37 °C (0.67 °F)
Type J (35)		0.15 °C (0.27 °F)	0.26 °C (0.47 °F)	0.31 °C (0.56 °F)	0.41 °C (0.74 °F)	0.44 °C (0.79 °F)
Type K (36)		0.17 °C (0.31 °F)	0.30 °C (0.54 °F)	0.36 °C (0.65 °F)	0.47 °C (0.85 °F)	0.51 °C (0.92 °F)
Type N (37)		0.25 °C (0.45 °F)	0.44 °C (0.79 °F)	0.52 °C (0.94 °F)	0.69 °C (1.24 °F)	0.75 °C (1.35 °F)
Type R (38)		0.62 °C (1.12 °F)	1.08 °C (1.94 °F)	1.28 °C (2.30 °F)	1.69 °C (3.04 °F)	1.85 °C (3.33 °F)
Type S (39)		0.62 °C (1.12 °F)	1.08 °C (1.94 °F)	1.29 °C (2.32 °F)	1.70 °C (3.06 °F)	
Type T (40)		0.18 °C (0.32 °F)	0.32 °C (0.58 °F)	0.38 °C (0.68 °F)	0.50 °C (0.90 °F)	0.54 °C (0.97 °F)
Type L (41)	DIN 43710	0.12 °C (0.22 °F)	0.21 °C (0.38 °F)	0.25 °C (0.45 °F)	0.33 °C (0.59 °F)	0.36 °C (0.65 °F)
Type U (42)		0.18 °C (0.32 °F)	0.31 °C (0.56 °F)	0.37 °C (0.67 °F)	0.49 °C (0.88 °F)	0.53 °C (0.95 °F)
Type L (43)	GOST R8.585-2001	0.15 °C (0.27 °F)	0.26 °C (0.47 °F)	0.31 °C (0.56 °F)	0.41 °C (0.74 °F)	0.44 °C (0.79 °F)

**Voltage transmitter (mV)**

- 20 to 100 mV		$\leq 0.012\% * MV$ or 4 $\mu V$	$\leq 0.021\% * MV$ or 7 $\mu V$	$\leq 0.025\% * MV$ or 8 $\mu V$	$\leq 0.033\% * MV$ or 11 $\mu V$	$\leq 0.036\% * MV$ or 12 $\mu V$
-------------------	--	----------------------------------	----------------------------------	----------------------------------	-----------------------------------	-----------------------------------

1) Whichever is greater

*Analog output long-term drift*


D/A long-term drift <sup>1)</sup> (±)				
after 1 month	after 6 months	after 1 year	after 3 years	after 5 years
0.018%	0.026%	0.030%	0.036%	0.038%

1) Percentages based on the configured span of the analog output signal.

**Influence of the reference junction**

Pt100 DIN IEC 60751 Cl. B (internal reference junction with thermocouples TC)

If an external 2-wire Pt100 is used for the reference junction measurement, the measured error caused by the transmitter is < 0.5 °C (0.9 °F). The measured error of the sensor element also needs to be added.

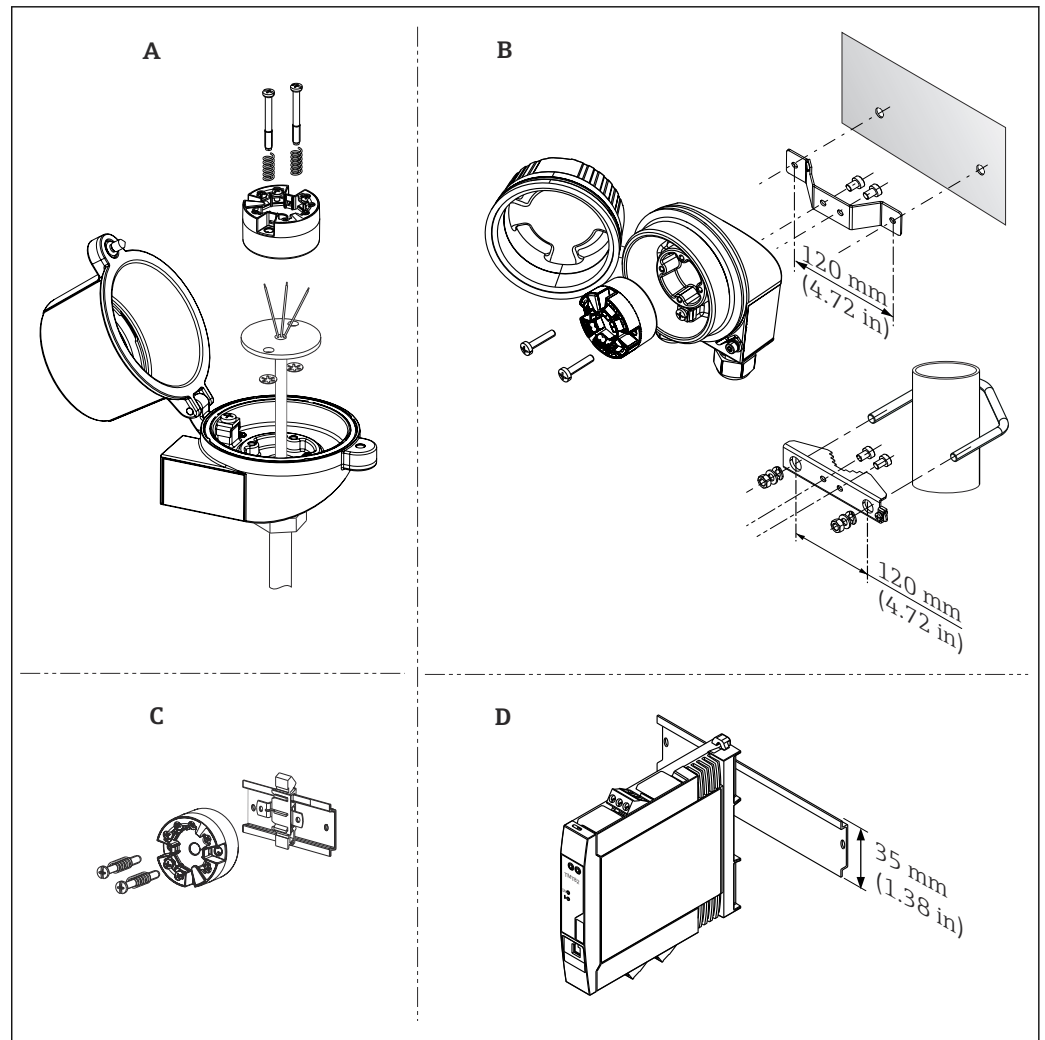**Installation****Installation instructions**

A0017817

5 Installation options for transmitter

- A Terminal head, form B (flat face) as per DIN EN 50446, direct installation on insert with cable entry (middle hole 7 mm (0.28 in))
- B Separated from process in field housing, wall or pipe mounting
- C With clip on DIN rail as per IEC 60715 (TH35)
- D DIN rail device for mounting on a TH35 mounting rail as per EN 60715

**Orientation**

When using DIN rail devices with a thermocouple/mV measurement, increased measurement deviation may occur depending on the installation situation and ambient conditions. If the DIN rail device is mounted on the DIN rail without any adjacent devices, this may result in deviations of  $\pm 1.34$  °C. If the DIN rail device is mounted in series between other DIN rail devices (reference operating condition: 24 V, 12 mA), deviations of max. +2.94 °C may occur.

## Environment

---

<b>Ambient temperature range</b>	-40 to +85 °C (-40 to +185 °F), for hazardous areas see Ex documentation
<b>Storage temperature</b>	<ul style="list-style-type: none"> <li>▪ Head transmitter: -50 to +100 °C (-58 to +212 °F)</li> <li>▪ DIN rail device: -40 to +100 °C (-40 to +212 °F)</li> </ul>
<b>Altitude</b>	Up to 4000 m (4374.5 yards) above mean sea level as per IEC 61010-1, CAN/CSA C22.2 No. 61010-1
<b>Humidity</b>	<ul style="list-style-type: none"> <li>▪ Condensation: <ul style="list-style-type: none"> <li>▪ Head transmitter permitted</li> <li>▪ DIN rail transmitter not permitted</li> </ul> </li> <li>▪ Max. rel. humidity: 95% as per IEC 60068-2-30</li> </ul>
<b>Climate class</b>	<ul style="list-style-type: none"> <li>▪ Head transmitter: climate class C1 as per IEC 60654-1</li> <li>▪ DIN rail device: climate class B2 as per IEC 60654-1</li> </ul>
<b>Degree of protection</b>	<ul style="list-style-type: none"> <li>▪ Head transmitter with screw terminals: IP 00, with spring terminals: IP 30. In installed state, depends on the terminal head or field housing used.</li> <li>▪ When installing in field housing TA30A, TA30D or TA30H: IP 66/68 (NEMA Type 4x incl.)</li> <li>▪ DIN rail device: IP 20</li> </ul>
<b>Shock and vibration resistance</b>	<p>Vibration resistance as per DNVGL-CG-0339 : 2015 and DIN EN 60068-2-27</p> <ul style="list-style-type: none"> <li>▪ Head transmitter: 2 to 100 Hz at 4g (increased vibration stress)</li> <li>▪ DIN rail device: 2 to 100 Hz at 0.7g (general vibration stress)</li> </ul> <p>Shock resistance as per KTA 3505 (section 5.8.4 Shock test)</p>
<b>Electromagnetic compatibility (EMC)</b>	<p><b>CE compliance</b></p> <p>Electromagnetic compatibility in accordance with all the relevant requirements of the IEC/EN 61326 series and NAMUR Recommendation EMC (NE21). For details, refer to the Declaration of Conformity. All tests were passed both with and without ongoing digital HART®-communication.</p> <p>Maximum measured error &lt;1% of measuring range.</p> <p>Interference immunity as per IEC/EN 61326 series, industrial requirements</p> <p>Interference emission as per IEC/EN 61326 series, Class B equipment</p>
<b>Measuring category</b>	Measuring category II as per IEC 61010-1. The measuring category is provided for measuring on power circuits that are directly connected electrically with the low-voltage network.
<b>Degree of contamination</b>	Pollution degree 2 as per IEC 61010-1.




## Mechanical construction

### Design, dimensions

Dimensions in mm (in)


#### Head transmitter

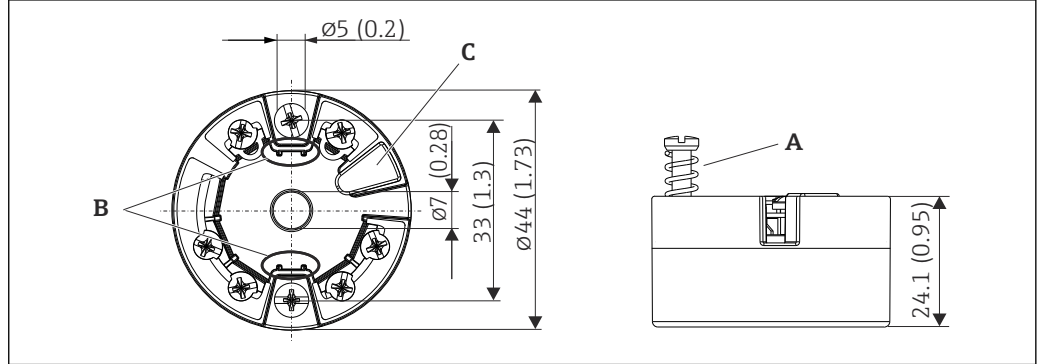

A0036303

6 Version with screw terminals


- A Spring travel  $L \geq 5$  mm (not for US - M4 securing screws)
- B Mounting elements for attachable measured value display TID10
- C Interface for connecting measured value display or configuration tool

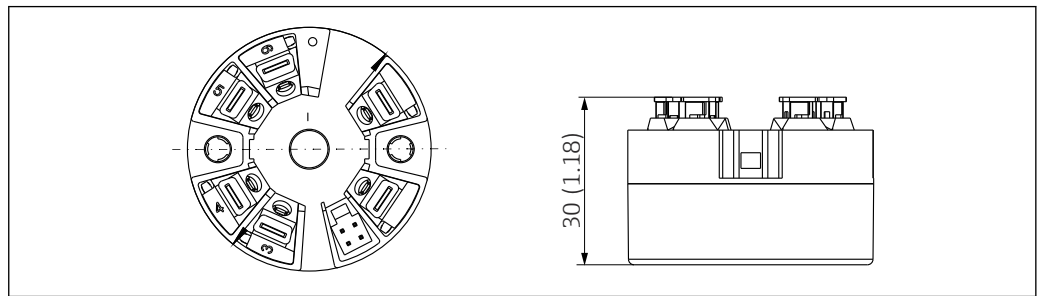

A0036304

7 Version with push-in terminals. Dimensions are identical to the version with screw terminals, apart from housing height.

#### DIN rail device

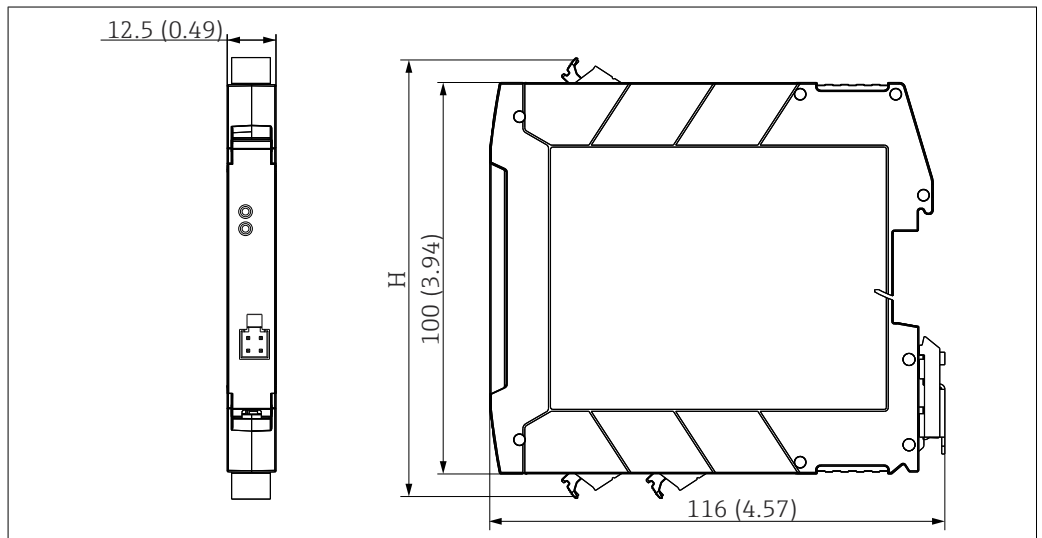

A0039296

Height of housing H varies depending on the terminal version:

- Screw terminals: H = 114 mm (4.49 in)
- Push-in terminals: H = 111.5 mm (4.39 in)

### Field housing

All field housings have an internal geometry in accordance with DIN EN 50446, form B (flat face).  
Cable glands in the diagrams: M20x1.5

Maximum ambient temperatures for cable glands	
Type	Temperature range
Polyamide cable gland ½" NPT, M20x1.5 (non-Ex)	-40 to +100 °C (-40 to 212 °F)
Polyamide cable gland M20x1.5 (for dust ignition-proof area)	-20 to +95 °C (-4 to 203 °F)
Brass cable gland ½" NPT, M20x1.5 (for dust ignition-proof area)	-20 to +130 °C (-4 to +266 °F)

TA30A	Specification
	<ul style="list-style-type: none"> <li>■ Two cable entries</li> <li>■ Temperature: -50 to +150 °C (-58 to +302 °F) without cable gland</li> <li>■ Material: aluminum, polyester powder coated</li> <li>■ Seals: silicone</li> <li>■ Cable entry glands: 1/2" NPT and M20x1.5</li> <li>■ Color of head: blue, RAL 5012</li> <li>■ Color of cap: gray, RAL 7035</li> <li>■ Weight: 330 g (11.64 oz)</li> </ul>

TA30A with display window in cover	Specification
	<ul style="list-style-type: none"> <li>■ Two cable entries</li> <li>■ Temperature: -50 to +150 °C (-58 to +302 °F) without cable gland</li> <li>■ Material: aluminum, polyester powder coated</li> <li>■ Seals: silicone</li> <li>■ Cable entry glands: 1/2" NPT and M20x1.5</li> <li>■ Color of head: blue, RAL 5012</li> <li>■ Color of cap: gray, RAL 7035</li> <li>■ Weight: 420 g (14.81 oz)</li> </ul>

TA30H	Specification
	<ul style="list-style-type: none"> <li>■ Flameproof (XP) version, explosion-protected, captive screw cap, with two cable entries</li> <li>■ Temperature: -50 to +150 °C (-58 to +302 °F) for rubber seal without cable gland (observe max. permitted temperature of cable gland!)</li> <li>■ Material: <ul style="list-style-type: none"> <li>■ Aluminum with polyester powder coating</li> <li>■ Stainless steel 316L without coating</li> </ul> </li> <li>■ Cable entry glands: ½" NPT, M20x1.5</li> <li>■ Color of aluminum head: blue, RAL 5012</li> <li>■ Color of aluminum cap: gray, RAL 7035</li> <li>■ Weight: <ul style="list-style-type: none"> <li>■ Aluminum: approx. 640 g (22.6 oz)</li> <li>■ Stainless steel: approx. 2 400 g (84.7 oz)</li> </ul> </li> </ul>

TA30H with display window in cover	Specification
	<ul style="list-style-type: none"> <li>▪ Flameproof (XP) version, explosion-protected, captive screw cap, with two cable entries</li> <li>▪ Temperature: -50 to +150 °C (-58 to +302 °F) for rubber seal without cable gland (observe max. permitted temperature of cable gland!)</li> <li>▪ Material:             <ul style="list-style-type: none"> <li>▪ Aluminum with polyester powder coating</li> <li>▪ Stainless steel 316L without coating</li> </ul> </li> <li>▪ Cable entry glands: ½" NPT, M20x1.5</li> <li>▪ Color of aluminum head: blue, RAL 5012</li> <li>▪ Color of aluminum cap: gray, RAL 7035</li> <li>▪ Weight:             <ul style="list-style-type: none"> <li>▪ Aluminum: approx. 860 g (30.33 oz)</li> <li>▪ Stainless steel: approx. 2 900 g (102.3 oz)</li> </ul> </li> </ul>

TA30D	Specification
	<ul style="list-style-type: none"> <li>▪ 2 cable entries</li> <li>▪ Temperature: -50 to +150 °C (-58 to +302 °F) without cable gland</li> <li>▪ Material: aluminum, polyester powder coated</li> <li>▪ Seals: silicone</li> <li>▪ Cable entry glands: 1/2" NPT and M20x1.5</li> <li>▪ Two head transmitters can be mounted. In the standard configuration one transmitter is mounted in the terminal head cover and an additional terminal block is installed directly on the insert.</li> <li>▪ Color of head: blue, RAL 5012</li> <li>▪ Color of cap: gray, RAL 7035</li> <li>▪ Weight: 390 g (13.75 oz)</li> </ul>

**Weight**

- Head transmitter: approx. 40 to 50 g (1.4 to 1.8 oz)
- Field housing: see specifications
- DIN rail device: approx. 100 g (3.53 oz)

**Materials**

All the materials used are RoHS-compliant.

- Housing: polycarbonate (PC)
- Terminals:
  - Screw terminals: nickel-plated brass and gold-plated contacts
  - Push-in terminals: tin-plated brass, contact springs 1.4310, 301 (AISI)
- Potting compound:
  - Head transmitter: QSIL 553
  - DIN rail housing: Silgel612EH


Field housing: see specifications

## Operability

### Local operation

#### Head transmitter

The head transmitter has no display or operating elements. There is the option of using the attachable measured value display TID10 together with the head transmitter. The display provides plain-text information on the current measured value and the measuring point identification. An optional bar graph is also used. In the event of a fault in the measurement chain, this will be displayed in inverse color showing the channel ident and error number. DIP switches can be found on the rear of the display. These enable hardware settings to be made e.g. write protection.

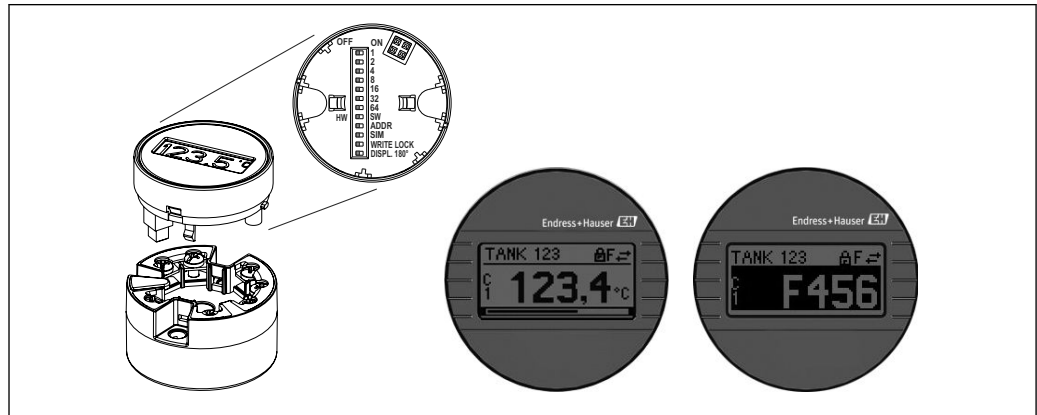

A0020347

8 Attachable measured value display TID10 with bar graph indicator (optional)

**i** If the head transmitter is installed in a field housing and used with a display, an enclosure with a glass window in the cover must be used.

#### DIN rail device

	1: Power LED	A green LED indicates that the voltage supply is correct
	2: Status LED	Off: no diagnostic message Red: Category F diagnostic message Red flashing: Category C, S or M diagnostic message
	3: Service interface	For connecting a configuration tool

A0039313


#### For connecting a configuration tool

The configuration of HART® functions and device-specific parameters takes place via HART®-communication or the CDI interface (service interface) of the device. There are special configuration tools from different manufacturers available for this purpose. For more information, contact your Endress+Hauser sales representative.

#### Bluetooth® wireless technology

The device has an optional Bluetooth® wireless technology interface and can be operated and configured using the SmartBlue app.

- The range under reference conditions is:
  - 10 m (33 ft) when installed in the terminal head or field housing with display window, or in the DIN rail housing
  - 5 m (16.4 ft) when installed in the terminal head or field housing
- Incorrect operation by unauthorized persons is prevented by means of encrypted communication and password encryption
- The Bluetooth® wireless technology interface can be deactivated

 However, simultaneous use of the Bluetooth® wireless technology interface and attachable measured value display is not possible.

## Certificates and approvals

<b>CE mark</b>	The product meets the requirements of the harmonized European standards. As such, it complies with the legal specifications of the EC directives. The manufacturer confirms successful testing of the product by affixing to it the CE-mark.
<b>EAC mark</b>	The product meets the legal requirements of the EEU guidelines. The manufacturer confirms the successful testing of the product by affixing the EAC mark.
<b>Ex approval</b>	Information about currently available Ex versions (ATEX, FM, CSA, etc.) can be supplied by your E+H Sales Center on request. All explosion protection data are given in separate documentation which is available upon request.
<b>CSA C/US</b>	The device complies with the requirements of "CLASS 2252 05 - Process Control Equipment" and "CLASS 2252 85 - Process Control Equipment - Certified to US Standards".
<b>HART® certification</b>	The temperature transmitter is registered by the HART® Communication Foundation. The device meets the requirements of the HART® Communication Protocol Specifications, Revision 7.
<b>Marine approvals</b>	For the type approval certificates (DNVGL, etc.) currently available, please contact your Sales Center for information. All data relating to shipbuilding can be found in separate type approval certificates which can be requested as needed.
<b>Radio approval</b>	The device has Bluetooth® radio approval in accordance with the Radio Equipment Directive (RED) and the Federal Communications Commission (FCC) 15.247 for the USA.

Europe	
This device meets the requirements of the Radio Equipment Directive RED 2014/53/EU:	<ul style="list-style-type: none"> <li>▪ EN 300 328</li> <li>▪ EN 301 489-1</li> <li>▪ EN 301 489-17</li> </ul>

Canada and USA	
<p>English:</p> <p>This device complies with Part 15 of the FCC Rules and with Industry Canada licenceexempt RSS standard(s).</p> <p>Operation is subject to the following two conditions:</p> <ul style="list-style-type: none"> <li>▪ This device may not cause harmful interference, and</li> <li>▪ This device must accept any interference received, including interference that may cause undesired operation.</li> </ul> <p>Changes or modifications made to this equipment not expressly approved by Endress+Hauser may void the user's authorization to operate this equipment.</p> <p>This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation.</p> <p>If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:</p> <ul style="list-style-type: none"> <li>▪ Reorient or relocate the receiving antenna.</li> <li>▪ Increase the separation between the equipment and receiver.</li> <li>▪ Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.</li> <li>▪ Consult the dealer or an experienced radio/TV technician for help.</li> </ul> <p>This equipment complies with FCC and IC radiation exposure limits set forth for an uncontrolled environment. This equipment should be installed and operated with minimum distance 20cm between the radiator and your body.</p>	<p>Français:</p> <p>Le présent appareil est conforme aux CNR d'industrie Canada applicables aux appareils radio exempts de licence.</p> <p>L'exploitation est autorisée aux deux conditions suivantes :</p> <ul style="list-style-type: none"> <li>▪ L'appareil ne doit pas produire de brouillage, et</li> <li>▪ L'utilisateur de l'appareil doit accepter tout brouillage radioélectrique subi, même si le brouillage est susceptible d'en compromettre le fonctionnement.</li> </ul> <p>Les changements ou modifications apportées à cet appareil non expressément approuvée par Endress+Hauser peut annuler l'autorisation de l'utilisateur d'opérer cet appareil.</p> <p>Déclaration d'exposition aux radiations: Cet équipement est conforme aux limites d'exposition aux rayonnements IC établies pour un environnement non contrôlé. Cet équipement doit être installé et utilisé avec un minimum de 20 cm de distance entre la source de rayonnement et votre corps.</p>

**MTTF**

- Without Bluetooth® wireless technology: 168 years
- With Bluetooth® wireless technology: 123 years

The mean time to failure (MTTF) denotes the theoretically expected time until the device fails during normal operation. The term MTTF is used for non-repairable systems such as temperature transmitters.

**Other standards and guidelines**

- IEC 60529:  
Degrees of protection provided by enclosures (IP code)
- IEC/EN 61010-1:  
Safety requirements for electrical equipment for measurement, control and laboratory use
- IEC/EN 61326 series:  
Electromagnetic compatibility (EMC requirements)
- This Class B digital apparatus complies with Canadian ICES-003  
Cet appareil numérique de la classe B est conforme à la norme NMB-003 du Canada.  
Compliance Label: CAN ICES-3 (B)/NMB-3(B)

**Ordering information**

Detailed ordering information is available for your nearest sales organization [www.addresses.endress.com](http://www.addresses.endress.com) or in the Product Configurator under [www.endress.com](http://www.endress.com) :

1. Click Corporate
2. Select the country

3. Click Products
4. Select the product using the filters and search field
5. Open the product page

The Configuration button to the right of the product image opens the Product Configurator.



#### Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
- Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

## Accessories

Various accessories, which can be ordered with the device or subsequently from Endress+Hauser, are available for the device. Detailed information on the order code in question is available from your local Endress+Hauser sales center or on the product page of the Endress+Hauser website: [www.endress.com](http://www.endress.com).

Accessories included in the scope of delivery:

- Multilingual Brief Operating Instructions as hard copy
- ATEX supplementary documentation: ATEX Safety instructions (XA), Control Drawings (CD)
- Mounting material for head transmitter



### Device-specific accessories

Accessories
TID10 display unit for Endress+Hauser head transmitter iTEMP TMT8x <sup>1)</sup> or TMT7x, attachable
TID10 service cable; connecting cable for service interface, 40 cm
Field housing TA30x for Endress+Hauser head transmitter
Adapter for DIN rail mounting, clip as per IEC 60715 (TH35) without securing screws
Standard - DIN mounting set (2 screws + springs, 4 securing disks and 1 display connector cover)
US - M4 Mounting screws (2 M4 screws and 1 display connector cover)
Stainless steel wall mounting bracket Stainless steel pipe mounting bracket



1) Without TMT80

### Communication-specific accessories

Accessories	Description
Commubox FXA195 HART	For intrinsically safe HART® communication with FieldCare via the USB interface. For details, see Technical Information TI404F/00
Commubox FXA291	Connects Endress+Hauser field devices with a CDI interface (= Endress+Hauser Common Data Interface) and the USB port of a computer or laptop. For details, see Technical Information TI405C/07

Accessories	Description
WirelessHART adapter	<p>Is used for the wireless connection of field devices. The WirelessHART® adapter can be easily integrated into field devices and existing infrastructures, offers data protection and transmission safety and can be operated in parallel with other wireless networks.</p> <p> For details, see Operating Instructions BA061S/04</p>
Field Xpert SMT70	<p>Universal, high-performance tablet PC for device configuration The tablet PC enables mobile plant asset management in hazardous and non-hazardous areas. It is suitable for commissioning and maintenance staff to manage field instruments with a digital communication interface and to record progress. This tablet PC is designed as a comprehensive, all-in-one solution. With a pre-installed driver library, it is an easy-to-use, touch-sensitive tool which can be used to manage field instruments throughout their entire life cycle.</p> <p> For details, see Technical Information TI01342S/04</p>




## Service-specific accessories

Accessories	Description
Applicator	<p>Software for selecting and sizing Endress+Hauser measuring devices:</p> <ul style="list-style-type: none"> <li>■ Calculation of all the necessary data for identifying the optimum measuring device: e.g. pressure loss, accuracy or process connections.</li> <li>■ Graphic illustration of the calculation results</li> </ul> <p>Administration, documentation and access to all project-related data and parameters over the entire life cycle of a project.</p> <p>Applicator is available: Via the Internet: <a href="https://portal.endress.com/webapp/applicator">https://portal.endress.com/webapp/applicator</a></p>
Configurator	<p>Product Configurator - the tool for individual product configuration</p> <ul style="list-style-type: none"> <li>■ Up-to-the-minute configuration data</li> <li>■ Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language</li> <li>■ Automatic verification of exclusion criteria</li> <li>■ Automatic creation of the order code and its breakdown in PDF or Excel output format</li> <li>■ Ability to order directly in the Endress+Hauser Online Shop</li> </ul> <p>The Configurator is available on the Endress+Hauser website: <a href="http://www.endress.com">www.endress.com</a> -&gt; Click "Corporate" -&gt; Select your country -&gt; Click "Products" -&gt; Select the product using the filters and the search field -&gt; Open the product page -&gt; The "Configure" button to the right of the product image opens the Product Configurator.</p>
DeviceCare SFE100	<p>Configuration tool for devices via fieldbus protocols and Endress+Hauser service protocols. DeviceCare is the tool developed by Endress+Hauser for the configuration of Endress+Hauser devices. All smart devices in a plant can be configured via a point-to-point or point-to-bus connection. The user-friendly menus enable transparent and intuitive access to the field devices.</p> <p> For details, see Operating Instructions BA00027S</p>
FieldCare SFE500	<p>FDT-based plant asset management tool from Endress+Hauser. It can configure all smart field units in your system and helps you manage them. By using the status information, it is also a simple but effective way of checking their status and condition.</p> <p> For details, see Operating Instructions BA00027S and BA00065S</p>



W@M	<p>Life cycle management for your plant</p> <p>W@M supports you with a wide range of software applications over the entire process: from planning and procurement, to the installation, commissioning and operation of the measuring devices. All the relevant device information, such as the device status, spare parts and device-specific documentation, is available for every device over the entire life cycle.</p> <p>The application already contains the data of your Endress+Hauser device. Endress+Hauser also takes care of maintaining and updating the data records.</p> <p>W@M is available: Via the Internet: <a href="http://www.endress.com/lifecyclemanagement">www.endress.com/lifecyclemanagement</a></p>
-----	---

## System components

Accessories	Description
RN221N	<p>Active barrier with power supply for safe separation of 4 to 20 mA standard signal circuits. Has bidirectional HART® transmission and optional HART® diagnostics if transmitters are connected with monitoring of 4 to 20 mA signal or HART® status byte analysis and an E+H-specific diagnostic command.</p> <p> For details, see Technical Information TI073R/09</p>
RIA15	<p>Process display, digital loop-powered display for 4 to 20 mA circuit, panel mounting, with optional HART® communication. Displays 4 to 20 mA or up to 4 HART® process variables</p> <p> For details, see Technical Information TI01043K/09</p>
Graphic Data Manager Memograph M	<p>The Advanced Data Manager Memograph M is a flexible and powerful system for organizing process values. Optional HART® input cards are available, each with 4 inputs (4/8/12/16/20), with highly accurate process values from the HART® devices directly connected for the purpose of calculation and data logging. The measured process values are clearly presented on the display and logged safely, monitored for limit values and analyzed. Via common communication protocols, the measured and calculated values can be easily communicated to higher-level systems or individual plant modules can be interconnected.</p> <p> For details, see Technical Information TI01180R/09</p>

## Supplementary documentation

- Operating Instructions 'iTEMP TMT72', HART® communication (BA01854T/09/en) and a hard copy of the associated Brief Operating Instructions 'iTEMP TMT72, TMT71' (KA01414T/09)
- Supplementary ATEX documentation:
  - ATEX/IECEX: II1G Ex ia IIC T6...T4 Ga: XA01736T/09/a3
  - ATEX II2G Ex d IIC: XA01007T/09/a3 (transmitter in field housing)
  - ATEX II3G Ex ic IIC: XA01155T/09/a3
  - ATEX II 3D, II 3G: XA01006T/09/a3
- Supplementary documentation CSA: XA01904T/09

---

---



[www.addresses.endress.com](http://www.addresses.endress.com)

---